

# LEGEND

**LEGEND**

	CONCRETE		NORTH ARROW		ELEVATION REFERENCE
	STONE FILL		CENTERLINE		DRAWING NO.
	CONCRETE MASONRY		COLUMN CENTERLINE		ELEVATION REFERENCE
	BRICK		SPOT ELEVATION		DRAWING NO.
	STEEL		REVISION AREA		SECTION REFERENCE
	ALUMINUM		REVISION NUMBER		DRAWING NO.
	PLYWOOD		CEILING ELEVATION		DETAIL REFERENCE
	FINISH WOOD		SPACE TAG		DRAWING NO.
	GYPSUM WALLBOARD		ROOM NAME		DRAWING NO.
	EARTH		ROOM NO.		DRAWING NO.
	BATT. INSULATION		ROOM INFO.		DRAWING NO.
	RIGID INSULATION		ROOM TAG		DRAWING NO.
	BLOCKING		WINDOW TAG		DRAWING NO.
			DOOR TAG		DRAWING NO.
			WALL TAG		DRAWING NO.

# ABBREVIATIONS

A.B.	ANCHOR BOLT	E	EAST	INT.	INTERIOR	REQD.	REQUIRED
ACoust.	ACOUSTICAL	EA	EACH	J.B.	JOIST BEARING	RESL.	RESILIENT
ACT	ACOUSTICAL CEILING TILE	E.B.	EXPANSION BOLT	J.T.	JOINT	REV.	REVISION
A.F.F.	ABOVE FINISH FLOOR	E.I.F.S.	EXTERIOR INSULATION FINISH SYSTEM	LAM.	LAMINATED	RM	ROOM
ALUM.	ALUMINUM	E.J.	EXPANSION JOINT	LF	LINEAR FEET	R.O.	ROUGH OPENING
APPROX.	APPROXIMATELY	EL.	ELEVATION (FLOOR)	LG	LONG, LARGE	REQMTS.	REQUIREMENTS
ARCH.	ARCHITECT, ARCHITECTURAL	ELEV.	ELEVATION	LLH	LONG LES HORIZONTAL	RTU	ROOF TOP UNIT
BD.	BOARD	ELEC.	ELECTRICAL	LLV	LONG LES VERTICAL	R/WL	RAIN WATER LEADER
BLDG.	BUILDING	EQ.	EQUAL	L.P.	LOW POINT	SCHED.	SCHEDULE
BLK.	BLOCK	EQUIP.	EQUIPMENT	MAS.	MASONRY	S.F.	SQUARE FEET
BM.	BEAM	EW	EACH WAY	MATL.	MATERIAL	SHT.	SHEET
B.O.S.	BOTTOM OF STEEL	EW	ELECTRIC WATER COOLER	MAX.	MAXIMUM	SM	SIMILAR
BRG.	BEARING	EXIST.	EXISTING	MECH.	MECHANICAL	S.M.S.	SHEET METAL SCREEN
BS	BOTH SIDES	EXP.	EXPANDED EXPANSION	MED.	MEDIUM	SPECS.	SPECIFICATIONS
BTM.	BOTTOM	EXT.	EXTERIOR	MFR.	MANUFACTURER	SQ.	SQUARE
BUR.	BUILT-UP ROOF	F.D.	FLOOR DRAIN	MN.	MINIMUM	S.S.	STAINLESS STEEL
C.I.	CAST IRON	F.E.	FIRE EXTINGUISHER	MISC.	MISCELLANEOUS	STD.	STANDARD
C.J.	CONTROL JOINT	F.F.E.	FINISH FLOOR ELEVATION	M.O.	MASONRY OPENING	STL.	STEEL
C.T.	CERAMIC TILE	F.F.	FACE OF	M.R.	MOISTURE-RESISTANT	STOR.	STORAGE
CAB.	CABINET	FN.	FINISH	M.R.G.B.	MOISTURE-RESISTANT GYPSUM BOARD	STRUCT.	STRUCTURAL
CEM.	CEMENTITIOUS	FL.F.R.	FLOOR	MTD.	MOUNTED	SUSP.	SUSPENDED
CG	CORNER GUARD	FLUOR.	FLUORESCENT	MTL.	METAL	T	TREAD
CLR.	CLEAR	FN.	FOUNDATION	N	NORTH	T/B	TOP & BOTTOM
CLNG.	CEILING	F.S.	FLOOR SINK	N.C.	NOT IN CONTRACT	TEL.	TELEPHONE
CMU	CONCRETE MASONRY UNIT	FTG.	FOOTING	N.O.	NUMBER	TO	TOP OF
CO	CLEAN OUT	G.C.	GENERAL CONTRACTOR	NTS	NOT TO SCALE	T.O.M.	TOP OF MASONRY
COL.	COLUMN	GA.	GAUGE	O/A	OVERALL	T.O.S.	TOP OF STEEL
CONC.	CONCRETE	GALV.	GALVANIZED	O.F.D.	OVERFLOW DRAIN	TH	THICKNESS
CONST.	CONSTRUCTION	GEN.	GENERAL	OH	OVERHEAD	TRP.	TYPICAL
CONT.	CONTINUOUS	GL.	GLASS GLAZING	OO	OUT TO OUT	U.L.	UNDERWRITERS LABORATORY
CONTR.	CONTRACTOR	GWB	GYPSUM WALLBOARD	O.C.	ON CENTER	U.O.N.	UNLESS OTHERWISE NOTED
CPT.	CARPET	GYP.	GYPSUM	O.D.	OUTSIDE DIAMETER	V	VOLT
CR	CARBONALCHARRAL	H	HIGH	OPNG.	OPENING	VCT	VINYL COMPOSITION TILE
CSX	COUNTERSINK	HB	HOSE BIBB	OPP.	OPPOSITE	VERT.	VERTICAL
D	DEPTH	HC	HANDICAPPED	P	PIKE	W	WEST, WIDTH, WASTE, WIRE
DBL.	DOUBLE	HDW.	HARDWARE	PC.	PIECE	W	WITH
DEMO	DEMOLITION	H.M.	HOLLOW METAL	PL.	PLATE	W.C.	WATER CLOSET
DET.	DETAIL	HORZ.	HORIZONTAL	PLAS.	PLASTER, PLASTIC	WD.	WOOD
DIAMETER	H.P.	H.P.	HIGH POINT	PLYWD.	PLYWOOD	WT	WEIGHT
DN.	DOWN	HT.	HEIGHT	PTD.	PAINTED	WR, WH	WATER HEATER
DM.	DIMENSION	HVAC	HEATING, VENTILATION & AIR CONDITIONING	QUAN.	QUANTITY	W	WITHIN
D.O.	DOOR OPENING	ID.	INTERIOR DIAMETER	Q.T.	QUARRY TILE	W/O	WITHOUT
D.S.	DOOR SWING	INCL.	INCLUDE	R	RADIUS, RISER	WWF	WELDED WIRE FABRIC
DWG.	DRAWING	INSUL.	INSULATION	R.D.	ROOF DRAIN	X	EXISTING TO REMAIN
				RENF.	REINFORCING	XTR	EXISTING TO BE REMOVED

# GENERAL NOTES

- GENERAL CONTRACTOR SHALL NOTIFY ARCHITECT OF ANY DISCREPANCIES FOUND IN THE PLANS, DETAILS AND/OR SPECIFICATIONS PRIOR TO PROCEEDING WITH CONSTRUCTION.
- CONTRACTOR SHALL BEAR RESPONSIBILITY FOR VERIFYING COMPLIANCE OF SHOP DRAWINGS WITH THE CONTRACT DOCUMENTS PRIOR TO ORDERING MATERIALS OR BEGINNING FABRICATION.
- GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING ALL WORK INCLUDED IN THE CONTRACT DOCUMENTS. ALL CORRESPONDENCE FROM THE SUBCONTRACTORS SHALL BE THROUGH THE GENERAL CONTRACTOR.
- CONTRACTOR SHALL BE RESPONSIBLE FOR COMPLYING WITH ALL APPLICABLE CODES AND STATUTES, WHETHER SPECIFICALLY REFERENCED BY THE PLANS OR NOT.
- CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL REQUIRED PERMITS AND SECURING REQUIRED INSPECTIONS.
- BUILDING SIGNAGE IS TO BE PROVIDED UNDER SEPARATE CONTRACT BY OTHERS.
- GENERAL CONTRACTOR IS RESPONSIBLE FOR PROVIDING ALL SIGNAGE IN COMPLIANCE WITH THE AMERICANS WITH DISABILITIES ACT (A.D.A.), ICC/ANSI A117.1-2009, AND THE LATEST EDITION OF THE NORTH CAROLINA BUILDING CODE.
- ALL MATERIALS ARE TO BE NEW UNLESS OTHERWISE NOTED.
- ANY DEFECTIVE WORK AND ANY DAMAGE RESULTING THEREFROM SHALL BE REPAIRED AT NO COST TO THE OWNER.
- ALTHOUGH THESE DRAWINGS ARE DRAWN TO SCALE, NO DIMENSIONS ARE TO BE DETERMINED BY SCALING THE DRAWINGS. ANY QUESTIONS OR DISCREPANCIES ARE TO BE BROUGHT TO THE ATTENTION OF THE ARCHITECT.
- CONTRACTOR IS RESPONSIBLE FOR REMOVING AND LEGALLY DISPOSING OF ALL REFUSE FROM THE PROJECT.
- NO SMOKING WILL BE PERMITTED INSIDE THE PROJECT AREA.
- CONTRACTOR SHALL PROVIDE BLOCKING AS REQUIRED TO SUPPORT ALL CONTRACTOR-SUPPLIED AND OWNER-SUPPLIED WALL-HUNG EQUIPMENT OR CASEWORK. CONFIRM LOCATIONS WITH OWNER PRIOR TO INSTALLATION.
- THE ADJACENT SITE MAY BE OCCUPIED BY THE PUBLIC DURING CONSTRUCTION. THE G.C. SHALL TAKE ALL PRECAUTIONS NECESSARY TO SAFEGUARD THE HEALTH AND WELFARE OF THE PUBLIC. ALL REQUIRED MEANS OF EGRESS SHALL BE KEPT CLEAR AND ACCESSIBLE AT ALL TIMES.
- THE GENERAL CONTRACTOR SHALL THOROUGHLY REVIEW MANUFACTURER'S LITERATURE AND SHOP DRAWINGS FOR ALL FIXTURES AND/OR EQUIPMENT (WHETHER PROVIDED BY THE OWNER, TENANT OR CONTRACTOR) PRIOR TO ROUGH-IN FOR UTILITIES. CONFIRM ANY DISCREPANCIES PRIOR TO COMMENCEMENT OF WORK.
- LABEL ALL FIRE-RATED WALLS ABOVE CEILING AS REQUIRED BY NC BUILDING CODE 2018, SECTION 703.7. SUGGESTED WORDING: "... HR RATED FIRE AND/OR SMOKE BARRIER. PROTECT ALL OPENINGS."
- G.C. SHALL PROVIDE KNOX BOX, IF REQUIRED BY LOCAL JURISDICTION.




VICINITY MAP

# SEPARATE CONTRACTS:

INCLUDING, BUT NOT LIMITED TO:

SECURITY AND TELECOMMUNICATIONS : THE OWNER SHALL CONTRACT WITH SEPARATE FIRMS TO PROVIDE SECURITY AND TELECOMMUNICATIONS EQUIPMENT AND INSTALLATION. GENERAL CONTRACTOR SHALL PROVIDE BOXES AND CONDUIT AS INDICATED IN THESE DRAWINGS.

# ATTENDANT BUILDING ASSEMBLY COURT SOLID WASTE CONVIENENCE CENTER

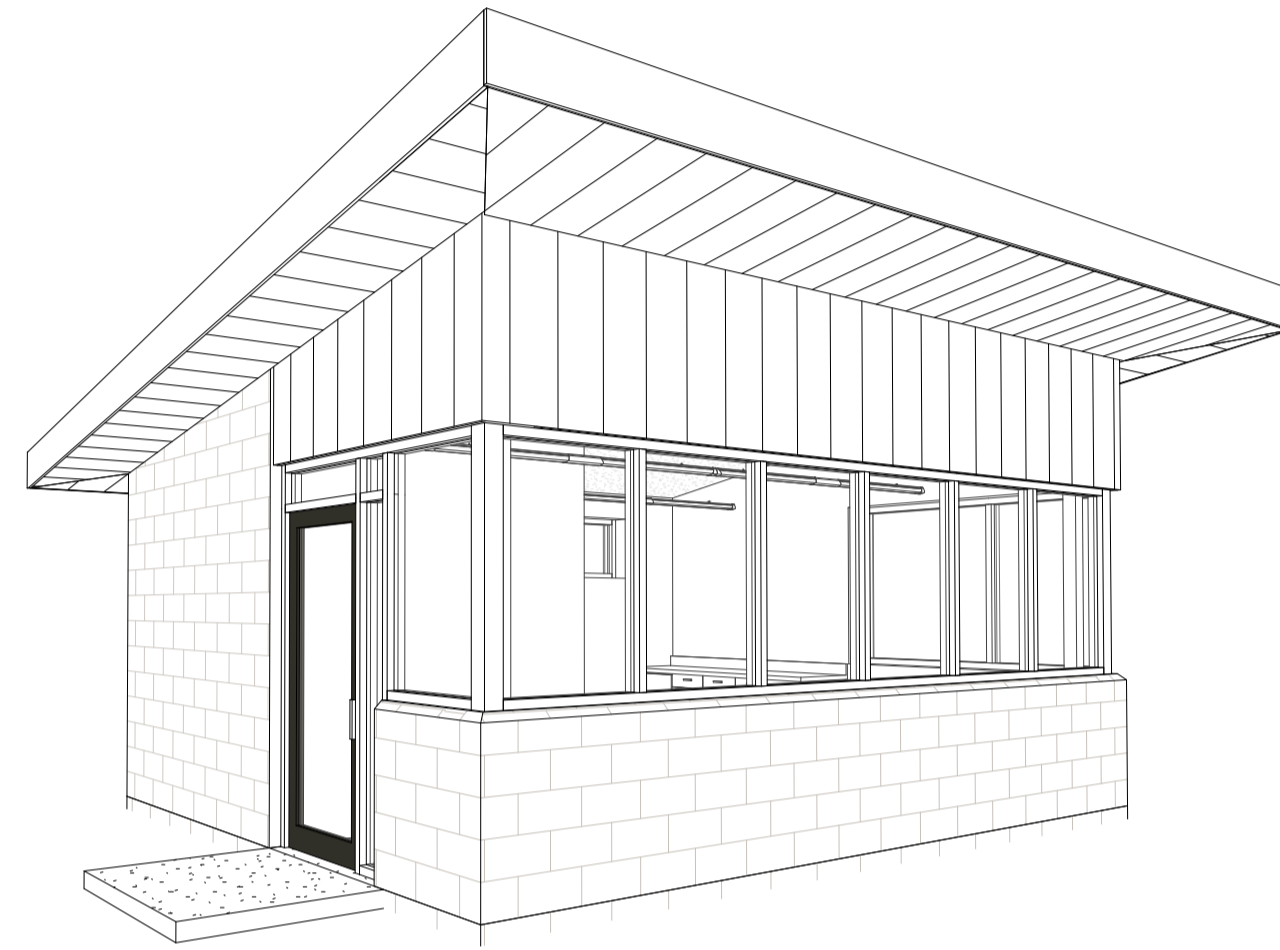

575 ASSEMBLY COURT  
FAYETTEVILLE NC, 28306

**ARCHITECT:**  
GONTRAM ARCHITECTURE, INC  
5100 UNICON DR SUITE 103  
WAKE FOREST NC, 27587  
P:(919) 876-5331  
eddie@gontramarchitecture.com

# STRUCTURAL ENGINEER:

ROSS LINDEN ENGINEERS, PC  
709 W. JONES ST.  
RALEIGH NC, 27603  
P:(919) 832-5680  
brian@rosslinden.com

# PLUMBING, MECHANICAL AND ELECTRICAL ENGINEERS:

ATLANTEC ENGINEERS, P.A.  
3221 BLUE RIDGE RD., SUITE 113  
RALEIGH, NC 27612  
P:(919) 571-1111  
david@atlantecengineers.com

# CIVIL ENGINEERING:

SMITH GARDNER, INC  
14 N. BOYLAN AVE  
RALEIGH NC, 2603  
P:(919) 828-0577

# INDEX OF DRAWINGS

Sheet #	DESCRIPTION	SHEET DATE	ISSUED FOR CONSTRUCTION	LATEST REVISION
<b>GENERAL</b>				
G101	COVER SHEET	03/13/2025	MARCH 13, 2025	
G102	BUILDING CODE SUMMARY	11/06/2023	MARCH 13, 2025	
<b>ARCHITECTURAL</b>				
A101	FLOOR PLAN	11/06/2023	MARCH 13, 2025	
A201	ROOF & REFLECTED CEILING PLAN	11/06/2023	MARCH 13, 2025	
A301	EXTERIOR ELEVATIONS	11/06/2023	MARCH 13, 2025	
A401	WINDOW & DOOR SCHEDULE	11/06/2023	MARCH 13, 2025	
A501	INTERIOR ELEVATIONS	11/06/2023	MARCH 13, 2025	
A601	BUILDING SECTIONS	11/06/2023	MARCH 13, 2025	
A701	WALL SECTIONS	11/06/2023	MARCH 13, 2025	
<b>ARCHITECTURAL SPECIFICATIONS</b>				
AS-001	SPECIFICATIONS	11/06/2023	MARCH 13, 2025	
AS-002	SPECIFICATIONS	11/06/2023	MARCH 13, 2025	
<b>STRUCTURAL</b>				
S101	FOUNDATION AND FRAMING PLANS	11/02/2023	MARCH 13, 2025	
S201	SECTIONS AND DETAILS	11/02/2023	MARCH 13, 2025	
<b>PLUMBING</b>				
P101	PLUMBING PLAN, SCHEDULES, DETAILS, NOTES	09/07/2023	MARCH 13, 2025	
<b>MECHANICAL</b>				
M-01	MECHANICAL PLAN, SCHEDULES, DETAILS, NOTES	09/07/2023	MARCH 13, 2025	
<b>ELECTRICAL</b>				
E1.1	ELECTRICAL PLANS, POWER RISER PANEL, SCHEDULE	03/13/2025	MARCH 13, 2025	
E1.2	SITE POWER PLAN	03/12/2025	MARCH 13, 2025	
E2.1	SYMBOL LEGEND, GENERAL NOTES, LDETAILS	03/12/2025	MARCH 13, 2025	



GONTRAM ARCHITECTURE, INC.

5100 UNICON DR. SUITE 103  
WAKE FOREST, NC 27587  
PHONE: 919.876.5331

eddie@gontramarchitecture.com  
www.gontramarchitecture.com

© Copyright 2023

THESE DOCUMENTS ARE INSTRUMENTS OF SERVICE AND AS SUCH REMAIN THE PROPERTY OF THE ARCHITECT. PUBLISH OR USE THEM ONLY WITH THE ARCHITECT'S EXPRESSED WRITTEN APPROVAL.



ATTENDANT BUILDING  
ASSEMBLY COURT SOLID WASTE  
CONVENIENCE CENTER  
575 ASSEMBLY COURT | FAYETTEVILLE, NC 28306

PLOT DATE:  
03/13/2025

ISSUED:  
MARCH 13, 2025

FOR CONSTRUCTION

Rev.	Date	Description

DRAWN BY: PJA  
APPROVED: EJC  
PROJECT NO.: 22003  
RECORD:

CONTENTS:  
COVER SHEET

SHEET:  
G101

BUILDING CODE SUMMARY

2018 APPENDIX B

BUILDING CODE SUMMARY FOR ALL COMMERCIAL PROJECTS (EXCEPT FOR 1 AND 2- FAMILY DWELLINGS AND TOWNHOUSES)

NAME OF PROJECT: CUMBERLAND LANDFILL ASSEMBLY CT. ADDRESS: 575 ASSEMBLY CT. FAYETTEVILLE, NC ZIP CODE: 28306

DESIGNER: FIRM NAME LICENSE# TELEPHONE# E-MAIL

Table with columns: ARCHITECT, CIVIL, ELECTRICAL, FIRE ALARM, PLUMBING, MECHANICAL, SPRINK-STNDR, STRUCTURAL, RET. WALL > 5' H., OTHER.

2018 NC BUILDING CODE: NEW BUILDING ADDITION RENOVATION 1st TIME INTERIOR COMPLETION

2018 NC EXISTING BUILDING CODE: PRESCRIPTIVE REPAIR CHAPTER 14 ALTERATION-LEVEL HISTORIC PROPERTY CHANGE OF USE

CONSTRUCTED: (date) CURRENT OCCUPANCY(S) (Ch.3) B RENOVATED: (date) PROPOSED OCCUPANCY(S) (Ch.3) B OCCUPANCY CATEGORY (Table 1604.5): Current: II Proposed: II

SCOPE OF WORK: NEW CONSTRUCTION OF 326 SF ATTENDANT BUILDING FOR LANDFILL CONVENIENCE CENTER

BASIC BUILDING DATA

CONSTRUCTION TYPE: I-A II-A III-A IV V-A I-B II-B III-B V-B

SPRINKLERS: NO PARTIAL YES NFPA 13 NFPA 13R NFPA 13D STANDPIPES: NO YES CLASS: I II III WET DRY FIRE DISTRICT: NO YES FLOOD HAZARD AREA: NO YES SPECIAL INSPECTIONS REQUIRED: NO

GROSS BUILDING AREA TABLE

Table with columns: FLOOR, EXISTING (SQ. FT.), NEW (SQ. FT.), SUB-TOTAL. Rows include 4TH FLOOR, 3RD FLOOR, 2ND FLOOR, 1ST FLOOR, BASEMENT, TOTAL.

PROJECT AREA: 326 SF

ALLOWABLE AREA

PRIMARY OCCUPANCY CLASSIFICATION(S): ASSEMBLY: A-1 A-2 A-3 A-4 A-5 BUSINESS EDUCATIONAL FACTORY: F-1 Moderate F-2 Low HIGH-HAZARD: H-1 (Detonate) H-2 (Deflagrate) H-3 (Combust) H-4 (Health) H-5 (HPM) INSTITUTIONAL: I-1 Condition I-2 I-3 Condition I-1 I-2 I-3 I-4 Condition I-1 I-2 I-3 I-4 I-5 MERCANTILE RESIDENTIAL: R-1 R-2 R-3 R-4 STORAGE: S-1 Moderate S-2 Low High-Piled Parking Garage Open Enclosed Repair Garage UTILITY AND MISCELLANEOUS

ACCESSORY OCCUPANCY CLASSIFICATION(S): INCIDENTAL USES (TABLE 509): SPECIAL USES (CHAPTER 4 - List code sections): SPECIAL PROVISIONS (CHAPTER 5 - List code sections): MIXED OCCUPANCY: NO YES SEPARATION Hr. EXCEPTION

NON-SEPARATED MIXED OCCUPANCY (508.3) The required type of construction for the building shall be determined by applying the height and area limitations for each of the applicable occupancies to the entire building. The most restrictive type of construction, so determined, shall apply to the entire building. SEPARATED MIXED OCCUPANCY (508.4) - SEE BELOW FOR AREA CALCULATIONS For each story, the area of the occupancy shall be such that the sum of the ratios of the actual floor area of each use divided by the allowable floor area for each use shall not exceed 1.

ACTUAL AREA OF OCCUPANCY A / ALLOWABLE AREA OF OCCUPANCY A + ACTUAL AREA OF OCCUPANCY B / ALLOWABLE AREA OF OCCUPANCY B <= 1

ACTUAL AREA OF OCCUPANCY A / ALLOWABLE AREA OF OCCUPANCY A + ACTUAL AREA OF OCCUPANCY B / ALLOWABLE AREA OF OCCUPANCY B <= 1

ACTUAL AREA OF OCCUPANCY A / ALLOWABLE AREA OF OCCUPANCY A + ACTUAL AREA OF OCCUPANCY B / ALLOWABLE AREA OF OCCUPANCY B <= 1

Table with columns: STORY NO., DESCRIPTION AND USE, (A) BLDG AREA PER STORY (ACTUAL), (B) TABLE 506.2 AREA, (C) AREA FOR FRONTAGE INCREASE 1/2, (D) ALLOWABLE FLOOR AREA OR UNLIMITED 1/2. Row 1: BUSINESS (B), 326, 23,000, 23,000.

1 Frontage area increases from Section 506.3 are computed thus: a. Perimeter which fronts a public way or open space having 20 feet minimum width = (F) b. Total Building Perimeter = (P) c. Ratio (F/P) = (F/P) d. W = Minimum width of public way = (W) e. Percent of frontage increase I = 100(F/P - 0.25) x W/30 = (%) 2 Unlimited area applicable under conditions of Section 507. 3 Maximum Building Area = total number of stories in the building x D (maximum 3 stories) (506.2). 4 The maximum area of open parking garages must comply with Table 406.5.4. 5 Frontage increase is based on the unpermitted area value in Table 506.2.

ALLOWABLE HEIGHT

Table with columns: BUILDING HEIGHT IN FEET (TABLE 504.3), BUILDING HEIGHT IN STORIES (TABLE 504.4), ALLOWABLE, SHOWN ON PLANS, CODE REFERENCE. Row 1: 12-9', 1, S=2.

1 Provide code reference if the "Shown on Plans" quantity is not based on Table 504.3 or 504.4. 2 The maximum height of air traffic control towers must comply with Table 412.3.1. 3 The maximum height of open parking garages must comply with Table 406.5.4.

FIRE PROTECTION REQUIREMENTS

Table with columns: BUILDING ELEMENT, FIRE SEPARATION DISTANCE (FEET), REVD, RATING, DETAIL # AND SHEET #, DESIGN # FOR RATED ASSEMBLY, DESIGN # FOR RATED PENETRATION, DESIGN # FOR RATED JOINTS. Rows include STRUCTURAL FRAME, BEARING WALLS, NONBEARING WALLS AND PARTITIONS, FLOOR CONSTRUCTION, ROOF CONSTRUCTION, EXTERIOR WALLS, FLOORS OVER UNCONDITIONED SPACE, FLOORS SLAB ON GRADE.

\* INDICATE SECTION NUMBER PERMITTING REDUCTION.

PERCENTAGE OF WALL OPENINGS CALCULATIONS

Table with columns: FIRE SEPARATION DISTANCE (FEET) FROM PROPERTY LINES, DEGREE OF OPENINGS PROTECTION (TABLE 705.8), ALLOWABLE AREA (%), ACTUAL SHOWN ON PLANS (%). Row 1: ALL EXT. WALLS ARE > 30 FT, UP, NS, NO LIMIT.

LIFE SAFETY SYSTEM REQUIREMENTS

EMERGENCY LIGHTING: NO YES EXIT SIGNS: NO YES FIRE ALARM: YES SMOKE DETECTION SYSTEMS: NO YES PARTIAL CARBON MONOXIDE DETECTION: NO YES

LIFE SAFETY PLAN REQUIREMENTS

LIFE SAFETY PLAN SHEET #: G102 Fire and/or smoke rated wall locations (Chapter 7) Assumed and real property line locations Exterior wall opening area with respect to distance to assumed property lines (705.8) Occupancy Use for each area as it relates to occupant load calculation. (Table 1004.1.2) Occupant loads for each area Exit sign locations (1013) Exit access travel distances (1017) Common paths of travel distances (1006.2.1 & 1006.3.2(1)) Dead end lengths (1020.4) Clear exit widths for each exit door Maximum calculated occupant load capacity each exit door can accommodate based on egress width (1005.3) Actual occupant load for each exit door A separate schematic plan indicating where fire rated floor/ceiling and/or roof structure is provided for purposes of occupancy separation. Location of doors with panic hardware (1010.1.10) Location of doors with delayed egress locks and the amount of delay (1010.1.9.7) Location of doors with electromagnetic egress locks (1010.1.9.8) Location of doors equipped with hold-open devices Location of emergency escape windows (1030) The square footage of each fire area (202) The square footage of each smoke compartment for Occupancy Classification I-2 (407.5) Note any code exceptions or table notes that may have been utilized regarding the items above.

ACCESSIBLE DWELLING UNITS (SECTION 1107) (NOT APPLICABLE)

Table with columns: TOTAL UNITS, ACCESSIBLE UNITS REQUIRED, ACCESSIBLE UNITS PROVIDED, TYPE A UNITS REQUIRED, TYPE A UNITS PROVIDED, TYPE B UNITS REQUIRED, TYPE B UNITS PROVIDED, TOTAL ACCESSIBLE UNITS PROVIDED.

ACCESSIBILITY PARKING (SECTION 1106)

Table with columns: LOT OR PARKING AREA, TOTAL # OF PARKING SPACES REQUIRED, PROVIDED, # OF ACCESSIBLE SPACES PROVIDED (96" SPACES, 132" SPACES), TOTAL # ACCESSIBLE PROVIDED. Row 1: 3, 3, 1, 1.

PLUMBING FIXTURE REQUIREMENTS (TABLE 2902.1)

Table with columns: USE, WATER CLOSETS (MALE, FEMALE, UNSEX), URINALS (MALE, FEMALE, UNSEX), LAVATORIES, SHOWERS/TUBS, DRINKING FOUNTAINS (REGULAR, ACCESSIBLE). Row 1: EXISTING, 1, 1, 1, 0, 0. Row 2: NEW REQUIRED, 1\*, 1\*, 1\*, 0\*\*, 0\*\*.

\*NOTE: PER NPCC 403.2 EXCEPTION 2, SEPARATE FACILITIES SHALL NOT BE REQUIRED IN BUSINESS OCCUPANCIES WITH A TOTAL OCCUPANT LOAD, INCLUDING EMPLOYEES AND CUSTOMERS, OF 30 OR FEWER.

\*\*NOTE: PER NPCC 410.2, DRINKING FOUNTAINS SHALL NOT BE REQUIRED FOR AN OCCUPANT LOAD OF 30 OR FEWER.

SPECIAL APPROVALS

SPECIAL APPROVAL: (Local Jurisdiction, Department of Insurance, OSC, DPI, DHHS, etc. describe below) (NOT APPLICABLE)

ENERGY SUMMARY

ENERGY REQUIREMENTS: The following data shall be considered minimum and any special attribute required to meet the energy code shall also be provided. Each designer shall furnish the required portions of the required information for the plan data sheet. If performance method, state the annual energy cost for the standard reference design versus the annual energy cost for the proposed design. EXISTING BUILDING ENVELOPE COMPLIES WITH CODE: NO YES (the remainder of this section is not applicable) EXEMPT BUILDING: NO YES (provide code or statutory reference) CLIMATE ZONE: 3A 4A 4B

METHOD OF COMPLIANCE: ENERGY CODE - PERFORMANCE ENERGY CODE - PRESCRIPTIVE OTHER ASHRAE 90.1 - PERFORMANCE ASHRAE 90.1 - PRESCRIPTIVE If "other" specify source here

THERMAL ENVELOPE (Prescriptive method only)

ROOF/CEILING ASSEMBLY (each assembly) MEMBRANE ROOF OVER RIGID INSULATION OVER SHEATHING OVER METAL JOISTS FILLED WITH BATT INSULATION DESCRIPTION OF ASSEMBLY U-VALUE OF TOTAL ASSEMBLY U = 0.028 R-VALUE OF INSULATION BATT INSULATION = R-25 RIGID INSULATION = R-10 ci SKYLIGHTS IN EACH ASSEMBLY U-VALUE OF SKYLIGHT U-VALUE OF SKYLIGHT TOTAL SQUARE FOOTAGE OF SKYLIGHTS IN EACH ASSEMBLY

EXTERIOR WALLS (each assembly) CMU VENEER OR METAL PANEL, AIRSPACE, RIGID INSULATION, SHEATHING, METAL STUDS, BATT INSULATION, GYPSUM WALLBOARD DESCRIPTION OF ASSEMBLY U-VALUE OF TOTAL ASSEMBLY U = 0.033 R-VALUE OF INSULATION BATT INSULATION = R-20 RIGID INSULATION = R-7.5 ci OPENINGS (windows or doors with glazing) U-VALUE OF ASSEMBLY U-VALUE = 0.45 SOLAR HEAT GAIN COEFFICIENT SHGC = .33 PROTECTION FACTOR PF = 0.20 DOOR R-VALUES U-VALUE = .77

WALLS BELOW GRADE (each assembly) DESCRIPTION OF ASSEMBLY U-VALUE OF TOTAL ASSEMBLY R-VALUE OF INSULATION

FLOORS OVER UNCONDITIONED SPACE (each assembly) DESCRIPTION OF ASSEMBLY U-VALUE OF TOTAL ASSEMBLY R-VALUE OF INSULATION

FLOORS SLAB ON GRADE (each assembly) DESCRIPTION OF ASSEMBLY U-VALUE OF TOTAL ASSEMBLY R-VALUE OF INSULATION HORIZONTAL/VERTICAL REQUIREMENT UNHEATED

STRUCTURAL DESIGN



DESIGN LOADS: IMPORTANCE FACTORS: SNOW (ls) SEISMIC (I) LIVE LOADS: ROOF 20 PSF MEZZANINE n/a PSF FLOOR 100 PSF GROUND SNOW LOAD: 10 PSF WIND LOAD: BASIC WIND SPEED 122 MPH (ASCE-7) EXPOSURE CATEGORY

SEISMIC DESIGN CATEGORY: Risk Category (Table 1604.5) Spectral Response Acceleration Site Classification (ASCE 7) Basic Structural System: Bearing Wall Dual w/Special Moment Frame Building Frame Dual w/Intermediate R/C or Special Steel Moment Frame Inverted Pendulum Analysis Procedure: Simplified Equiv. Lateral Force Dynamic Architectural, Mechanical, Components anchored? Yes No LATERAL DESIGN CONTROL: Earthquake Wind SOIL BEARING CAPACITIES: Field Test (provide copy of test report) psf Presumptive Bearing Capacity Pile size, type, and capacity psf

ELECTRICAL SYSTEM AND EQUIPMENT (SEE ELECTRICAL DRAWINGS FOR ELECTRICAL ENERGY CODE CALCULATIONS.)

MECHANICAL SYSTEMS, SERVICE SYSTEMS AND EQUIPMENT (SEE MECHANICAL DRAWINGS FOR MECHANICAL ENERGY CODE CALCULATIONS.)

LIFE SAFETY PLAN LEGEND

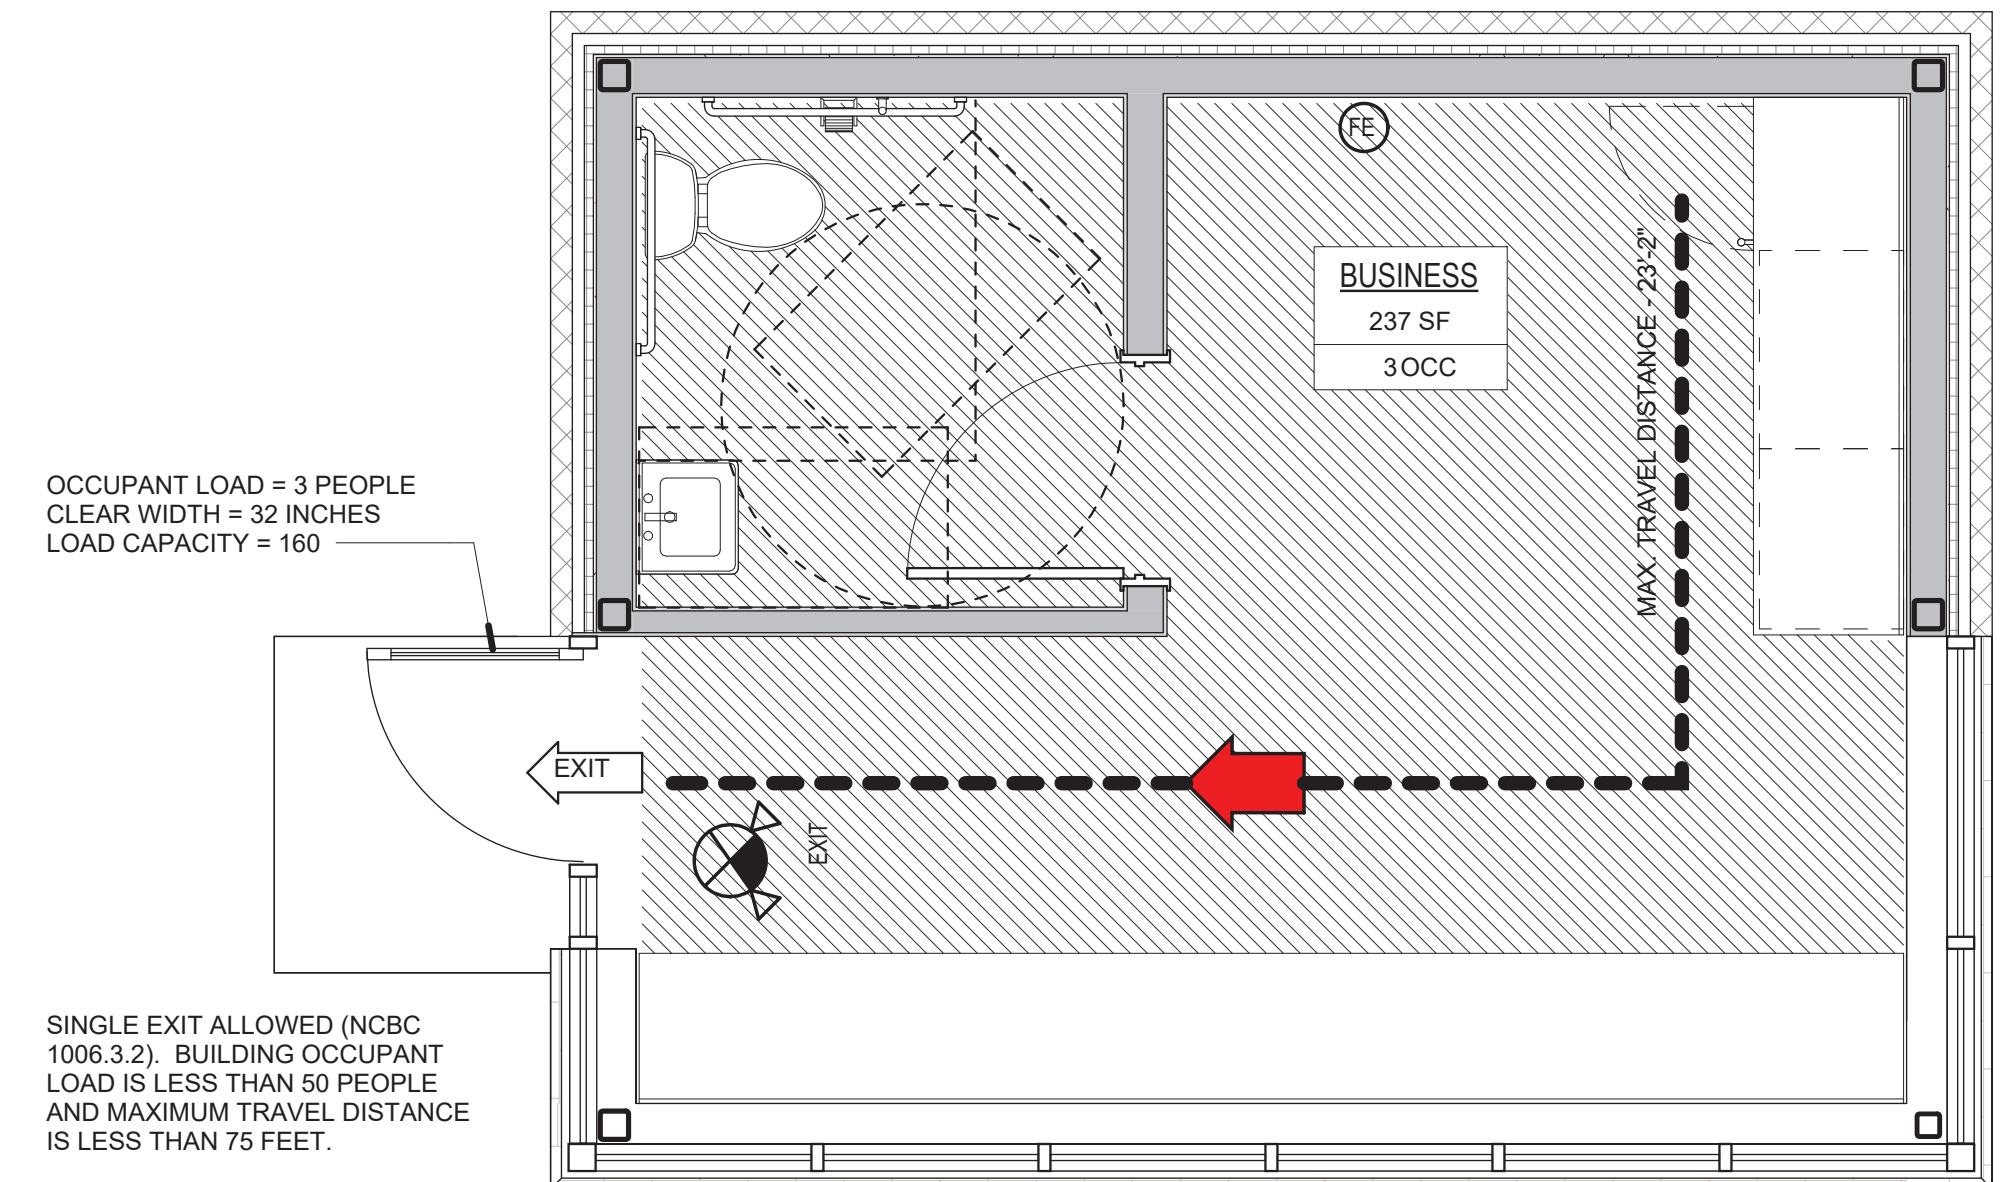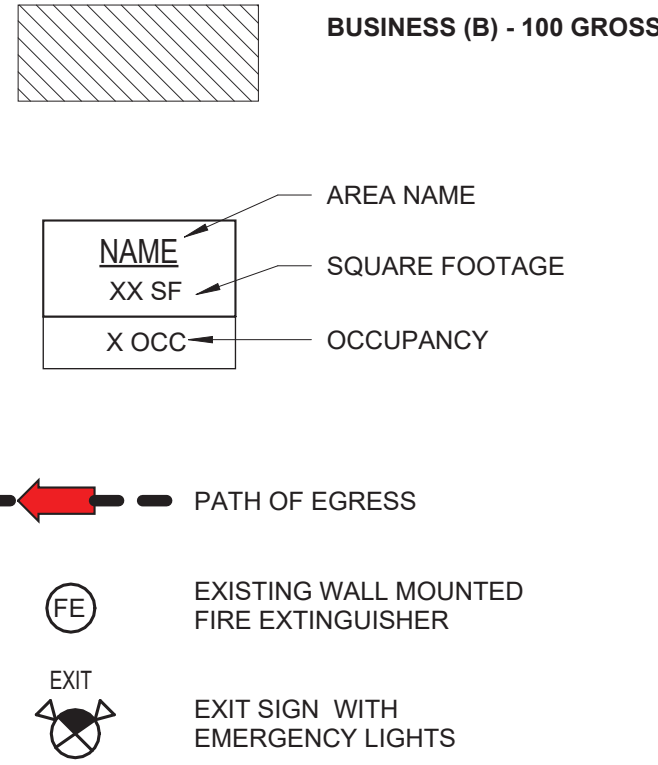

SINGLE EXIT ALLOWED (NCBC 1006.3.2). BUILDING OCCUPANT LOAD IS LESS THAN 50 PEOPLE AND MAXIMUM TRAVEL DISTANCE IS LESS THAN 75 FEET.

1 LIFE SAFETY PLAN 3/8" = 1'-0"



GONTRAM ARCHITECTURE, INC.

5100 UNICON DR. SUITE 103 WAKE FOREST, NC 27587 PHONE: 919.876.5331

eddie@gontramarchitecture.com www.gontramarchitecture.com

Copyright 2023

THESE DOCUMENTS ARE INSTRUMENTS OF SERVICE AND AS SUCH REMAIN THE PROPERTY OF THE ARCHITECT. PUBLISHED OR USE THEM ONLY WITH THE ARCHITECT'S EXPRESSED WRITTEN APPROVAL.



ATTENDANT BUILDING ASSEMBLY COURT SOLID WASTE CONVENIENCE CENTER 575 ASSEMBLY COURT | FAYETTEVILLE, NC 28306

Table with columns: Rev, Date, Description. Row 1: 11/06/2023, ISSUED, NOVEMBER 6, 2023, FOR CONSTRUCTION.

DRAWN BY: PJA APPROVED: EUG

PROJECT NO.: 22003 RECORD:

CONTENTS: BUILDING CODE SUMMARY

SHEET: G102

FINISH SCHEDULE											
ROOM		FLOOR		WALLS				CEILING			NOTES
NUMBER	NAME	FLOOR	BASE	NORTH	EAST	SOUTH	WEST	TYPE	HEIGHT		
100	ATTENDANT ROOM	VCT	RUBBER	PTD GWB	PTD GWB	PTD GWB	PTD GWB	PTD GWB	SLOPED		
101	RESTROOM	VCT	RUBBER	PTD GWB	PTD GWB	PTD GWB	PTD GWB	PTD GWB	SLOPED		

**NOTE:** NORTH, EAST, SOUTH AND WEST ARE BASED ON PLAN NORTH, EAST, SOUTH AND WEST.

**GENERAL FINISH NOTES:**

1. ALL NEW EXPOSED STRUCTURAL STEEL, MECHANICAL DUCTWORK, ELECTRICAL CONDUIT, ETC. IS TO BE PAINTED. COLOR TO BE CONFIRMED BY OWNER.
2. INTERIOR FINISHES SHALL NOT HAVE A FLAME SPREAD RATING EXCEEDING THAT ALLOWED FOR TYPE V-B CONSTRUCTION.
3. ALL FINISH MATERIALS TO BE INSTALLED IN STRICT COMPLIANCE WITH MANUFACTURER'S SPECIFICATIONS.
4. ALL FINISHES TO BE NEW UNLESS OTHERWISE NOTED.

**5. CONFIRM ALL FINISHES WITH OWNER, PRIOR TO CONSTRUCTION.**

**ABBREVIATIONS:**

VCT:	VINYL COMPOSITION TILE
RUBBER:	4" RUBBER BASE
GWB:	GYPSUM WALLBOARD
PTD:	PAINT

**TOILET ACCESSORY LEGEND**

MARK	DESCRIPTION	MODEL #
T1	TOILET TISSUE DISPENSER	BOBRICK B-6867
T2	18" GRAB BAR (VERTICAL)	BOBRICK B-6806.99 x 18
T3	42" GRAB BAR (HORIZONTAL)	BOBRICK B-6806.99 x 42
T4	36" GRAB BAR (HORIZONTAL)	BOBRICK B-6806.99 x 36
T5	MIRROR	BOBRICK B-165 2436
T6	WALL MOUNTED PAPER TOWEL DISPENSER	BOBRICK B-262
T7	COAT HOOK	BOBRICK B-542
T8	RESTROOM SIGNAGE	UNISEX/ACCESSIBLE. SEE DETAIL: 10 / A501
T9	SOAP DISPENSER	BY TENANT

**NOTES:**

1. ALL TOILET ACCESSORIES MODEL NUMBERS IN THIS SCHEDULE ARE BASED ON BOBRICK WASHROOM EQUIPMENT, INC. UNLESS NOTED OTHERWISE, AND SHALL COMPLY WITH ADA. ALL WALL MOUNTED ACCESSORIES SHALL NOT INTERFERE W/ REQUIRED CLEARANCES PER 2010 ADA STANDARDS FOR ACCESSIBLE DESIGN. EQUALS APPROVED BY TENANT/OWNER ARE ACCEPTABLE.
2. ACCESSORY MOUNTING HEIGHT TO BE ADJUSTED AS REQUIRED TO COORDINATE WITH PLUMBING FIXTURES.
3. INSTALL FIRE RETARDANT TREATED WOOD OR METAL STUD BLOCKING FOR ALL WALL MOUNTED TOILET ACCESSORIES

**PLAN NOTES:**

1. EXTERIOR DIMENSIONS SHOWN ARE FROM FACE OF WALL TO FACE OF WALL OR FROM COLUMN CENTERLINE TO COLUMN CENTERLINE.
2. INTERIOR DIMENSIONS SHOWN ARE FROM FACE OF NEW STUD/CENTERLINE TO FACE OF NEW STUD/CENTERLINE.
3. DIMENSIONS INDICATED AS "CLEAR" OR "CLR" ARE FROM FINISHED SURFACE TO FINISHED SURFACE.
4. DIMENSIONS INDICATED AS "MIN." OR "MINIMUM" ARE ABSOLUTE MINIMUM DIMENSIONS AND ARE NOT TO BE DECREASED. DIMENSIONS INDICATED AS "MAX." OR "MAXIMUM" ARE ABSOLUTE MAXIMUM DIMENSIONS AND ARE NOT TO BE INCREASED.
5. ALTHOUGH THESE DRAWINGS ARE DRAWN TO SCALE, NO DIMENSIONS ARE TO BE DETERMINED BY SCALING THE DRAWINGS. ANY QUESTIONS OR DISCREPANCIES ARE TO BE BROUGHT TO THE ATTENTION OF THE ARCHITECT.


**INTERIOR PARTITION SCHEDULE**

1		NEW UNRATED INTERIOR PARTITION: \ 3 5/8" 20 GA METAL STUDS AT 16" O.C. TO CEILING ABOVE, WITH ONE LAYER 5/8" GWB ON EACH SIDE.  FINISH AS SCHEDULED. PROVIDE SOUND BATT INSULATION  (R-11 UNFACED BATT INSULATION)
2		NEW UNRATED INTERIOR PARTITION: \ 6" 20 GA METAL STUDS AT 16" O.C. TO CEILING ABOVE, WITH ONE LAYER 5/8" GWB ON EACH SIDE.  FINISH AS SCHEDULED. PROVIDE SOUND BATT INSULATION  (R-11 UNFACED BATT INSULATION)

1. PARTITION TYPE #1 IS TYPICAL THROUGHOUT PROJECT, UNLESS OTHERWISE NOTED.
2. WHERE PARTITIONS OF VARIOUS THICKNESS MEET, MAINTAIN A FLUSH SURFACE ON THE SIDE WHERE FACES ARE STRAIGHT AND CONTINUOUS, UNLESS OTHERWISE NOTED.
3. PARTITIONS IN ALL TOILET ROOMS TO HAVE WATER RESISTANT TYPE "X" GYPSUM BOARD IN THICKNESS TO MATCH SCHEDULED.

**EXTERIOR WALL SCHEDULE**

A		NEW UNRATED LOAD BEARING WALL: 6" 18 GA. METAL STUDS AT 16" O.C. TO JOIST ABOVE, R-20 BATT INSULATION, TYVEK AIR INFILTRATION BARRIER OVER EXTERIOR SHEATHING, R-7.5 RIGID INSULATION, 2" AIRSPACE, 4" CMU  NOTE: SEE SHEET A701
---	--	--

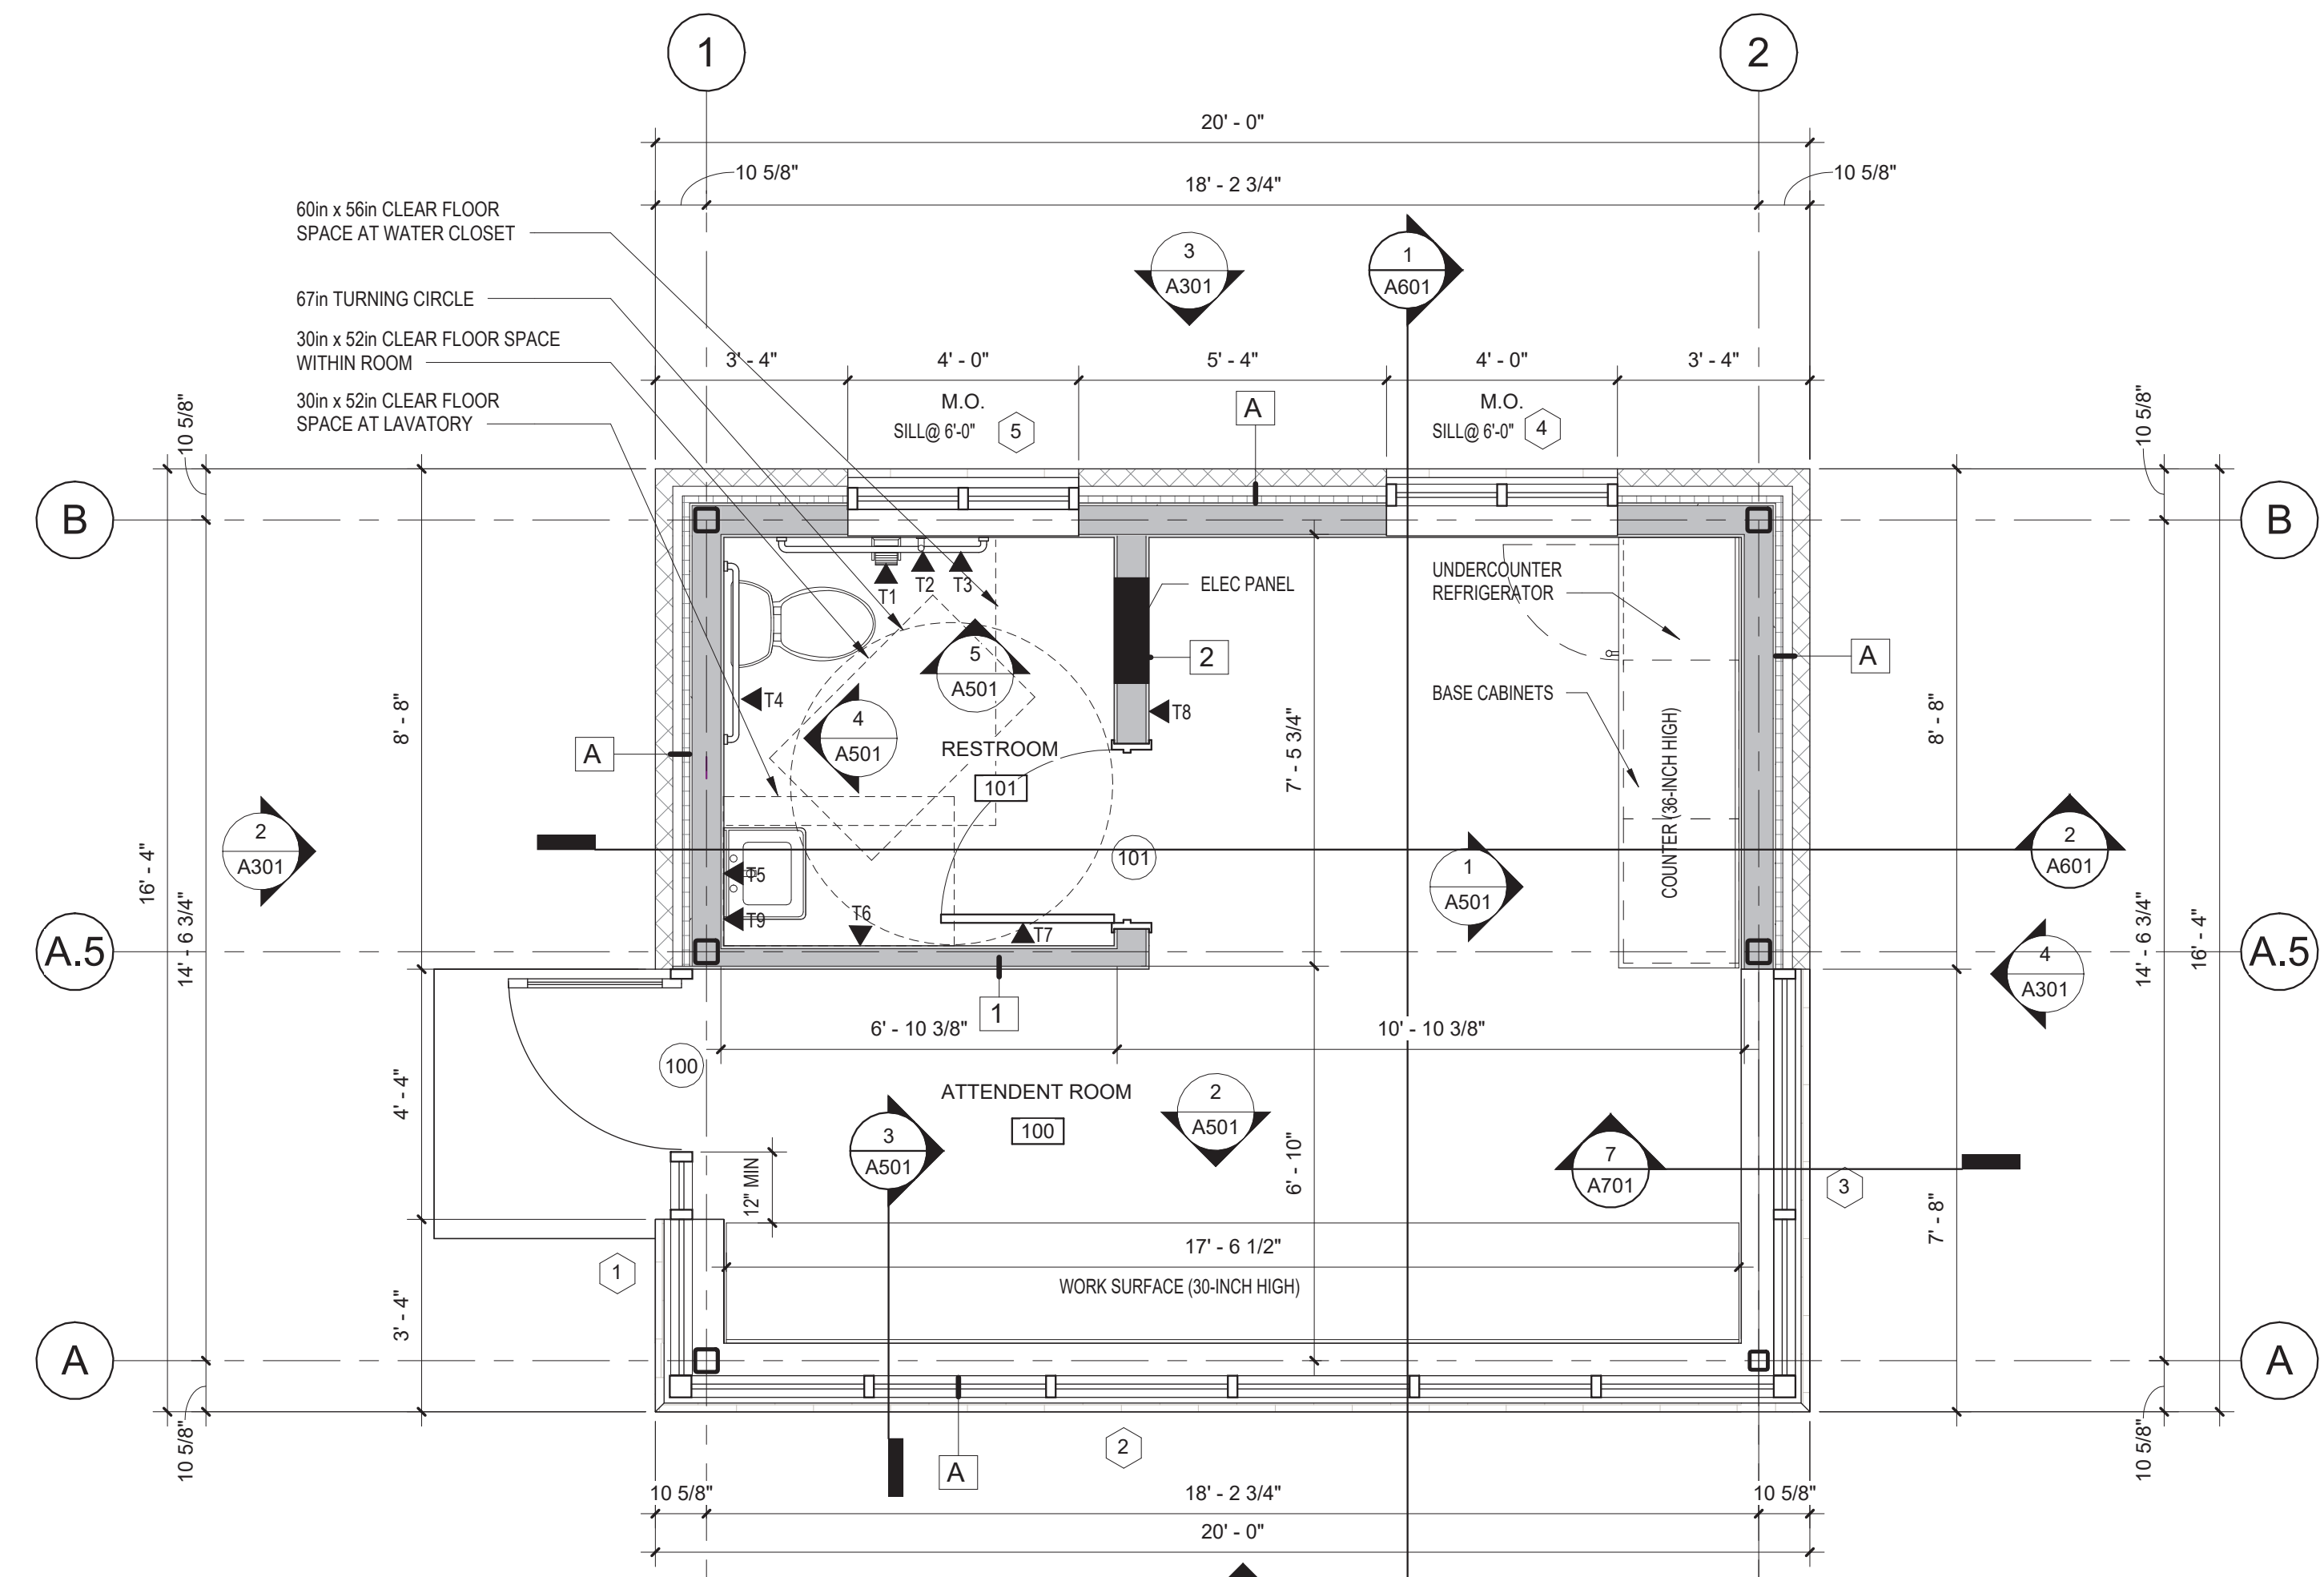

**1 FLOOR PLAN**  
3/8" = 1'-0"



**GONTRAM ARCHITECTURE, INC.**

5100 UNICON DR. SUITE 103  
WAKE FOREST, NC 27587  
PHONE: 919.876.5331

eddie@gontramarchitecture.com  
www.gontramarchitecture.com

© Copyright 2023

THESE DOCUMENTS ARE INSTRUMENTS OF SERVICE AND AS SUCH REMAIN THE PROPERTY OF THE ARCHITECT. PUBLISH OR USE THEM ONLY WITH THE ARCHITECT'S EXPRESSED WRITTEN APPROVAL.



**ATTENDANT BUILDING**  
**ASSEMBLY COURT SOLID WASTE CONVENIENCE CENTER**  
575 ASSEMBLY COURT | FAYETTEVILLE, NC 28306

PLOT DATE:  
11/06/2023  
ISSUED:  
NOVEMBER 6, 2023  
FOR CONSTRUCTION

Rev.	Date	Description

DRAWN BY: PJA APPROVED: EJJ

PROJECT NO.: 22003 RECORD:


CONTENTS:  
FLOOR PLAN

SHEET:


**A101**






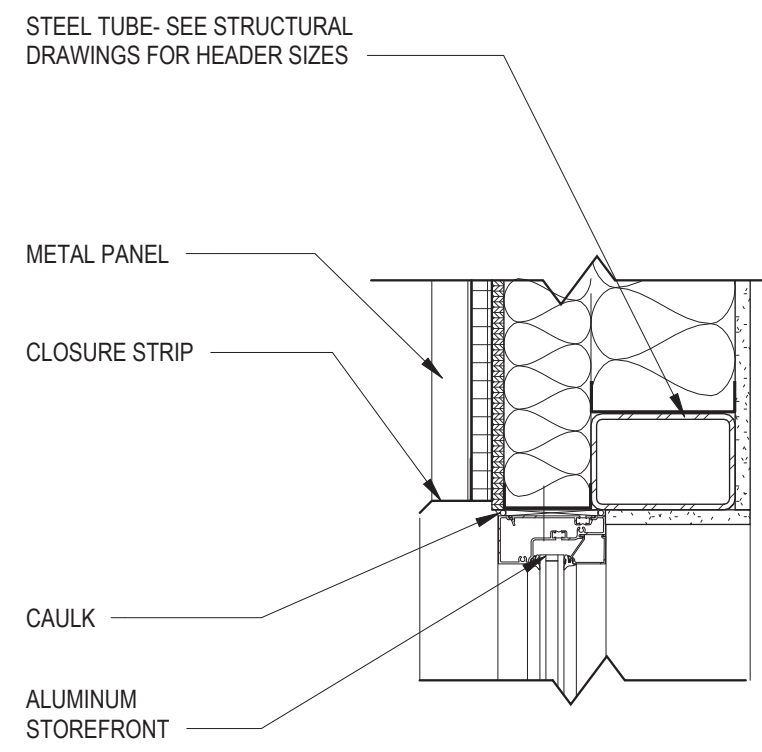


**HEAD  
(METAL PANEL)**

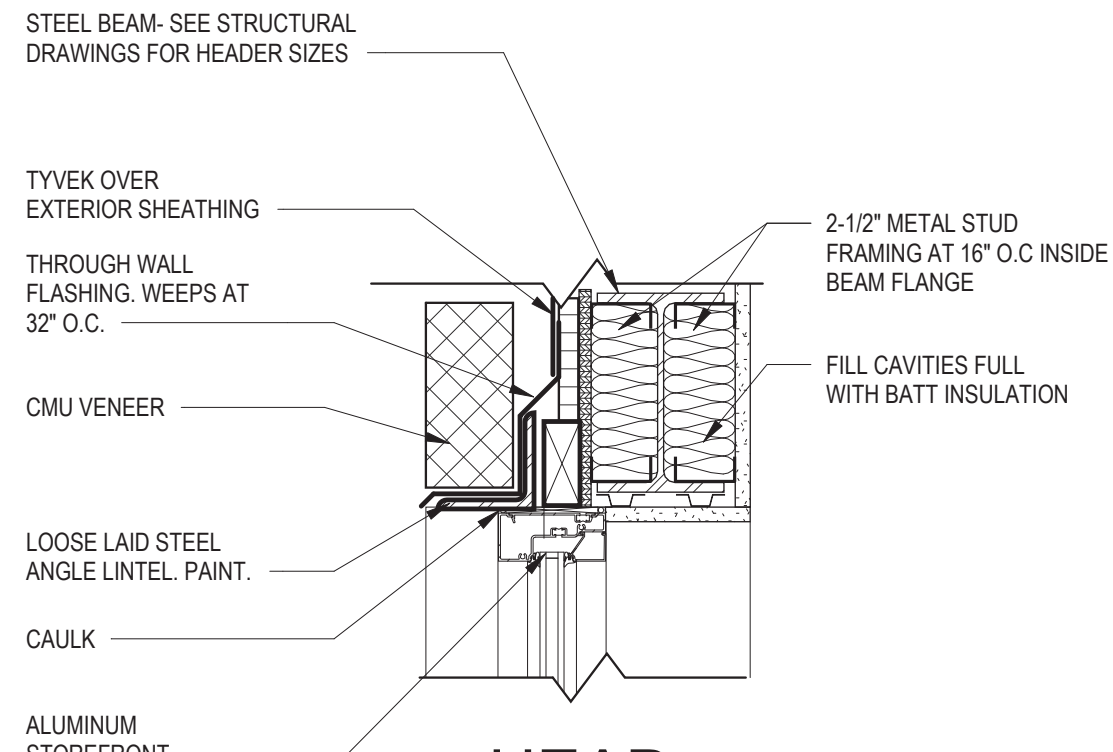


**HEAD  
(MASONRY)**

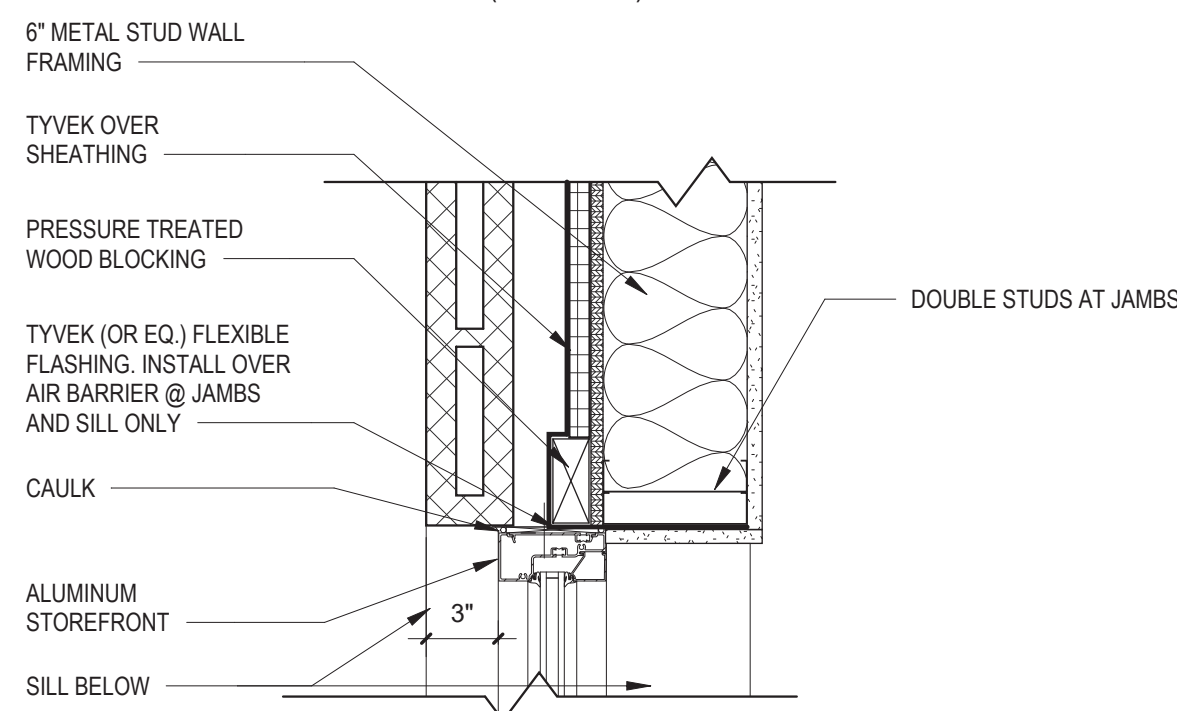


**JAMB**

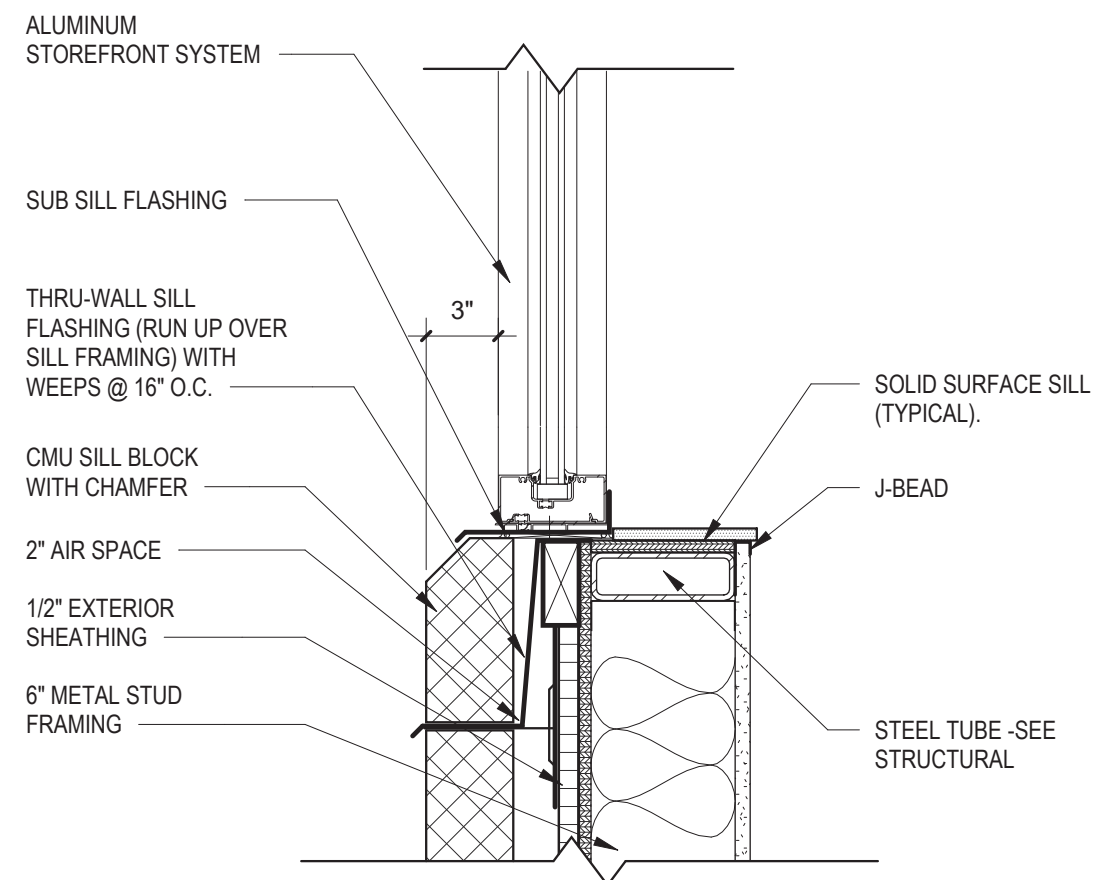

**SILL**

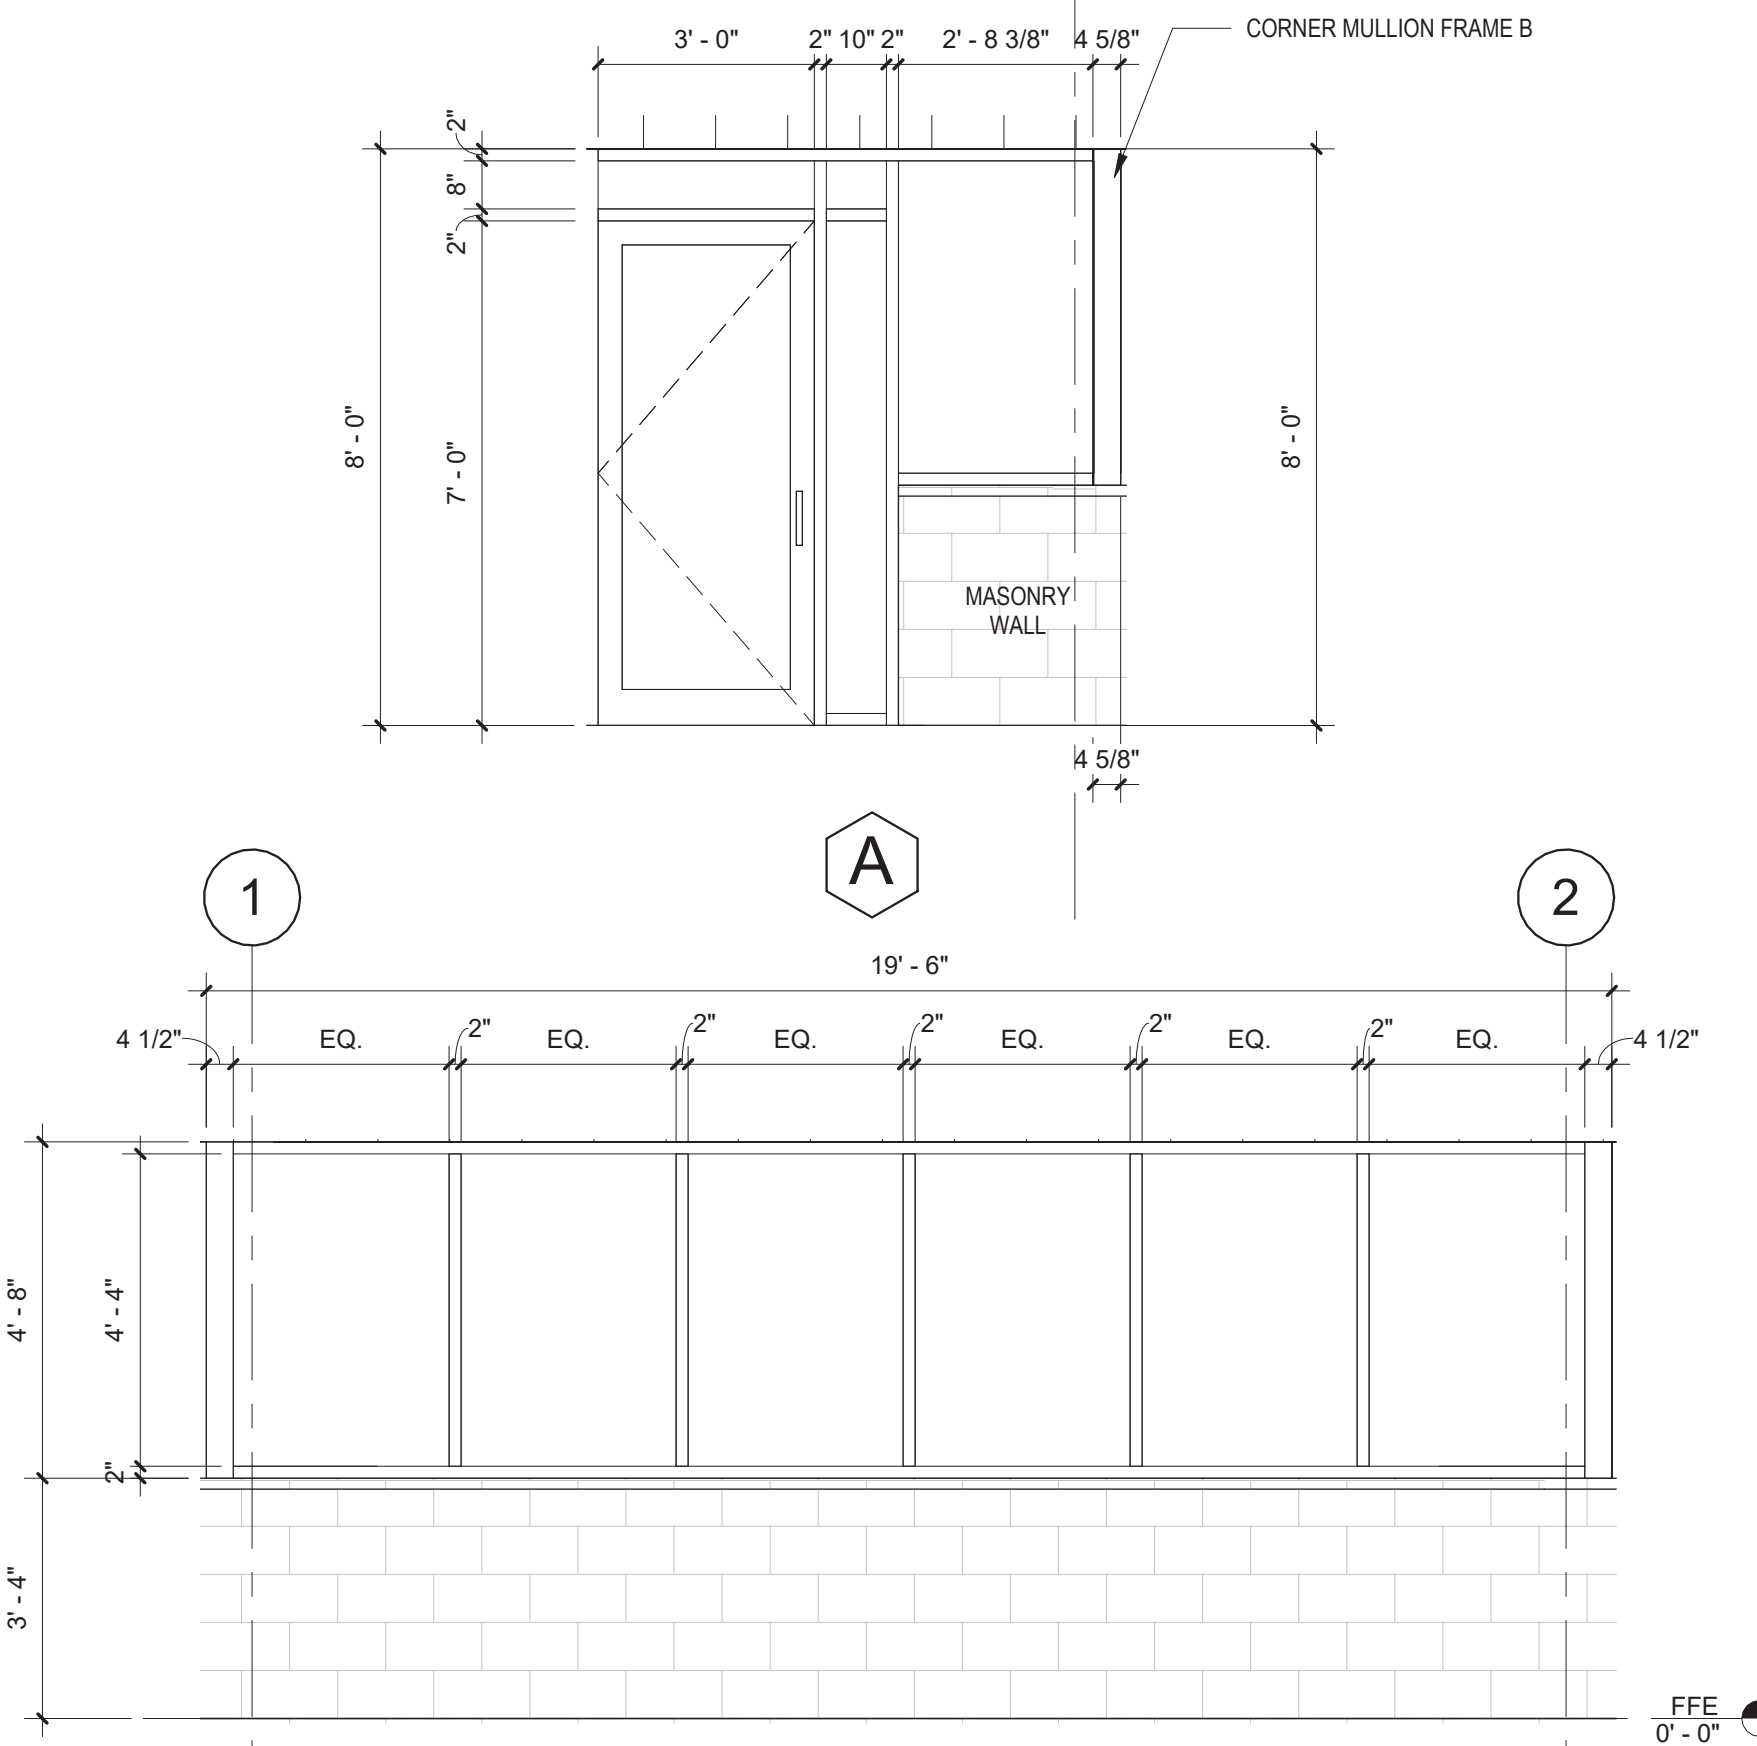

**2 ALUMINUM FRAME TYPES.**  
1/2" = 1'-0"

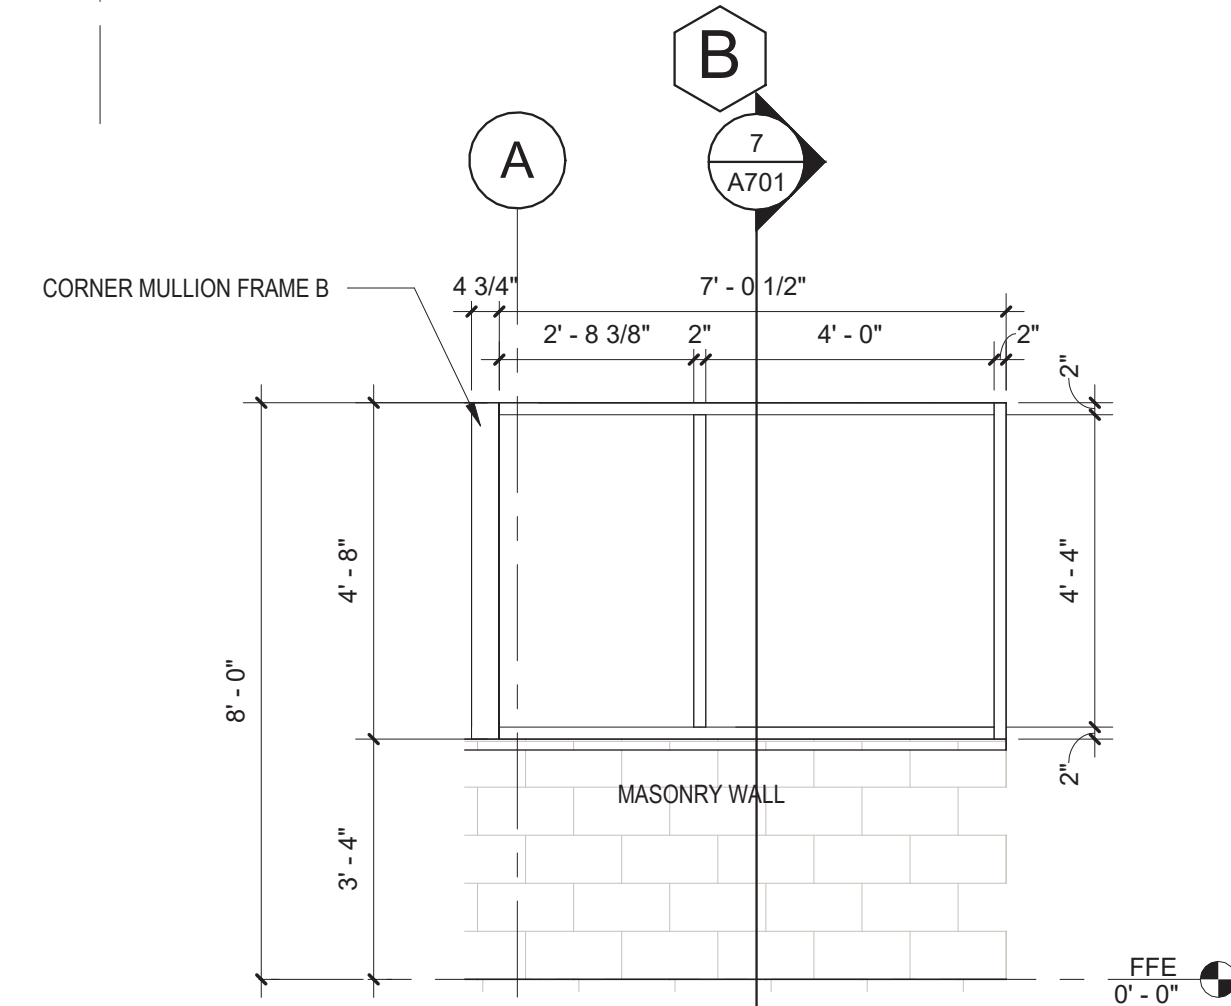

**3 DOOR DETAILS-INTERIOR**  
1 1/2" = 1'-0"

WINDOW SCHEDULE						
MARK	WIDTH	HEIGHT	TYPE	MATERIAL	GLASS	NOTES
1	7'-0 3/8"	8'-0"	A	DARK BRONZE ALUMINUM	1" INSULATED GLASS	
2	19'-6"	4'-8"	B	DARK BRONZE ALUMINUM	1" INSULATED GLASS	
3	7'-0 3/8"	4'-8"	C	DARK BRONZE ALUMINUM	1" INSULATED GLASS	
4	4'-0"	2'-0"	D	DARK BRONZE ALUMINUM	1" INSULATED GLASS	
5	4'-0"	2'-0"	D	DARK BRONZE ALUMINUM	1" INSULATED GLASS	

**WINDOW NOTES:**

- GLAZING TYPE FOR EXTERIOR STOREFRONT ASSEMBLIES TO BE 1" INSULATED GLAZING LOW-E UNITS, TINTED GLASS (SOLARBAN 70XL OR EQUAL). INTERIOR GLAZING TO BE 1/4" CLEAR (TEMPERED OR LAMINATED SAFETY GLASS WHERE INDICATED). SEE MINIMUM CRITERIA ON SHEET G102 UNDER ENERGY SUMMARY.
- STOREFRONT ASSEMBLIES TO BE CLEAR ANODIZED ALUMINUM. EXTERIOR FRAMES TO BE THERMALLY BROKEN FRAMES.
- GLAZING FOR EXTERIOR STOREFRONT DOORS TO BE 1/4" TINTED TEMPERED GLAZING.
- ALL WINDOWS TO BE PROPERLY FLASHED AT HEAD, JAMBS AND SILLS. PROVIDE FLASHING WITH END DAMS AT ALL SILLS.
- DIMENSIONS SHOWN ARE NOT TO BE USED FOR FABRICATION. ALL DIMENSIONS ARE TO BE CONFIRMED WITH SHOP DRAWINGS AND FIELD MEASUREMENTS AFTER COMPLETION OF CONSTRUCTION OF OPENINGS AND PRIOR TO FABRICATION OF WINDOW ASSEMBLIES.
- SEE STRUCTURAL DRAWINGS FOR HEADER CONSTRUCTION.
- PROVIDE TEMPERED GLAZING WHERE INDICATED AND WHERE REQUIRED BY CODE.
- SEE DOOR SCHEDULE FOR ADDITIONAL INFORMATION REGARDING TRANSOMS AND SIDELITE.
- SEE DETAIL FOR WINDOW SILLS AND TRIM INFORMATION.



DOOR SCHEDULE												
MARK	ROOM	DOOR				FRAME				FIRE RATING	HDW SET	NOTES
		WIDT	HEIGH	THK	TYPE	MATERIAL	FINISH	MATERIAL	FINISH			
100	ATTENDANT	3'-0"	7'-0"		SF-01	ALUMINUM	DARK BRONZE	ALUMINUM	DARK BRONZE	NR	1	
101	RESTROOM	3'-0"	7'-0"	1 3/4"	A	SOLID CORE WOOD	STAIN	HM	PAINT	NR	2	6" stud wall

**DOOR HARDWARE**

- HARDWARE SET NO. (ALUMINUM STOREFRONT-EXTERIOR SINGLE ENTRY DOOR):**  
 HEAVY-DUTY HINGES: (3)  
 C PULLS: (1)  
 CYLINDER  
 WEATHER STRIPPING: (1) SET  
 THRESHOLD: (1)  
 CLOSER: (1)
- HARDWARE SET NO. (INTERIOR TOILET ROOM DOOR):**  
 HEAVY-DUTY HINGES: (3)  
 PRIVACY LOCKSET: (1)  
 SILENCERS: (3)  
 WALL/FLOOR STOP: (1)

**DOOR NOTES**

- HARDWARE FINISH TO BE **US260 OR US32D** (CONFIRM W/ OWNER). HARDWARE TO BE STANDARD-DUTY, COMMERCIAL HARDWARE, SCHLAGE AL SERIES "SATURN" (OR APPROVED EQUAL).
- PROVIDE HARDWARE THAT COMPLIES WITH THE NCBC, THE AMERICAN'S WITH DISABILITIES ACT AND ICC/ANSI A117.1.
- ALL DOORS AND FRAMES TO BE FINISHED AS SCHEDULED. **WOOD SPECIES TO BE NATURAL ROTARY CUT BIRCH, DOORS TO BE FIELD FINISHED.**
- G.C. TO COORDINATE. FINAL HARDWARE SELECTION/ SCHEDULING/ KEYING WITH OWNER. ALL DOORS WILL BE KEYED TO OWNER'S MASTER KEYING SYSTEM.
- G.C. TO PROVIDE ADDITIONAL HARDWARE AS REQUIRED BY DOOR MANUFACTURER

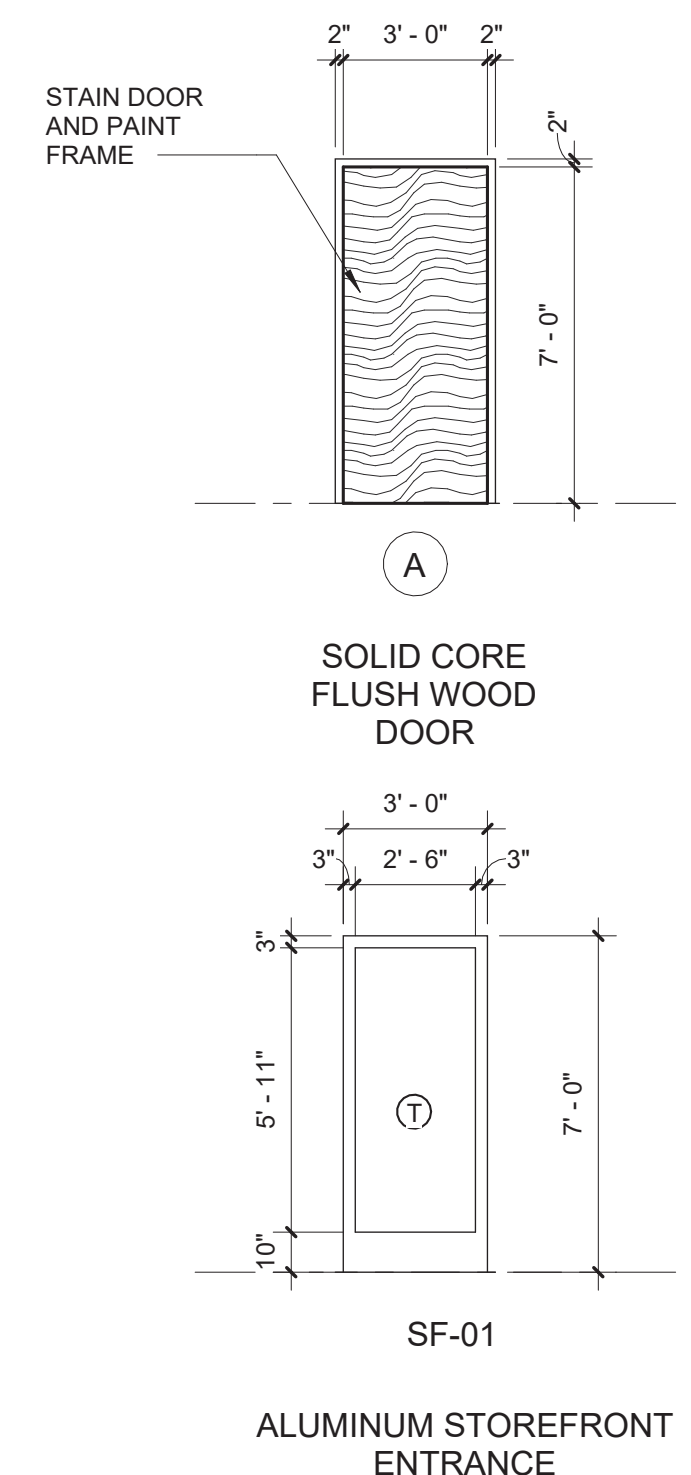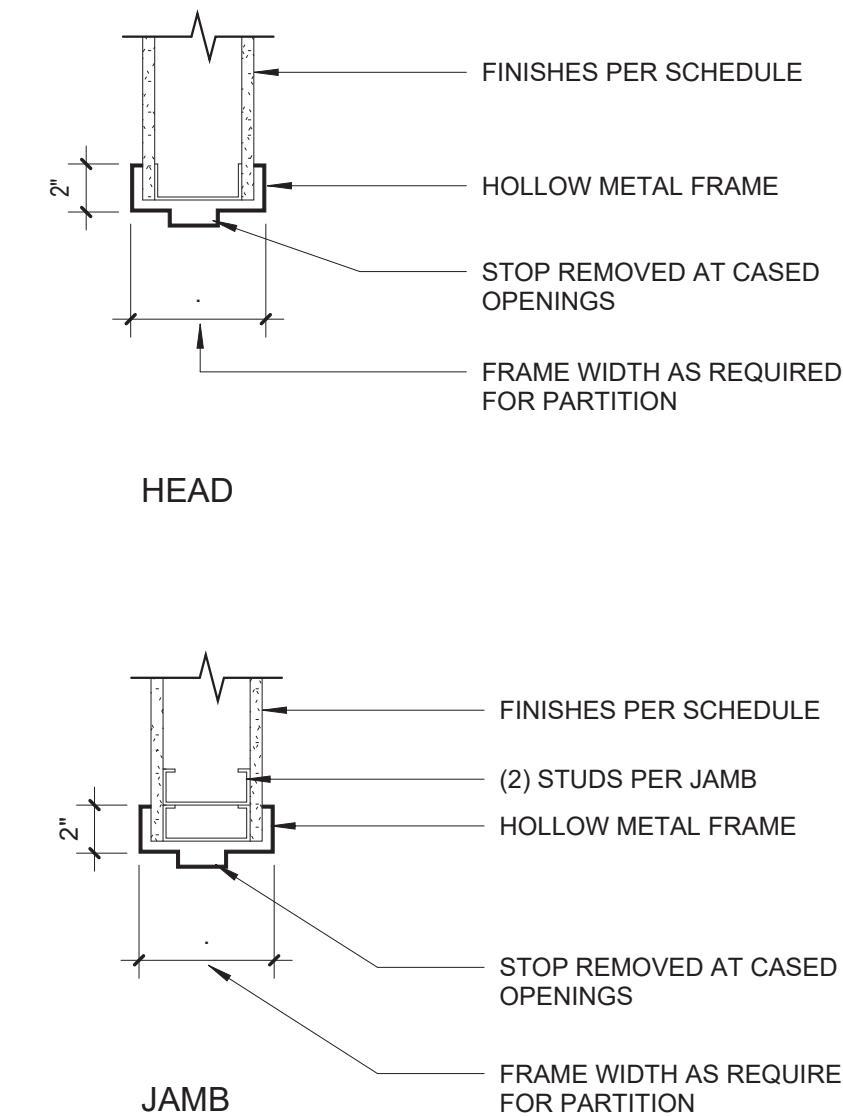

**4 DOOR TYPES**  
1/4" = 1'-0"

**1 SECTION - EXTERIOR WINDOW**  
1 1/2" = 1'-0"



**GONTRAM ARCHITECTURE, INC.**

5100 UNICON DR. SUITE 103  
WAKE FOREST, NC 27587  
PHONE: 919.876.5331

eddie@gontramarchitecture.com  
www.gontramarchitecture.com

© Copyright 2023

THESE DOCUMENTS ARE INSTRUMENTS OF SERVICE AND AS SUCH REMAIN THE PROPERTY OF THE ARCHITECT. PUBLISH OR USE THEM ONLY WITH THE ARCHITECT'S EXPRESSED WRITTEN APPROVAL.



**ATTENDANT BUILDING  
ASSEMBLY COURT SOLID WASTE  
CONVENIENCE CENTER**  
575 ASSEMBLY COURT | FAYETTEVILLE, NC 28306

PLOT DATE:  
11/06/2023

ISSUED:  
NOVEMBER 6, 2023

FOR CONSTRUCTION

Rev.	Date	Description

DRAWN BY: PJA APPROVED: EJC

PROJECT NO.: 22003 RECORD:

CONTENTS:  
WINDOW & DOOR SCHEDULE

SHEET:

**A401**





**GONTRAM ARCHITECTURE, INC.**

5100 UNICON DR. SUITE 103  
WAKE FOREST, NC 27587  
PHONE: 919.876.5331

eddie@gontramarchitecture.com  
www.gontramarchitecture.com

© Copyright 2023  
THESE DOCUMENTS ARE INSTRUMENTS OF SERVICE AND AS SUCH REMAIN THE PROPERTY OF THE ARCHITECT. PUBLISH OR USE THEM ONLY WITH THE ARCHITECT'S EXPRESSED WRITTEN APPROVAL.




**ATTENDANT BUILDING**  
**ASSEMBLY COURT SOLID WASTE CONVENIENCE CENTER**  
575 ASSEMBLY COURT | FAYETTEVILLE, NC 28306


PLOT DATE: 11/06/2023		
ISSUED: NOVEMBER 6, 2023		
FOR CONSTRUCTION		
Rev.	Date	Description

DRAWN BY: PJA	APPROVED: EJG
PROJECT NO.: 22003	RECORD:
CONTENTS: BUILDING SECTIONS	


SHEET:  
**A601**

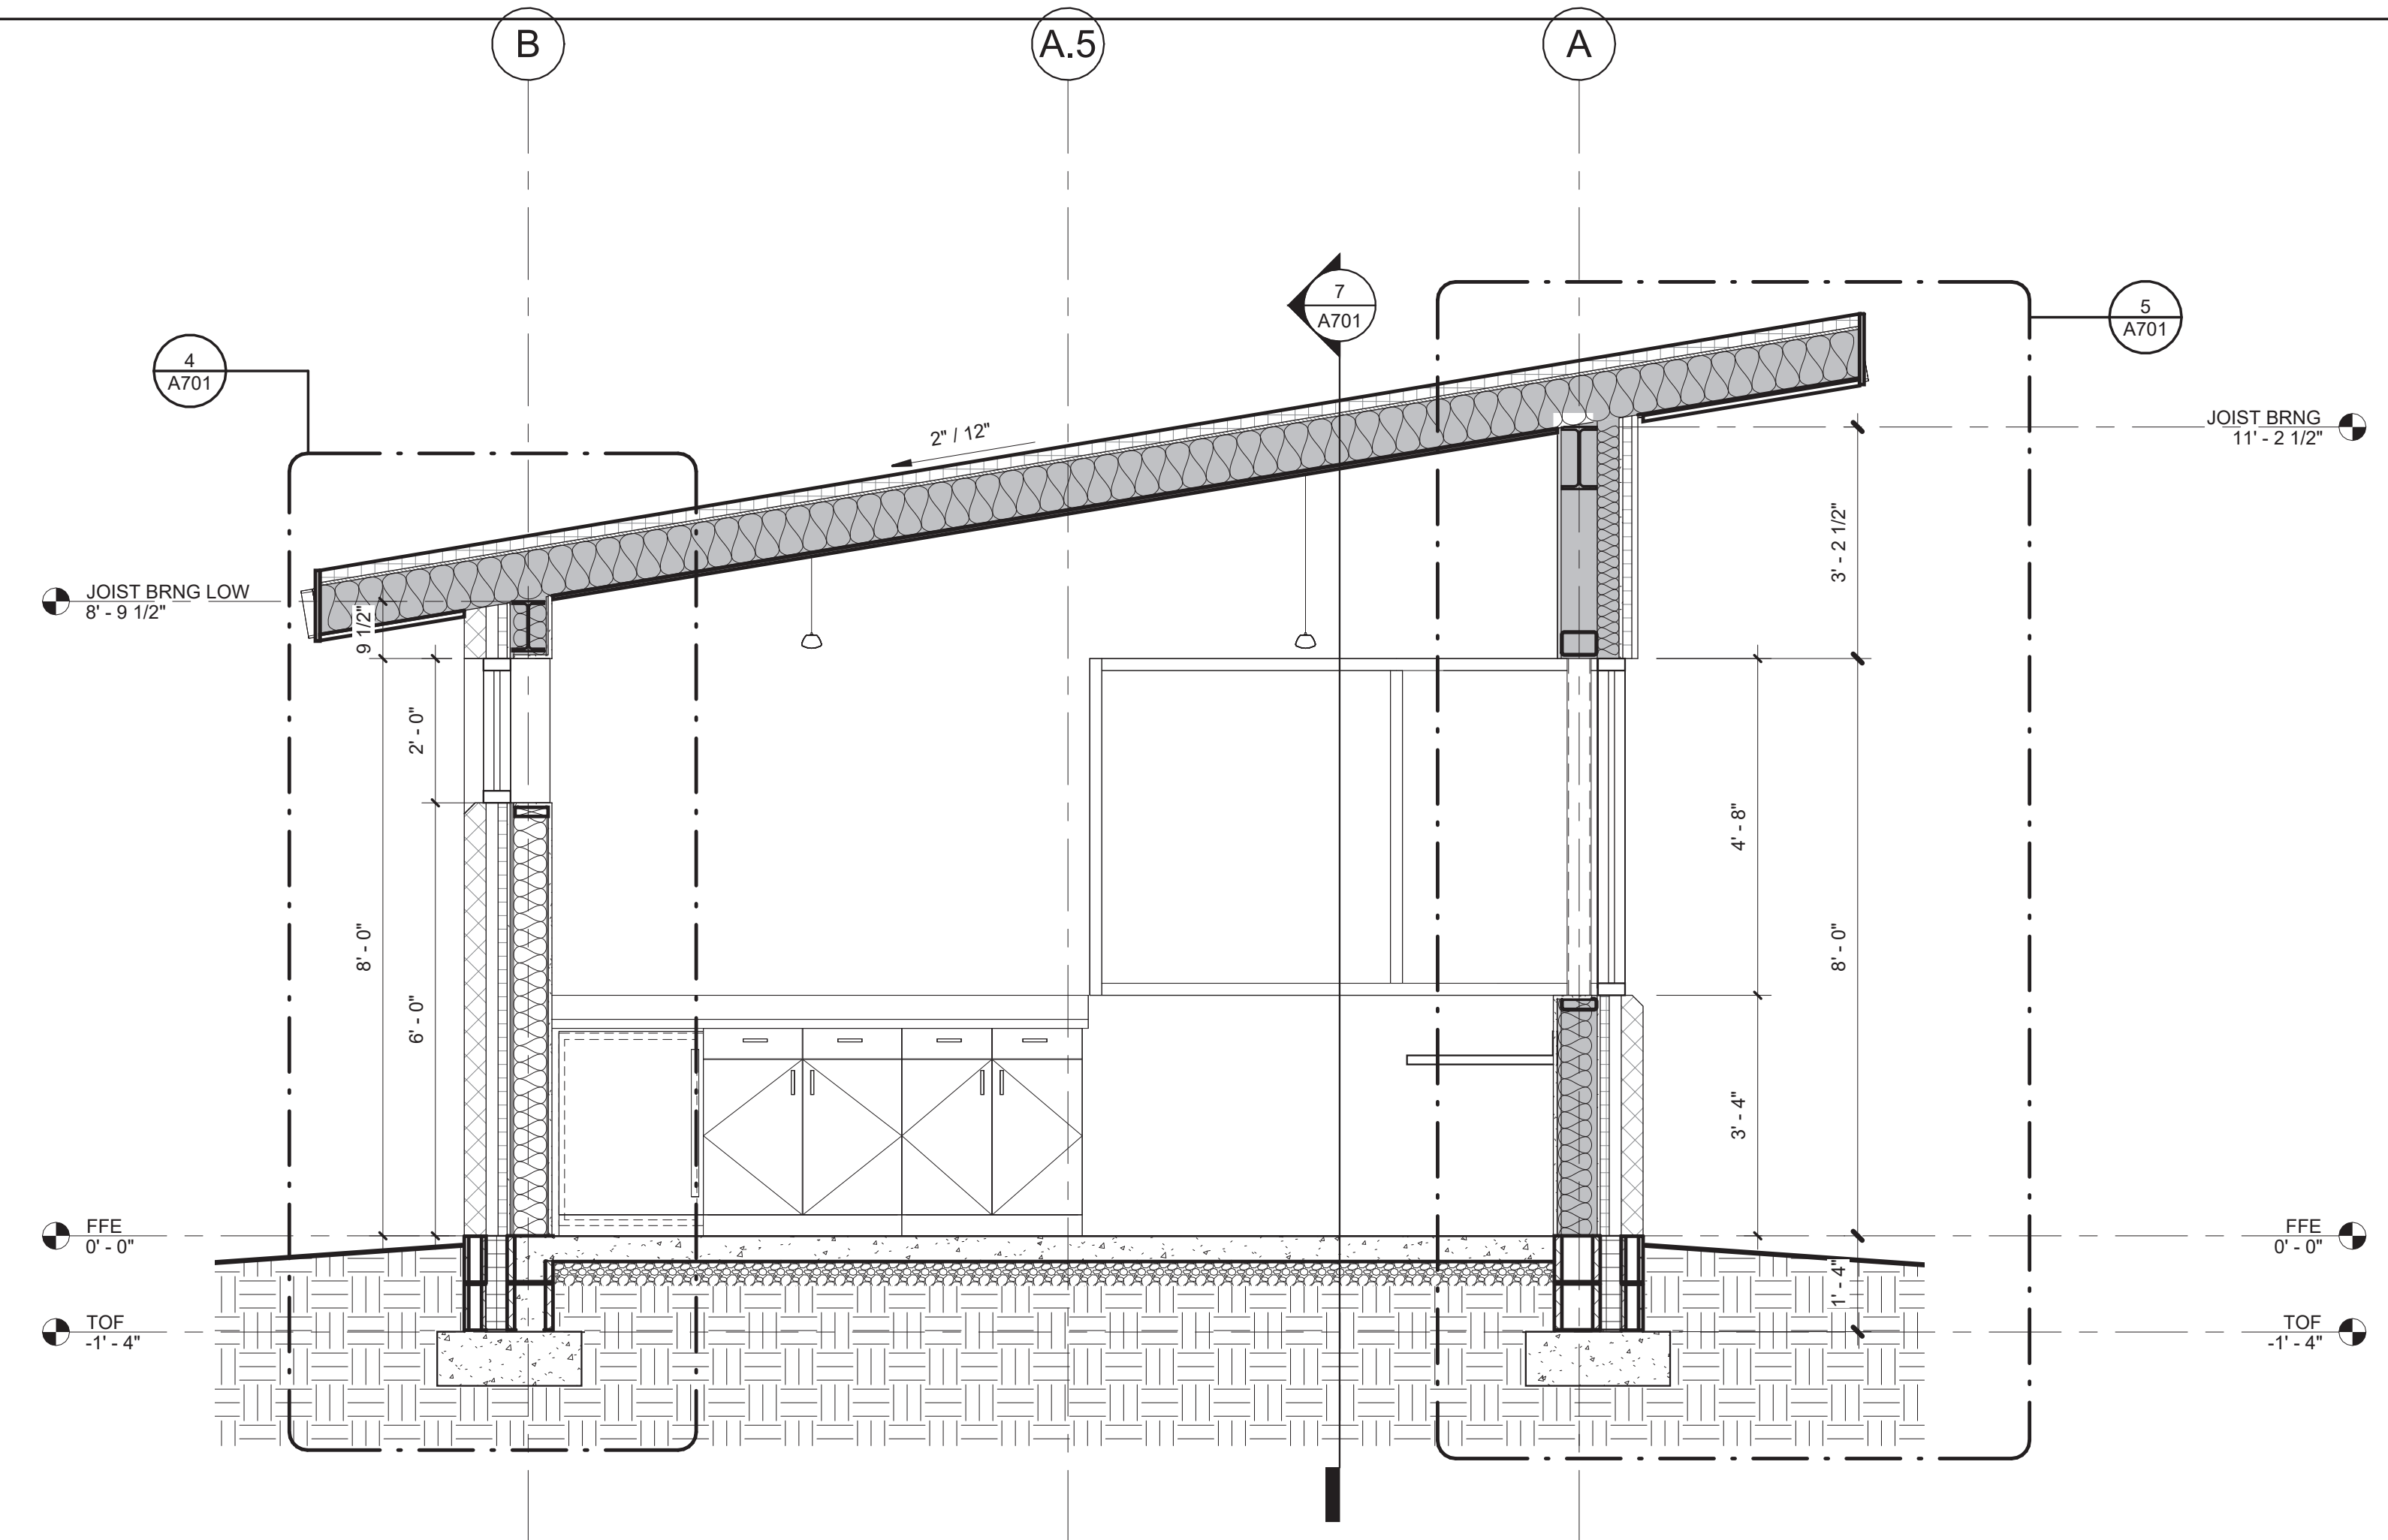


**1 BUILDING SECTION (NORTH-SOUTH)**  
1/2" = 1'-0"

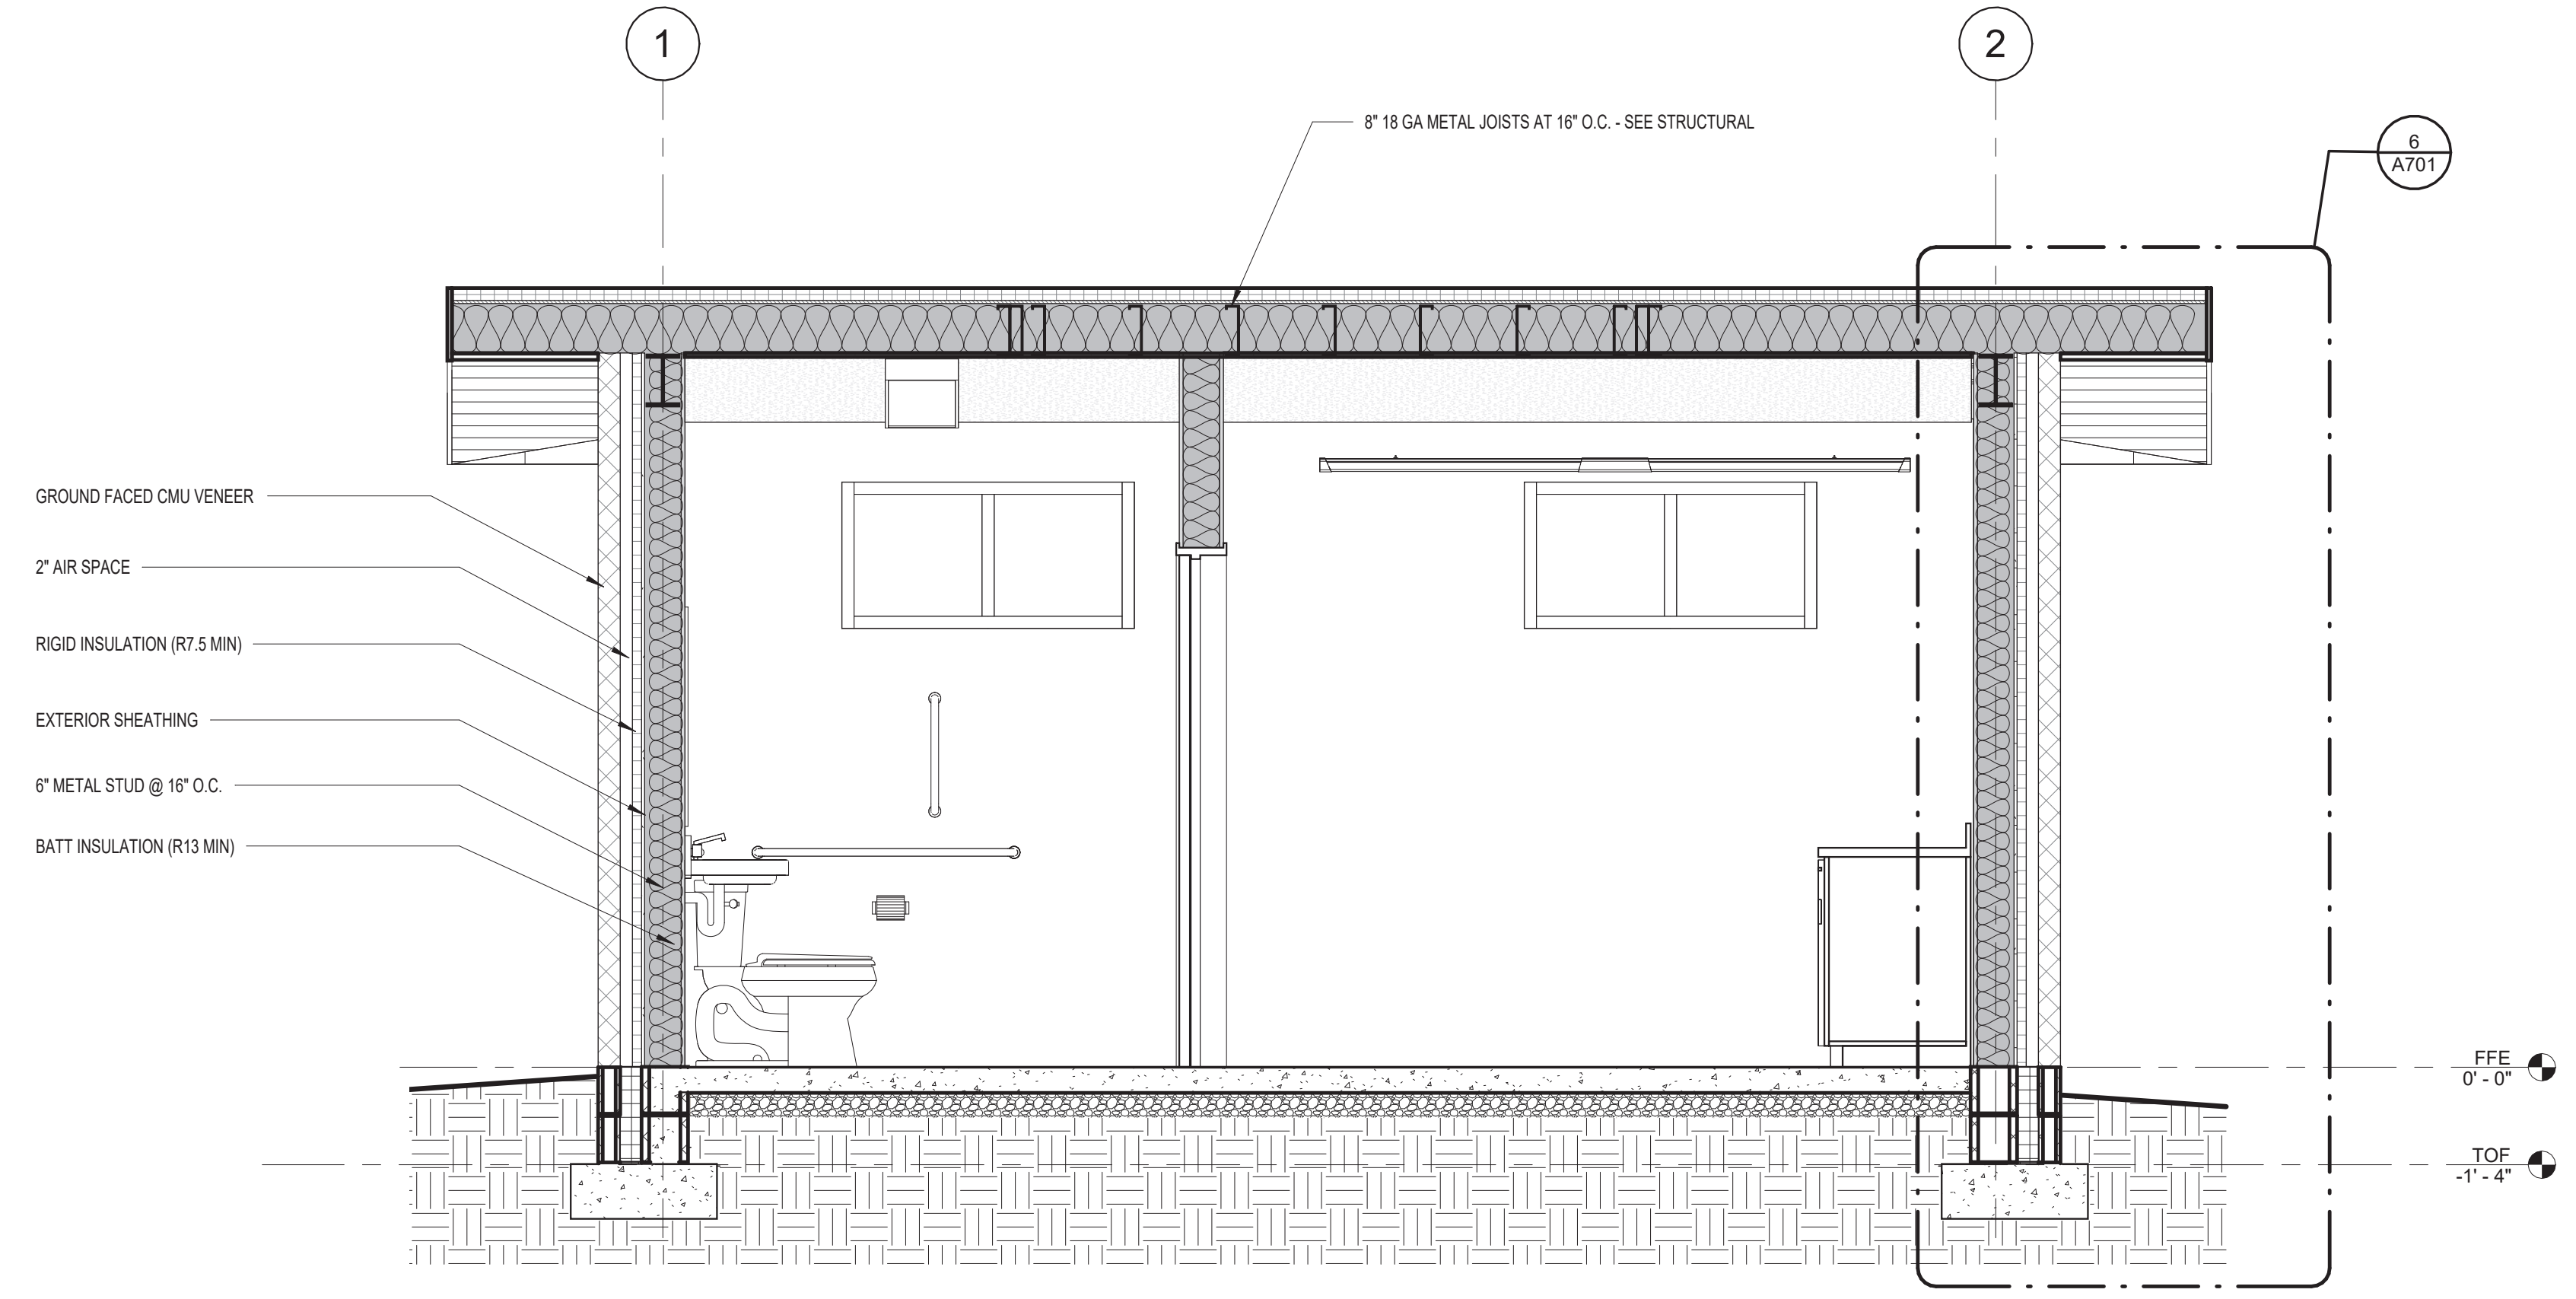


**2 BUILDING SECTION (EAST-WEST)**  
1/2" = 1'-0"

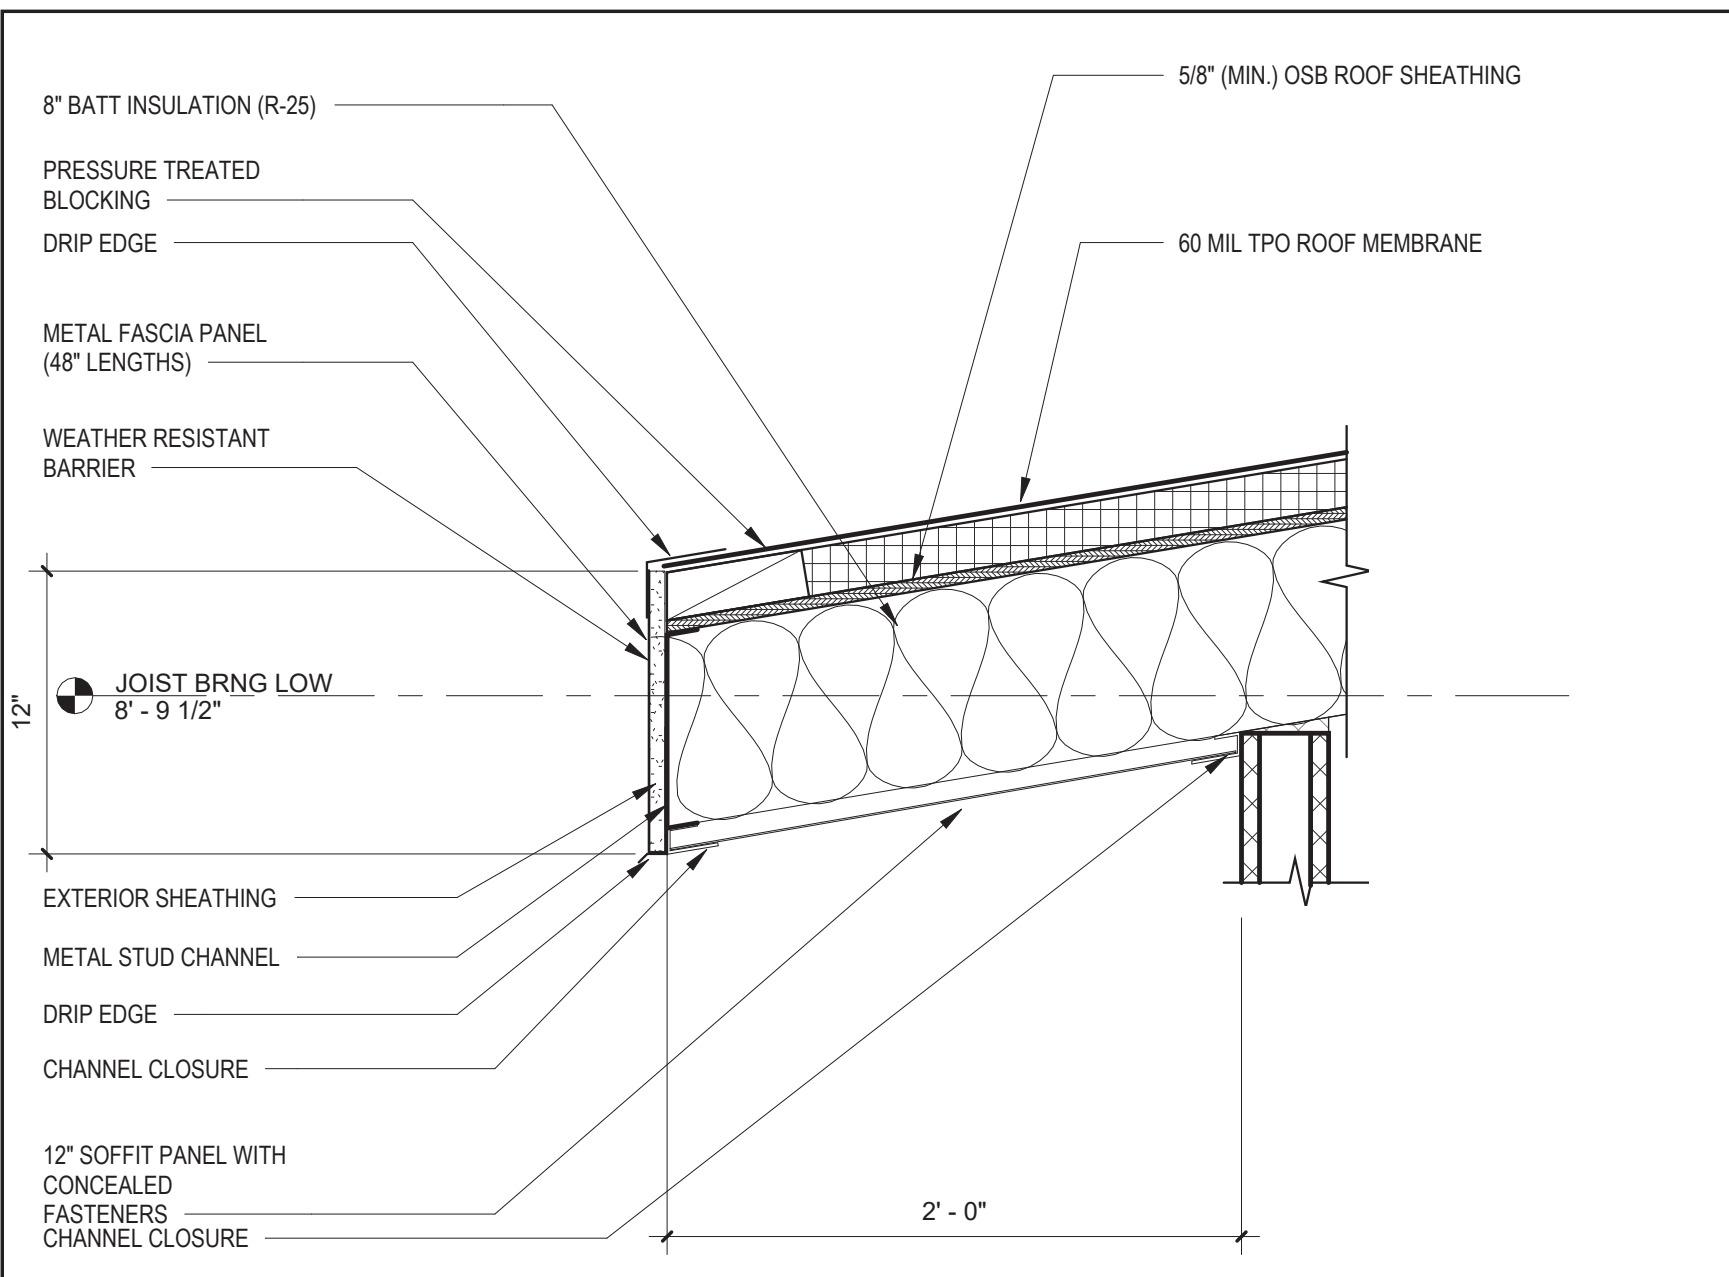


**1 ROOF DETAIL-LOW END**  
1 1/2" = 1'-0"

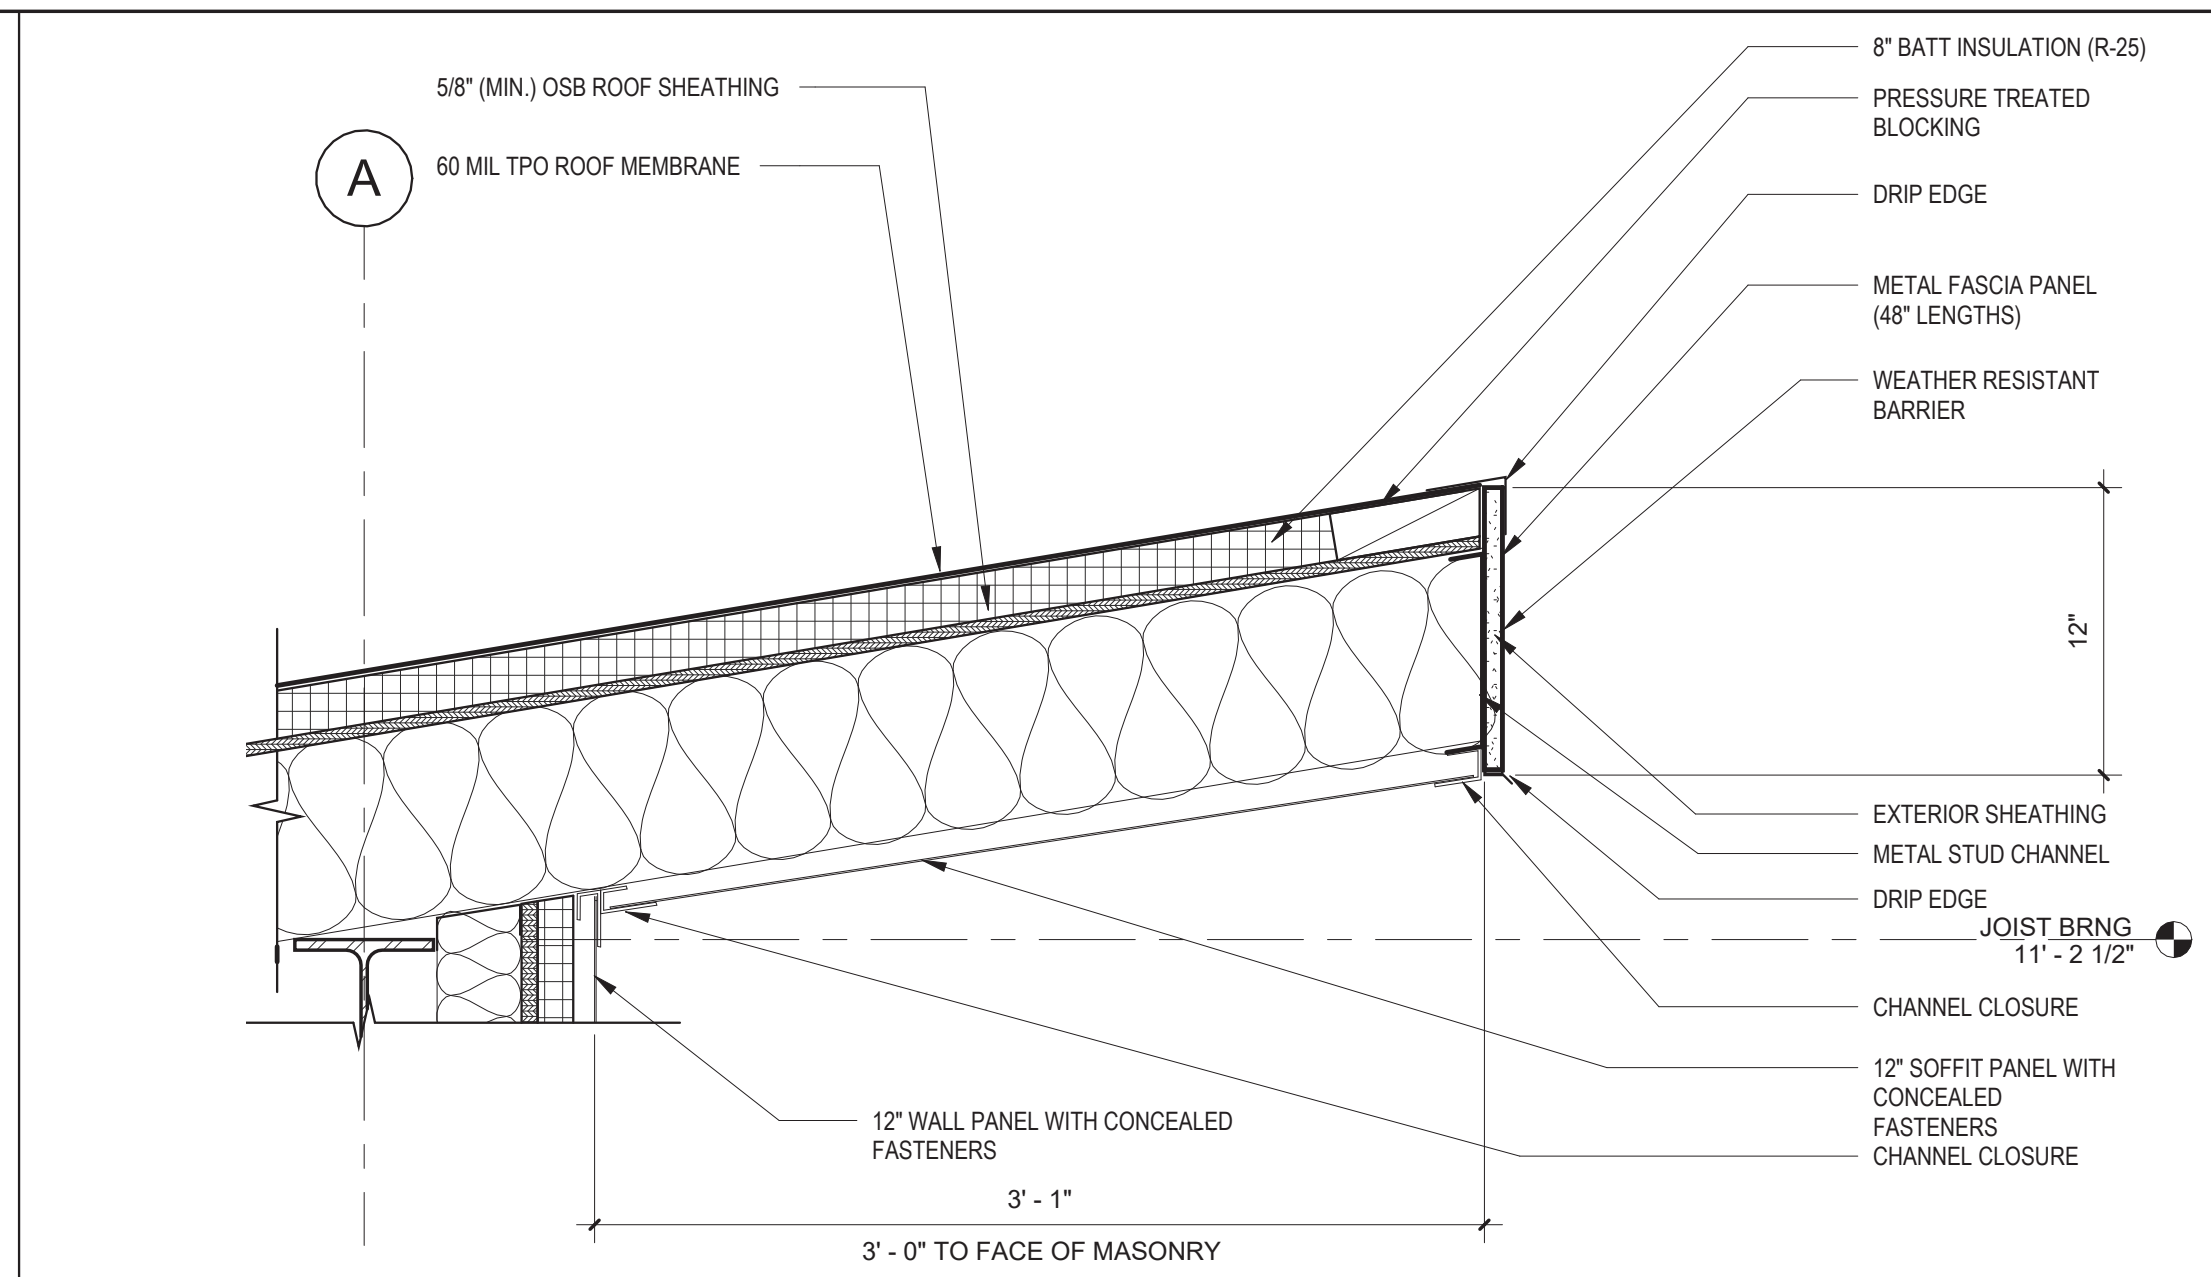


**2 ROOF DETAIL-HIGH END**  
1 1/2" = 1'-0"

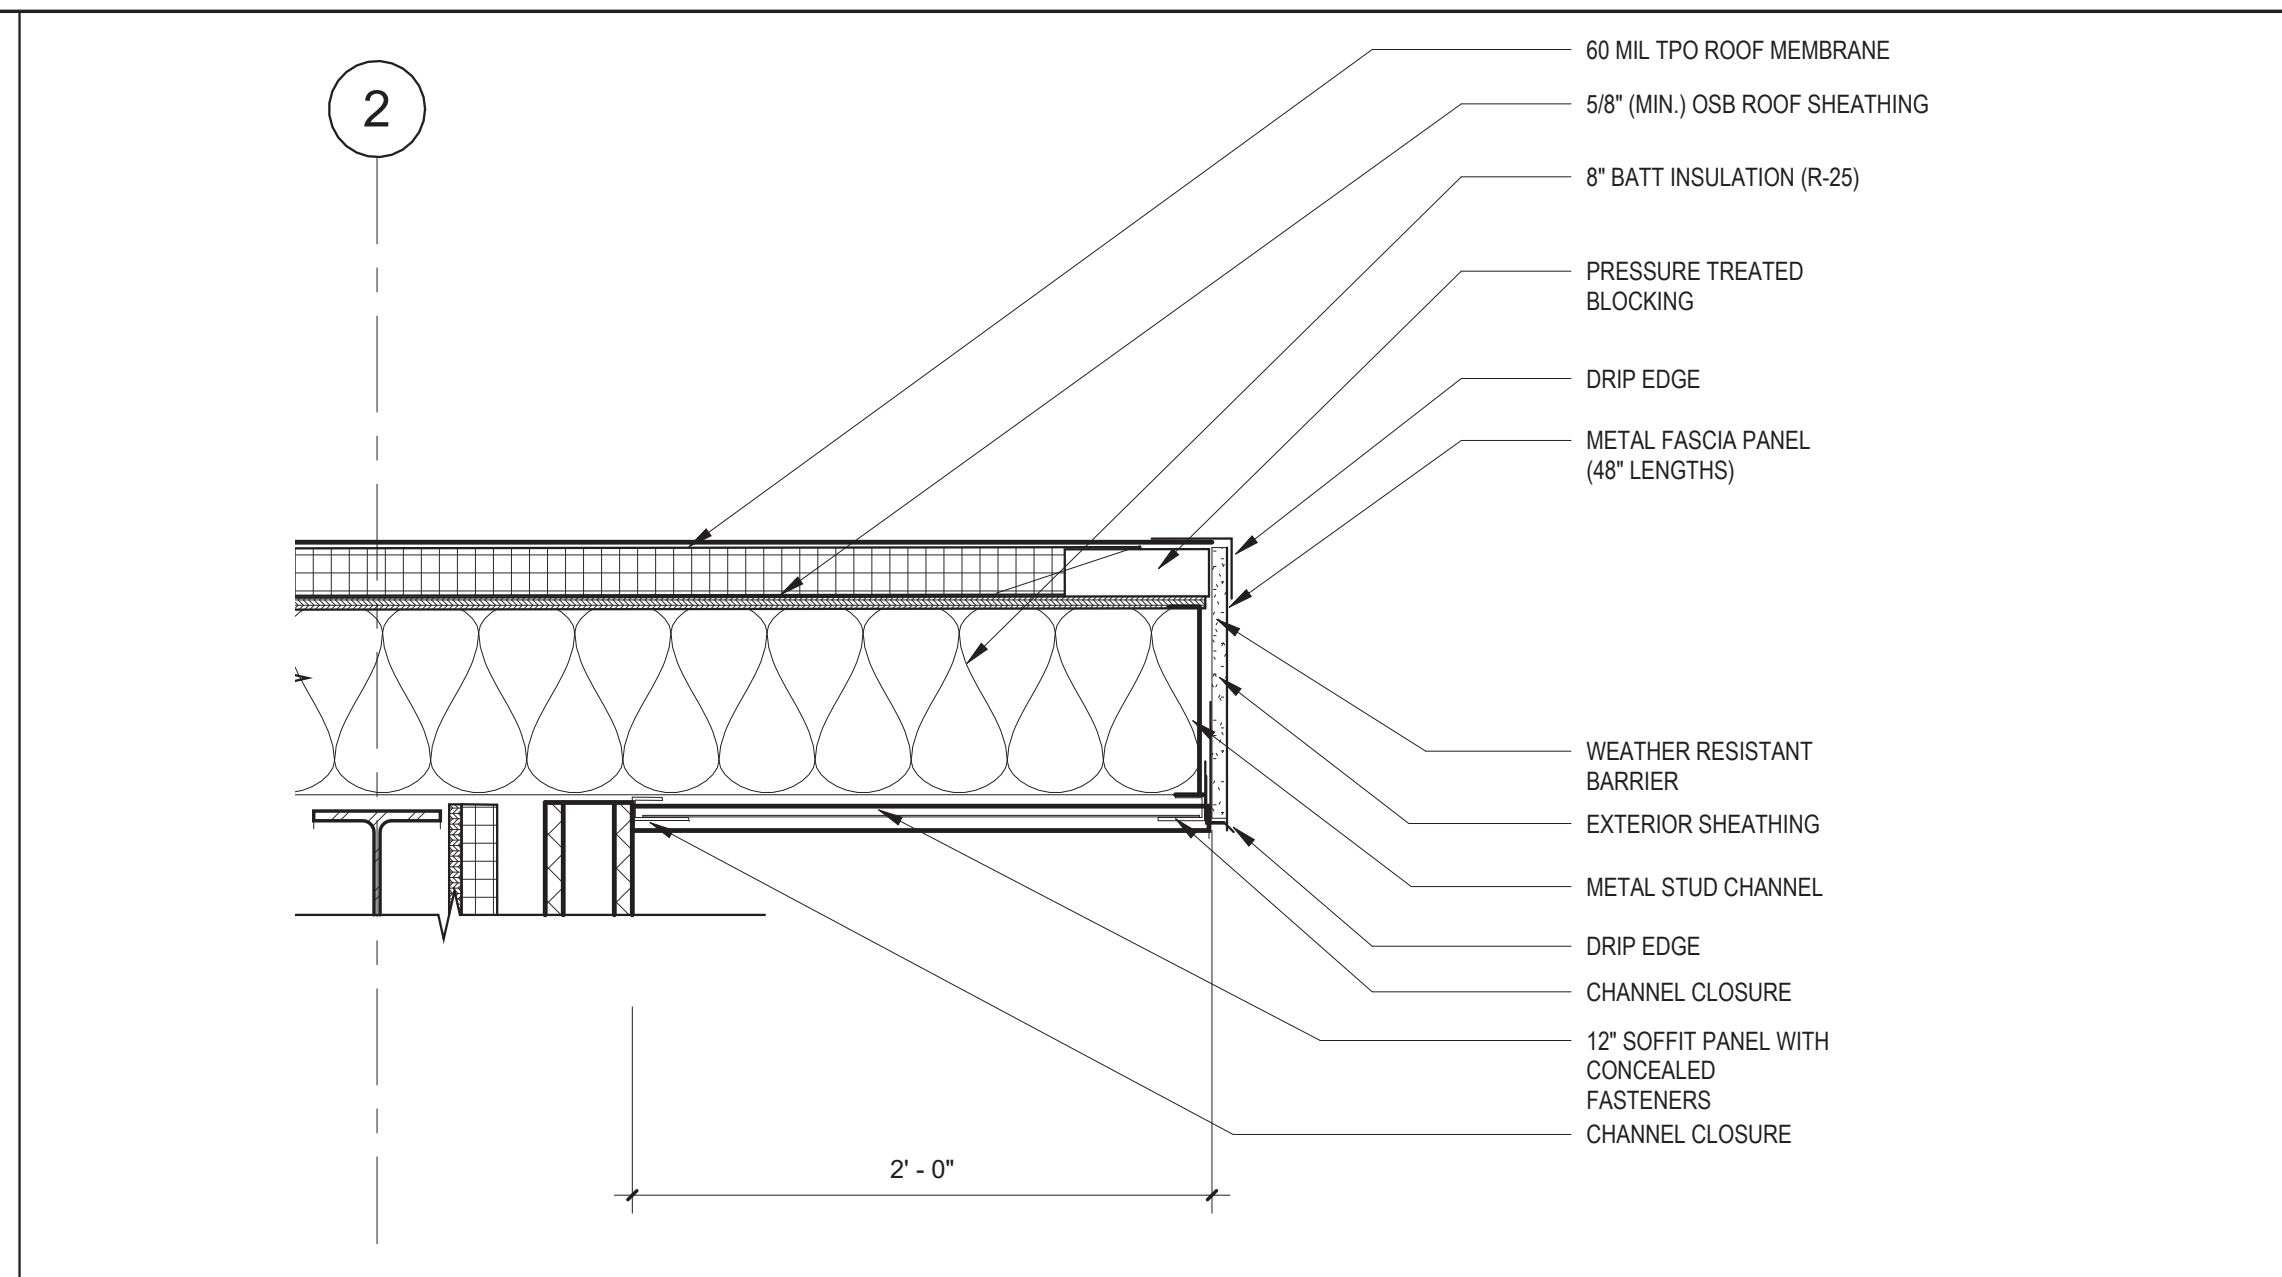


**3 ROOF DETAIL - RAKE**  
1 1/2" = 1'-0"

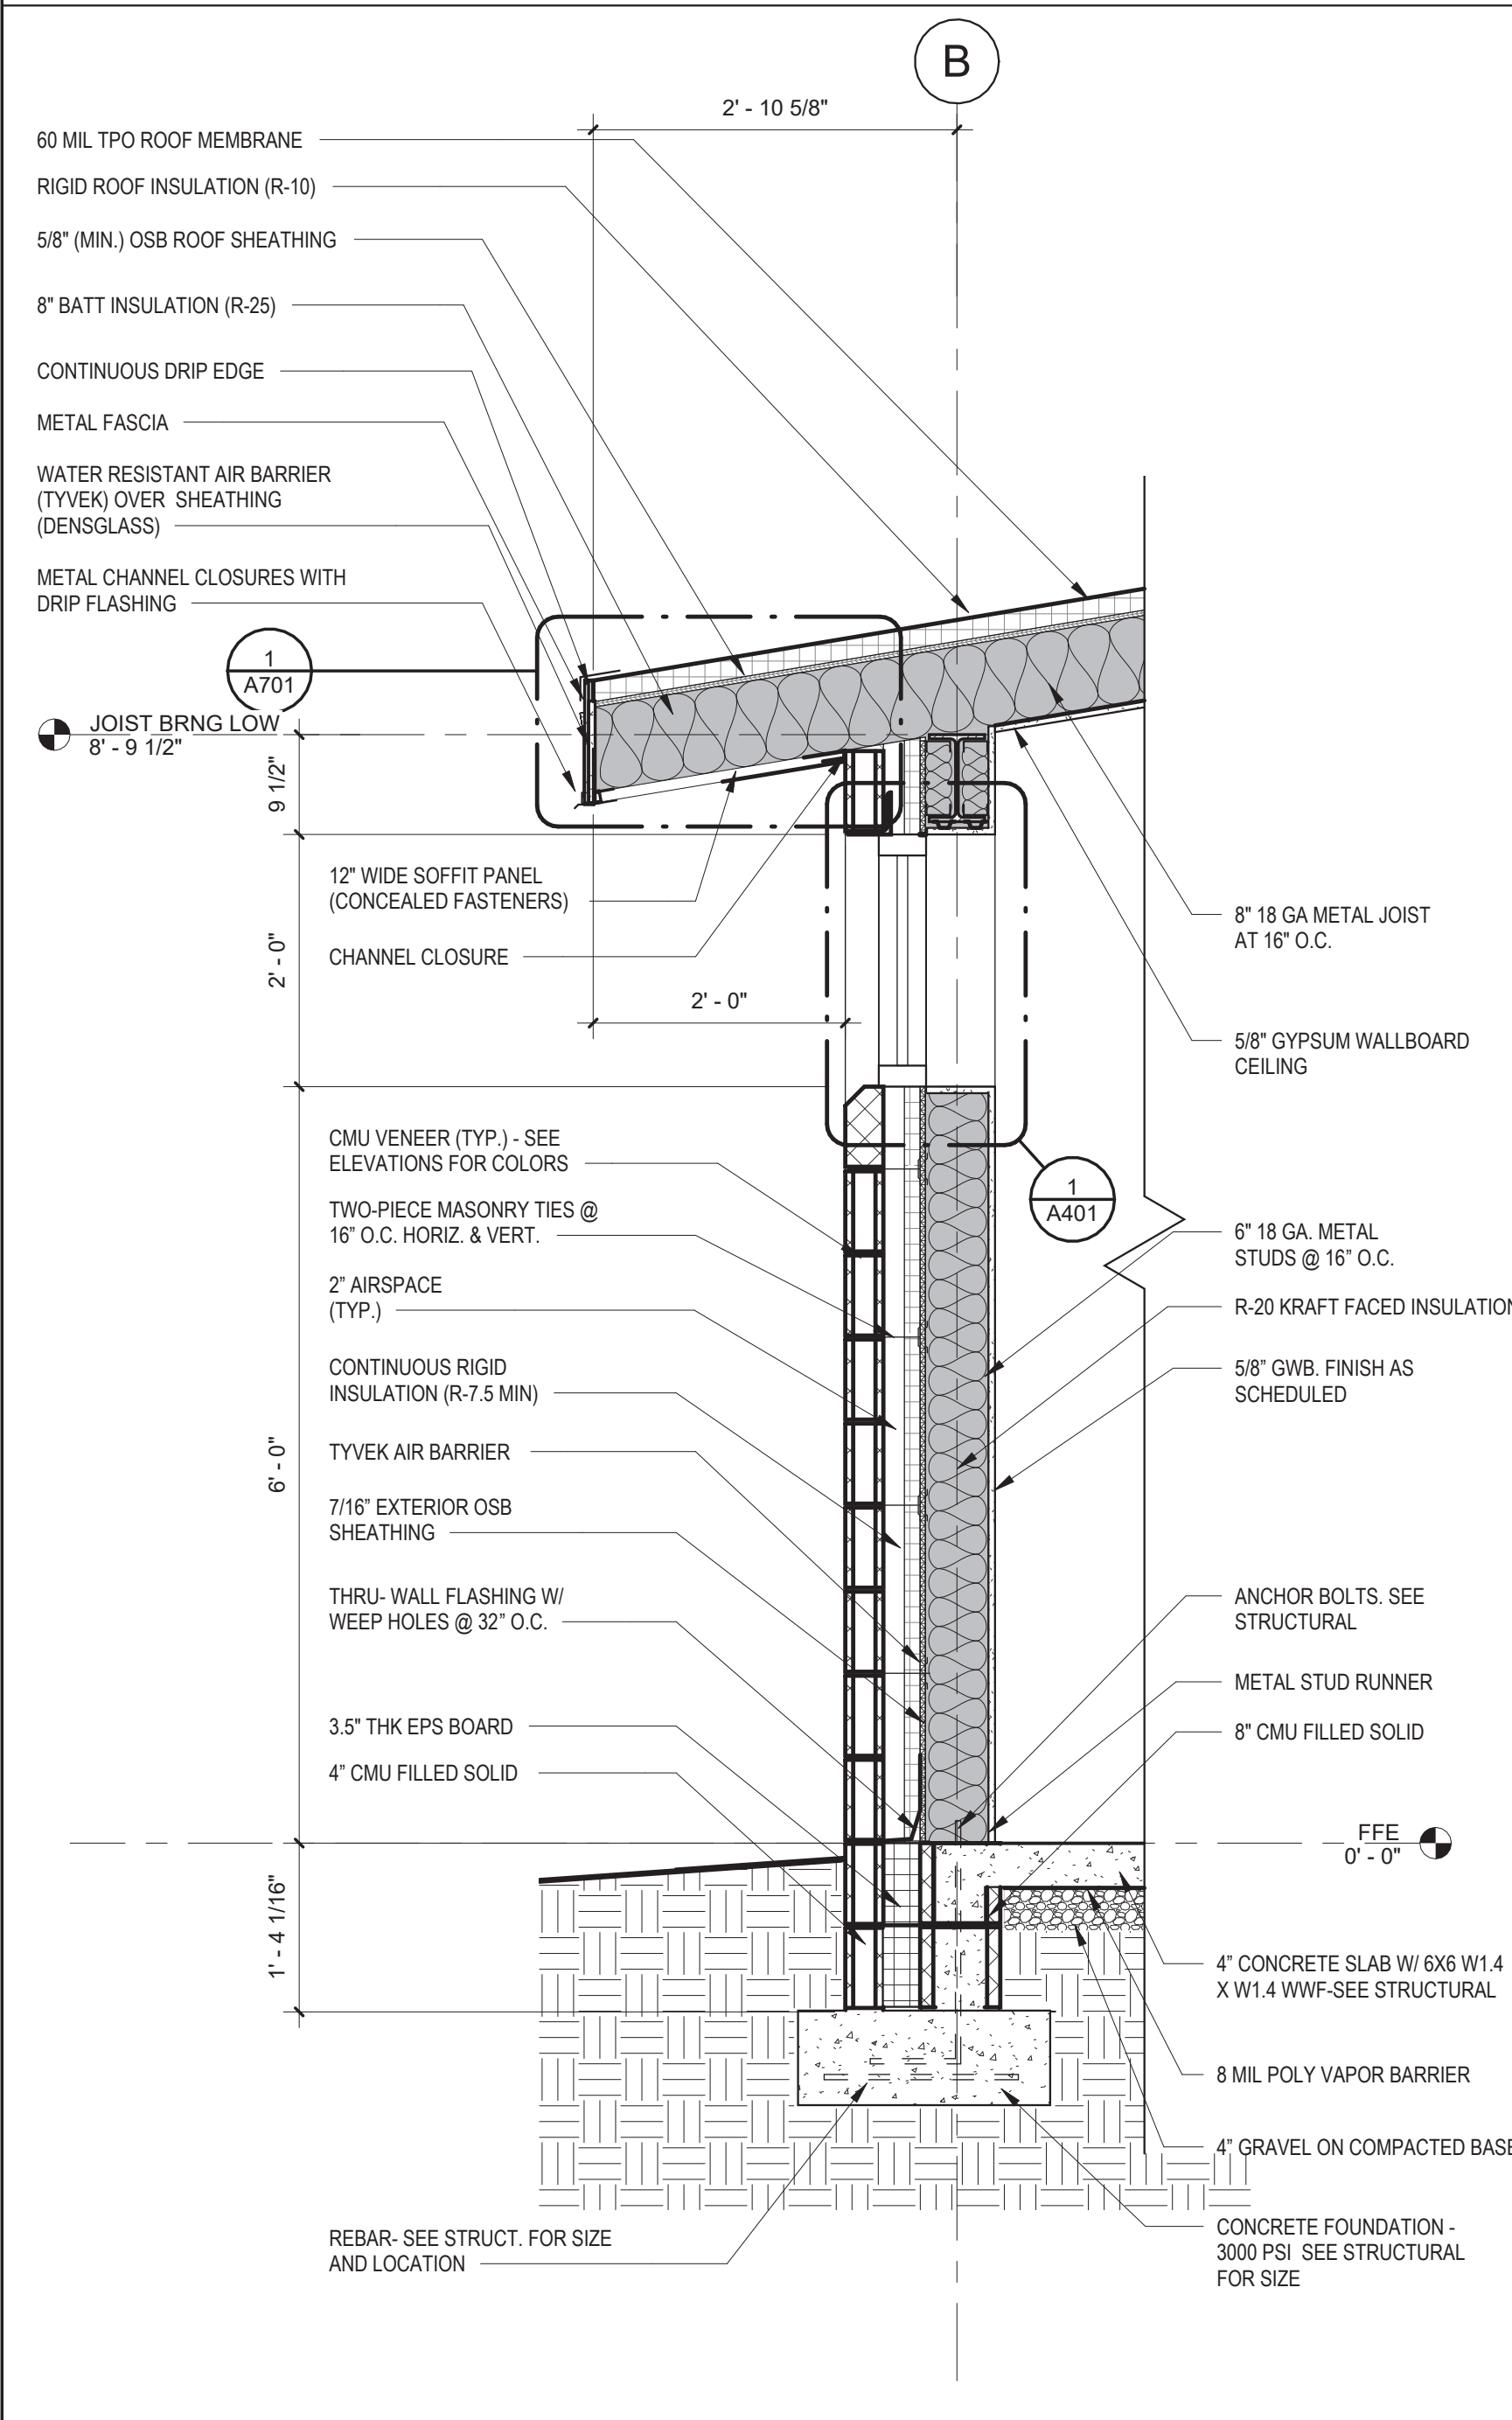


**4 WALL SECTION - LOW ROOF EDGE**  
3/4" = 1'-0"

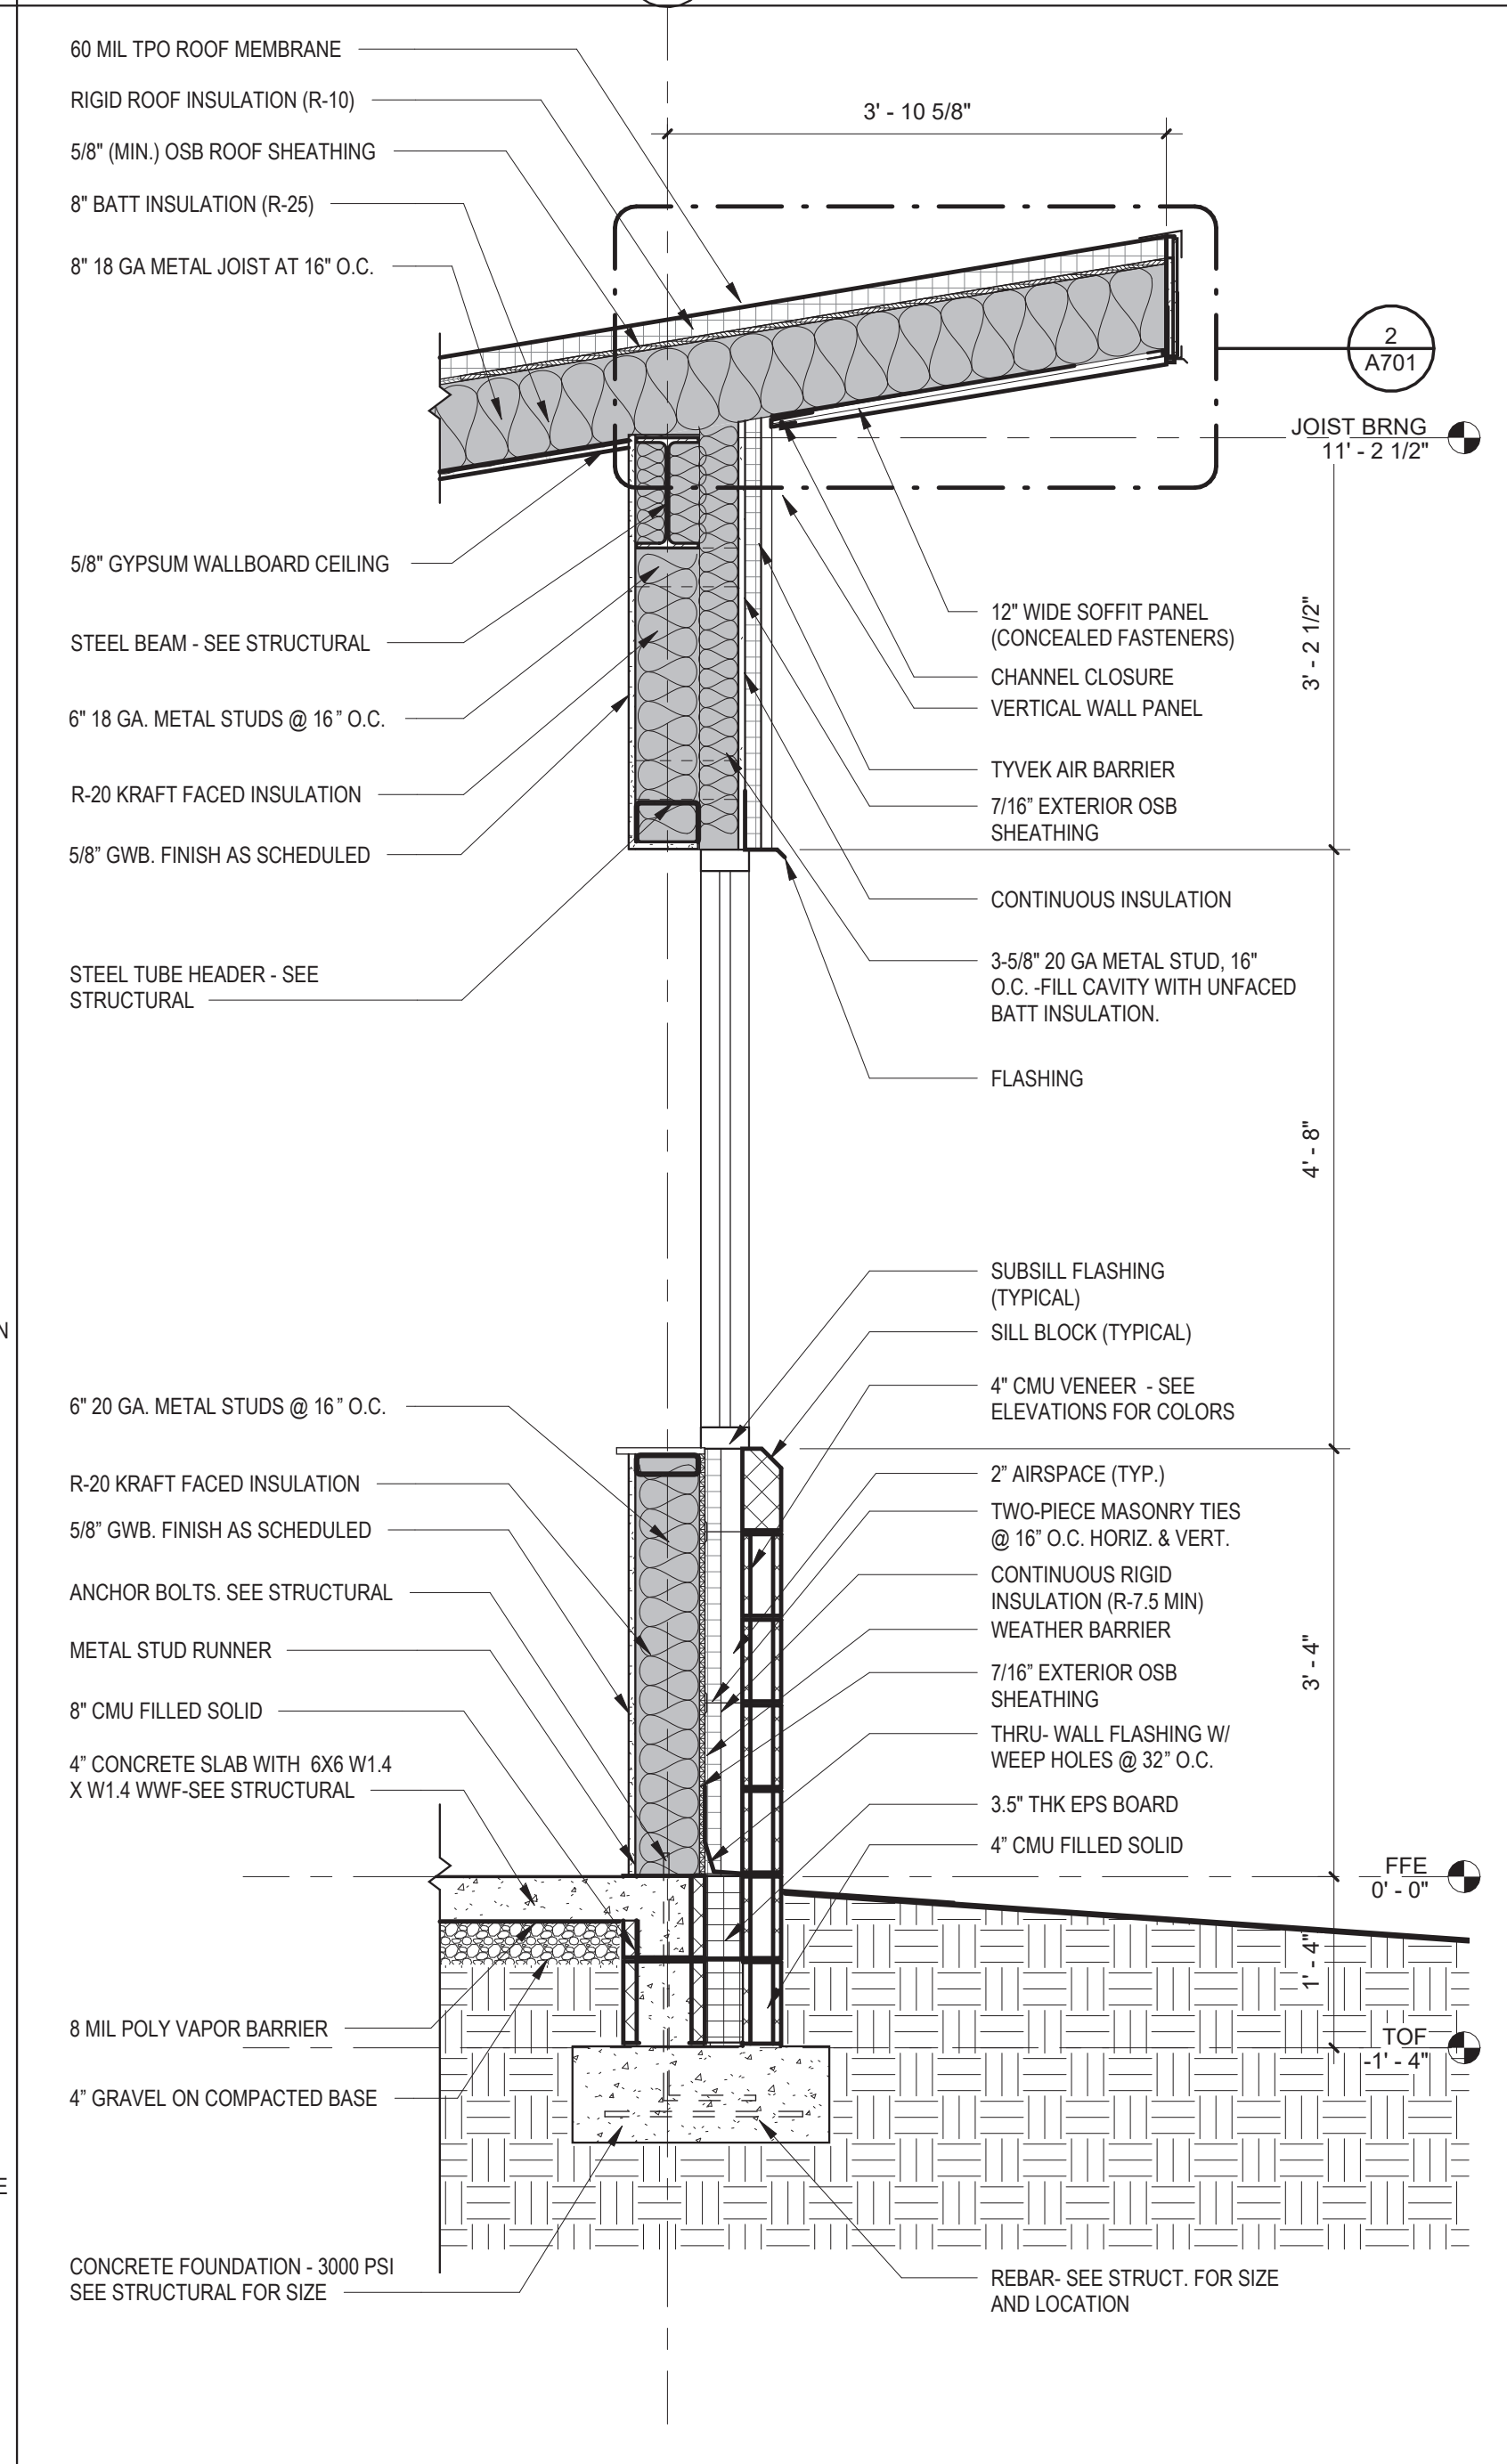

**5 WALL SECTION - HIGH ROOF EDGE**  
3/4" = 1'-0"

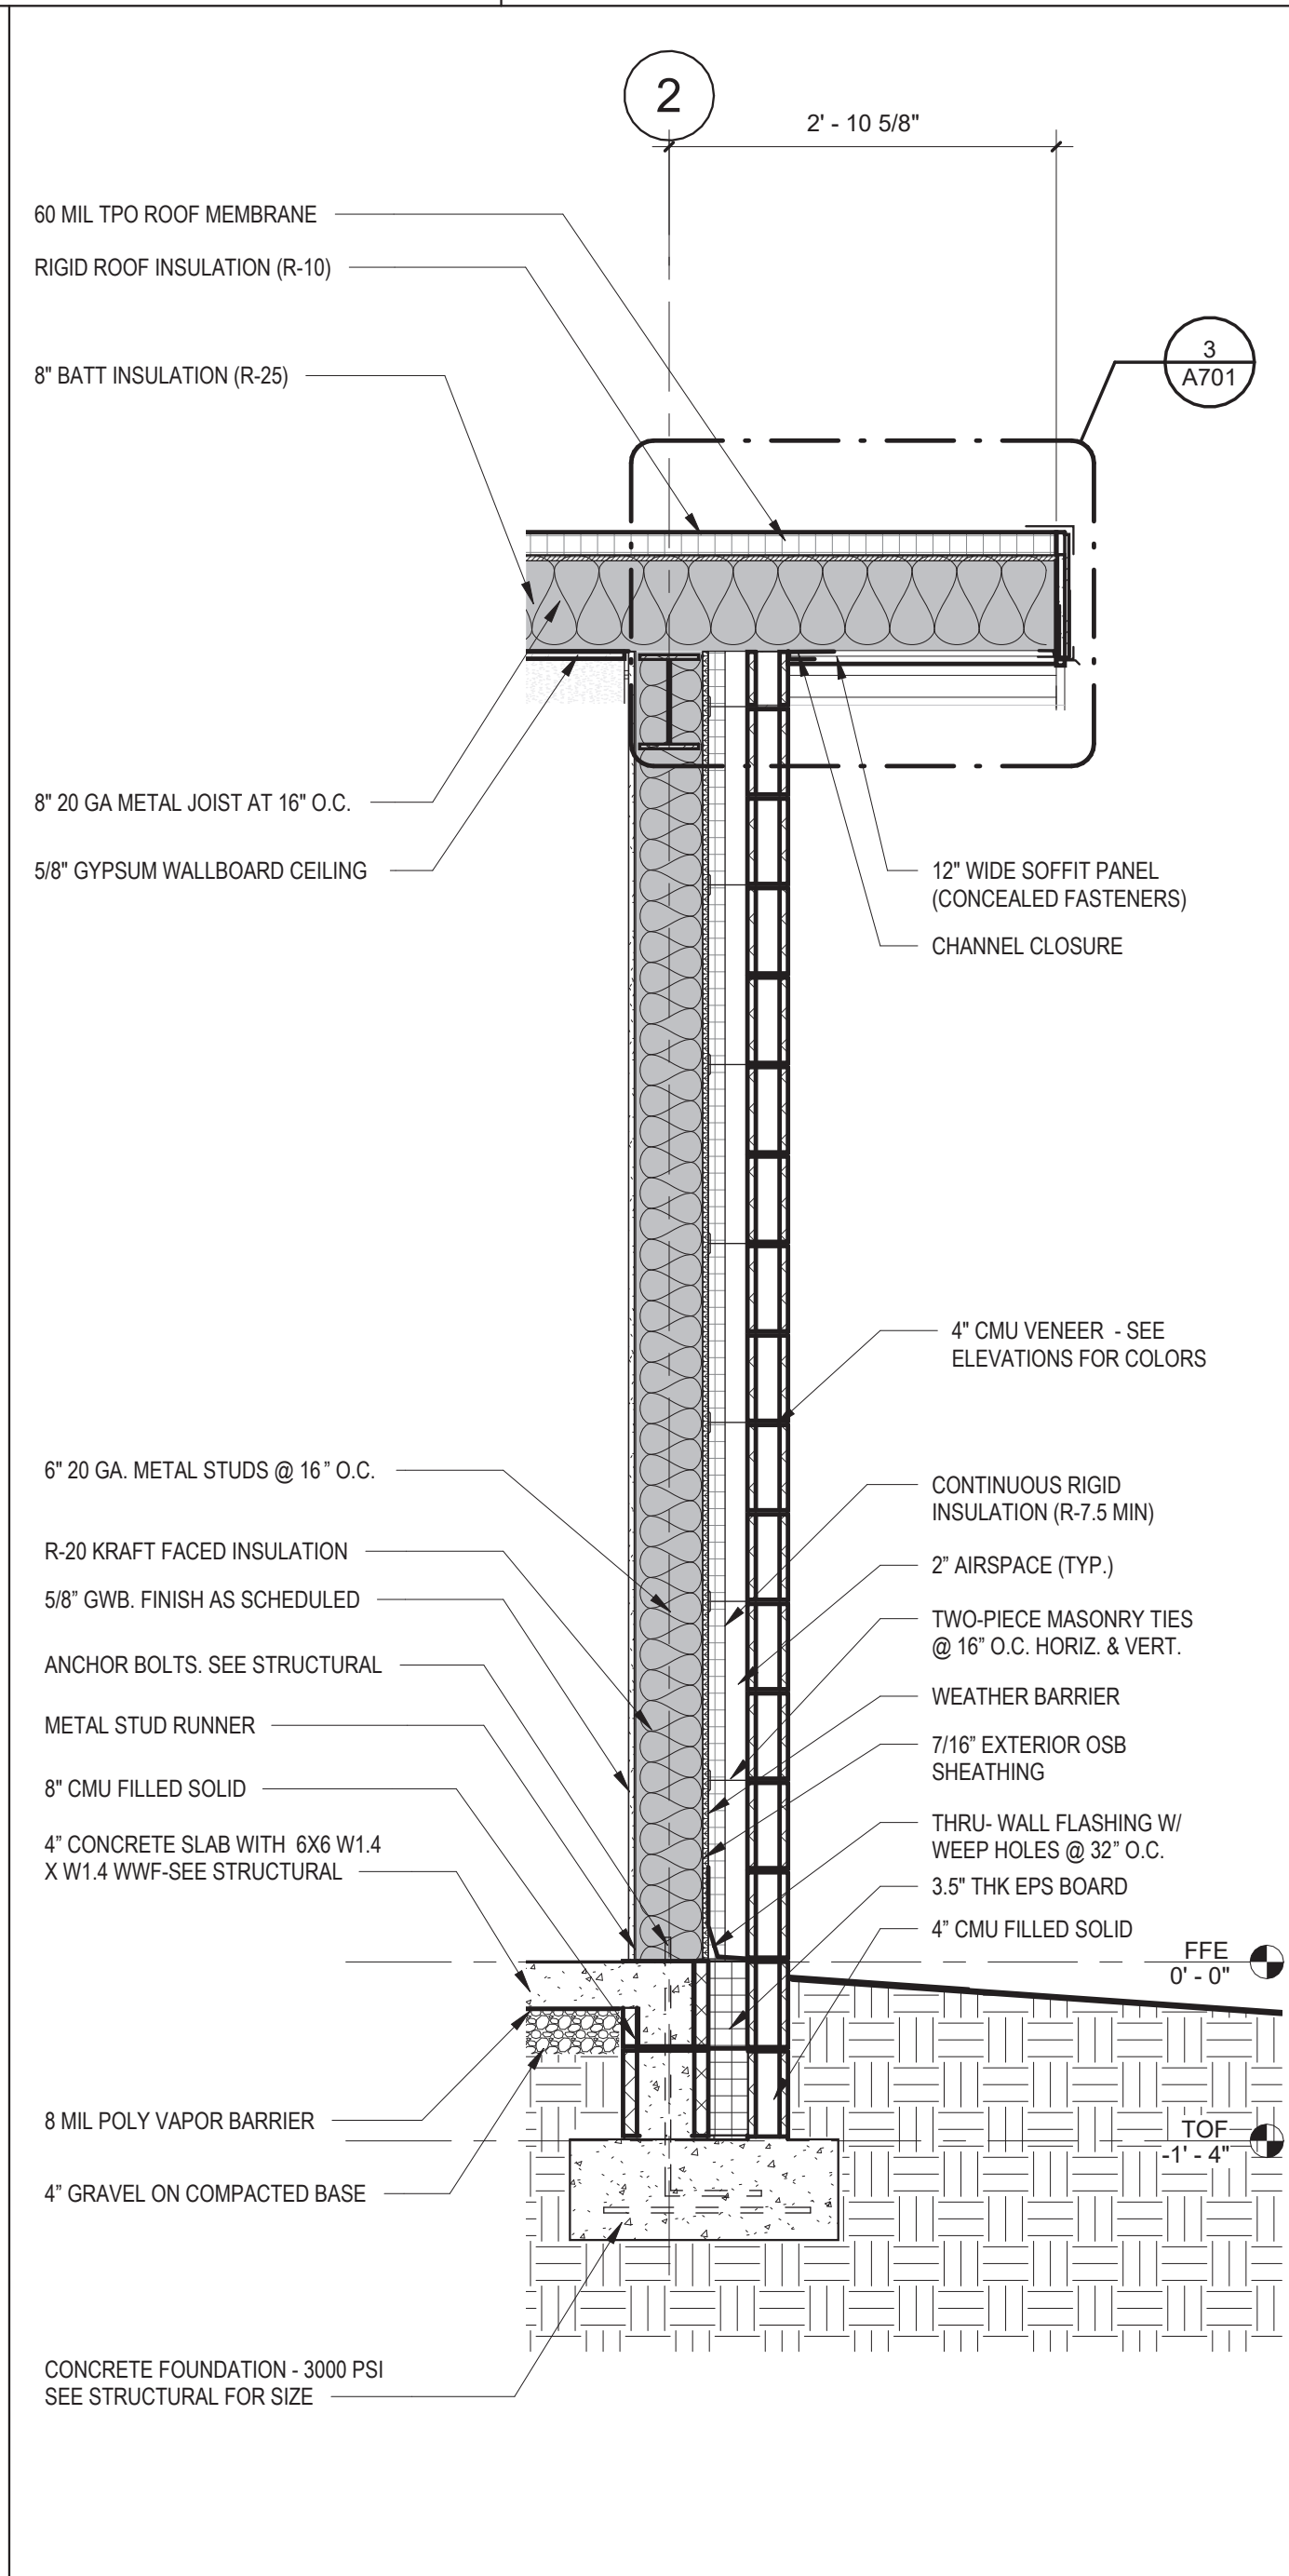

**6 WALL SECTION - RAKE SIDE**  
3/4" = 1'-0"

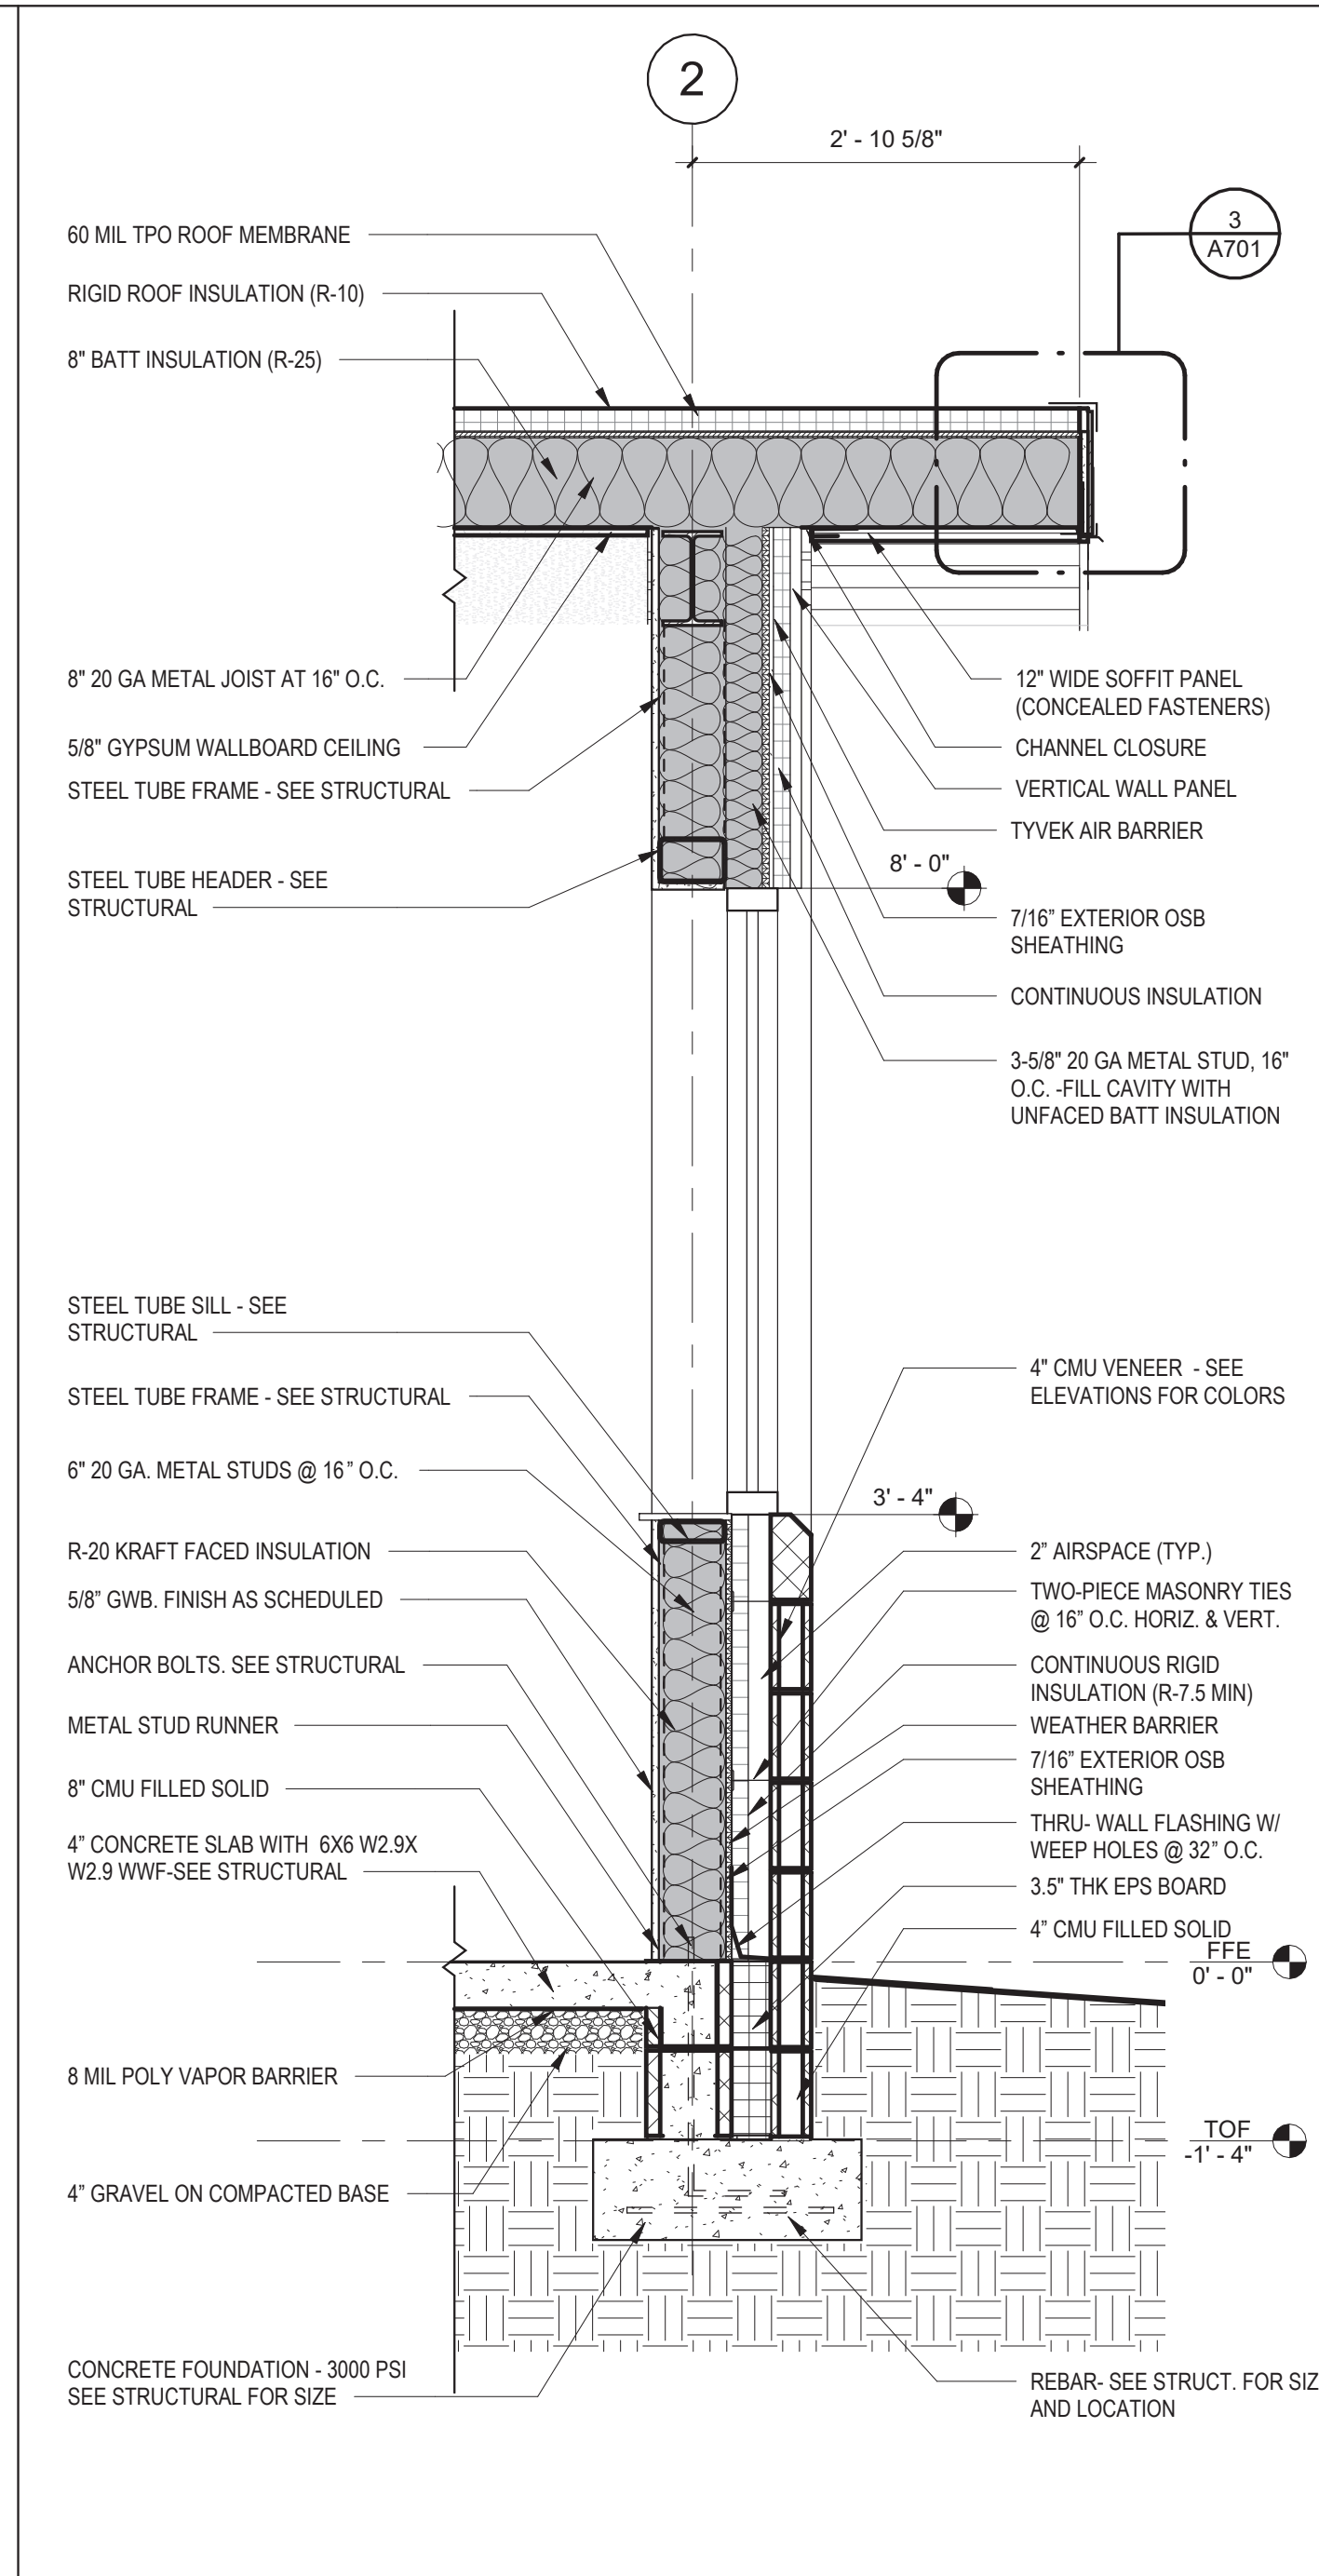

**7 WALL SECTION - RAKE (WINDOW)**  
3/4" = 1'-0"




**GONTRAM ARCHITECTURE, INC.**

5100 UNICON DR. SUITE 103  
WAKE FOREST, NC 27587  
PHONE: 919.876.5331

eddie@gontramarchitecture.com  
www.gontramarchitecture.com

Copyright 2023

THESE DOCUMENTS ARE INSTRUMENTS OF SERVICE AND AS SUCH REMAIN THE PROPERTY OF THE ARCHITECT. PUBLISH OR USE THEM ONLY WITH THE ARCHITECT'S EXPRESSED WRITTEN APPROVAL.

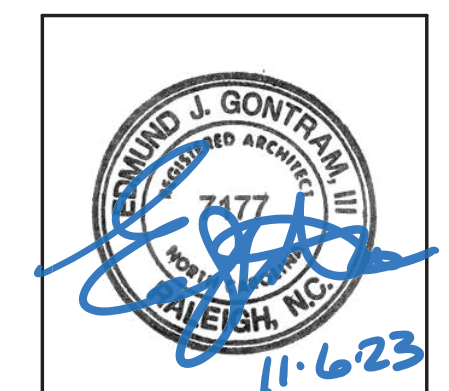

**ATTENDANT BUILDING  
ASSEMBLY COURT SOLID WASTE  
CONVENIENCE CENTER**  
575 ASSEMBLY COURT | FAYETTEVILLE, NC 28306

PLOT DATE:  
11/06/2023

ISSUED:  
NOVEMBER 6, 2023  
FOR CONSTRUCTION

Rev.	Date	Description

DRAWN BY: PJA APPROVED: EUG

PROJECT NO.: 22003 RECORD:

CONTENTS:  
WALL SECTIONS

SHEET:  
**A701**





**GONTRAM ARCHITECTURE, INC.**

5100 UNICON DR. SUITE 103  
WAKE FOREST, NC 27587  
PHONE: 919.876.5331

eddie@gontramarchitecture.com  
www.gontramarchitecture.com

© Copyright 2023  
THESE DOCUMENTS ARE INSTRUMENTS OF SERVICE AND AS SUCH REMAIN THE PROPERTY OF THE ARCHITECT. PUBLISH OR USE THEM ONLY WITH THE ARCHITECT'S EXPRESSED WRITTEN APPROVAL.



ATTENDANT BUILDING  
ASSEMBLY COURT SOLID WASTE  
CONVENIENCE CENTER  
575 ASSEMBLY COURT | FAYETTEVILLE, NC 28306

PLOT DATE:		
11/06/23		
ISSUED:		
NOVEMBER 6, 2023		
FOR CONSTRUCTION		
Rev.	Date	Description

DRAWN BY: Author	APPROVED: EJG
PROJECT NO.: 22003	RECORD:
CONTENTS: SPECIFICATIONS	

SHEET:  
**AS-002**

**SECTION 092116  
GYPSUM BOARD ASSEMBLIES**

- PART 1 GENERAL**
- PART 2 PRODUCTS**
- 2.01 GYPSUM BOARD ASSEMBLIES**
- A. Provide completed assemblies complying with ASTM C840 and GA-216.
  - B. Interior Partitions, Indicated as Acoustic: Provide completed assemblies with the following characteristics:
    1. Acoustic Attenuation: STC of 45-49 calculated in accordance with ASTM E413, based on tests conducted in accordance with ASTM E90.
- 2.02 METAL FRAMING MATERIALS**
- A. Steel Sheet: ASTM A1003/A1003M, subject to the ductility limitations indicated in AISI S220 or equivalent.
  - B. Nonstructural Framing System Components: AISI S220; galvanized sheet steel, of size and properties necessary to comply with ASTM C754 for the spacing indicated, with maximum deflection of wall framing of L/120 at 5 psf (L/120 at 240 Pa).
    1. Studs: C-shaped with knurled or embossed faces.
    2. Runners: U shaped, sized to match studs.
- 2.03 BOARD MATERIALS**
- A. Gypsum Wallboard: Paper-faced gypsum panels as defined in ASTM C1396/C1396M; sizes to minimize joints in place; ends square cut.
    1. Application: Use for vertical surfaces and ceilings, unless otherwise indicated.
    2. Thickness:
      1. Ceiling Board: Special sag resistant gypsum ceiling board as defined in ASTM C1396/C1396M; sizes to minimize joints in place; ends square cut.
        1. Application: Ceilings, unless otherwise indicated.
        2. Thickness: 1/2 inch (13 mm).
        3. Edges: Tapered.
- 2.04 GYPSUM BOARD ACCESSORIES**
- PART 3 EXECUTION**
- 3.01 FRAMING INSTALLATION**
- A. Metal Framing: Install in accordance with ASTM C1007/AISI S220 and manufacturer's instructions.
- 3.02 ACOUSTIC ACCESSORIES INSTALLATION**
- A. Acoustic Insulation: Place tightly within spaces, around cut openings, behind and around electrical and mechanical items within partitions, and light to items passing through partitions.
- 3.03 BOARD INSTALLATION**
- A. Comply with ASTM C840, GA-216, and manufacturer's instructions. Install to minimize butt end joints, especially in highly visible locations.
  - B. Single-Layer Nonrated: Install gypsum board in most economical direction, with ends and edges occurring over firm bearing.
  - C. Installation on Metal Framing: Use screws for attachment of gypsum board except face layer of nonrated double-layer assemblies, which may be installed by means of adhesive lamination.
- 3.04 JOINT TREATMENT**
- A. Paper Faced Gypsum Board: Use paper joint tape, embed with drying type joint compound and finish with drying type joint compound.
  - B. Finish gypsum board in accordance with levels defined in ASTM C840, as follows:
    1. Level 4: Walls and ceilings to receive paint finish or wall coverings, unless otherwise indicated.
    2. Level 1: Fire-resistance-rated wall areas above finished ceilings, whether or not accessible in the completed construction.

**END OF SECTION  
SECTION 096500  
RESILIENT FLOORING**

- PART 1 GENERAL**
- PART 2 PRODUCTS**
- 2.01 TILE FLOORING**
- A. Vinyl Composition Tile - \_\_\_\_: Homogeneous, with color extending throughout thickness.
    1. Minimum Requirements: Comply with ASTM F1066, of Class corresponding to type specified.
    2. Size: 12 by 12 inch (305 by 305 mm).
    3. Thickness: 0.125 inch (3.2 mm).
    4. Color: To be selected by Architect from manufacturer's full range.
- 2.02 RESILIENT BASE**
- A. Resilient Base: ASTM F1861, Type TS, rubber, vulcanized thermoset; style as scheduled.
    1. Height: 4 inches (100 mm).
    2. Thickness: 0.125 inch (3.2 mm).
    3. Finish: Satin.
    4. Length: Roll.
    5. Color: To be selected by Architect from manufacturer's full range.
- 2.03 ACCESSORIES**
- A. Primers, Adhesives, and Seam Sealer: Waterproof, types recommended by flooring manufacturer.
  - B. Moldings, Transition and Edge Strips: Same material as flooring.
- PART 3 EXECUTION**
- 3.01 INSTALLATION - GENERAL**
- A. Starting installation constitutes acceptance of subfloor conditions.
  - B. Install in accordance with manufacturer's written instructions.
- 3.02 INSTALLATION - TILE FLOORING**
- A. Mix tile from container to ensure shade variations are consistent when tile is placed, unless otherwise indicated in manufacturer's installation instructions.
  - B. Lay flooring with joints and seams parallel to building lines to produce symmetrical pattern.
- 3.03 INSTALLATION - RESILIENT BASE**
- A. Fit joints tightly and make vertical. Maintain minimum dimension of 18 inches (45 mm) between joints.

**END OF SECTION  
SECTION 099123  
INTERIOR PAINTING**

- PART 1 GENERAL**
- 1.01 SECTION INCLUDES**
- A. Scope: Finish interior surfaces exposed to view, unless fully factory-finished and unless otherwise indicated.
  - B. Do Not Paint or Finish the Following Items:
    1. Items factory-finished unless otherwise indicated; materials and products having factory-applied primers are not considered factory finished.
    2. Items indicated to receive other finishes.
    3. Items indicated to remain unfinished.
    4. Fire rating labels, equipment serial number and capacity labels, bar code labels, and operating parts of equipment.
    5. Floors, unless specifically indicated.
    6. Glass.
    7. Concealed pipes, ducts, and conduits.
- PART 2 PRODUCTS**
- 2.01 PAINTS AND FINISHES - GENERAL**

- A. Paints and Finishes: Ready-mixed, unless intended to be a field-catalyzed paint.
    1. Provide paints and finishes of a soft paste consistency, capable of being readily and uniformly dispersed to a homogeneous coating, with good flow and brushing properties, and capable of drying or curing free of streaks or sags.
    2. Supply each paint material in quantity required to complete entire project's work from a single production run.
    3. Do not reduce, thin, or dilute paint or finishes or add materials unless such procedure is specifically described in manufacturer's product instructions.
- 2.02 PAINT SYSTEMS - INTERIOR**
- A. Paint I-OP - Interior Surfaces to be Painted, Unless Otherwise Indicated: Including gypsum board, uncoated steel, shop primed steel, and galvanized steel.
    1. Two top coats and one coat primer.
    2. Top Coat Sheen:
      - a. Eggshell: MPI gloss level 3; use this sheen at all locations.
      - b. Satin: MPI gloss level 4; use this sheen for items subject to frequent touching by occupants, including door frames and railings.
  - B. Paint I-OP-MD-DT - Medium Duty Door/Trim: For surfaces subject to frequent contact by occupants, including metals and wood:
    1. Two top coats and one coat primer.
    2. Top Coat(s): High Performance Architectural Interior Latex; MPI #138, 139, 140, or 141.
    3. Top Coat Sheen:

- PART 3 EXECUTION**
- 3.01 EXAMINATION**
- A. Measure moisture content of surfaces using an electronic moisture meter. Do not apply finishes unless moisture content of surfaces is below the following maximums:
    1. Gypsum Wallboard: 12 percent.
    2. Interior Wood: 15 percent, measured in accordance with ASTM D4442.
- 3.02 PREPARATION**
- A. Clean surfaces thoroughly and correct defects prior to application.
  - B. Prepare surfaces using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.
- 3.03 APPLICATION**
- A. Apply products in accordance with manufacturer's written instructions and recommendations in "MPI Architectural Painting Specification Manual".
  - B. Do not apply finishes to surfaces that are not dry. Allow applied coats to dry before next coat is applied.

**END OF SECTION  
DIVISION 10 - SPECIALTIES  
SECTION 102800  
TOILET, BATH, AND LAUNDRY ACCESSORIES**

- PART 2 PRODUCTS**
- 1.01 MANUFACTURERS**
- 1.02 MATERIALS**
- A. Accessories - General: Shop assembled, free of dents and scratches and packaged complete with anchors and fittings, steel anchor plates, adapters, and anchor components for installation.
  - B. Mirror Glass: Annealed float glass, ASTM C1036 Type I, Class 1, Quality Q2, with silvering, protective and physical characteristics complying with ASTM C1503.
- 1.03 FINISHES**
- A. Stainless Steel: Satin finish, unless otherwise noted.
  - B. Chrome/Nickel Plating: ASTM B456, SC 2, polished finish, unless otherwise noted.
- 1.04 COMMERCIAL TOILET ACCESSORIES**
- A. Toilet Paper Dispenser: Double roll, surface mounted bracket type, stainless steel, spindleless type for tension spring delivery designed to prevent theft of tissue roll.
  - B. Paper Towel Dispenser: Folded paper type, stainless steel, surface-mounted, with viewing slots on sides as refill indicator and tumbler lock.
    1. Capacity: 300 C-fold minimum.
  - C. Mirrors: Stainless steel framed, 1/4 inch (6 mm) thick annealed float glass; ASTM C1036.
  - D. Grab Bars: Stainless steel, smooth surface.
    1. Standard Duty Grab Bars:
      - a. Push/Pull Point Load: 250 pound-force (1112 N), minimum.
      - b. Dimensions: 1-1/4 inch (32 mm) outside diameter, minimum 0.05 inch (1.3 mm) wall thickness, exposed flange mounting, 1-1/2 inch (38 mm) clearance between wall and inside of grab bar.
      - c. Length and Configuration: As indicated on drawings.

- PART 3 EXECUTION**
- 2.01 INSTALLATION**
- A. Install accessories in accordance with manufacturers' instructions in locations indicated on drawings.
  - B. Install plumb and level, securely and rigidly anchored to substrate.
  - C. Mounting Heights: As required by accessibility regulations, unless otherwise indicated.

**END OF SECTION**

STRUCTURAL NOTES

I. GENERAL

1. DESIGN CODES

- NORTH CAROLINA BUILDING CODE, 2018 EDITION (AMENDED 2015 INTERNATIONAL BUILDING CODE)
  - ACI BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE (ACI 318-14)
  - AISC MANUAL OF STEEL CONSTRUCTION - ALLOWABLE STRESS DESIGN NINTH EDITION
  - ASCE 7-10 MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES
2. DESIGN LOADS
- RISK CATEGORY II
- LIVE LOADS: FIRST FLOOR: 100 PSF  
ROOF: 20 PSF
- ULTIMATE DESIGN WIND SPEED: 122 MPH
- GROUND SNOW LOAD 10 PSF
- SEISMIC DESIGN CATEGORY C  
SITE CLASS D  
S<sub>s</sub> = 0.234  
S<sub>1</sub> = 0.100

3. ALL ELEVATIONS ARE REFERENCED FROM FINISHED FLOOR ELEVATION OF 0'-0". SEE ARCHITECTURAL DRAWINGS FOR ADDITIONAL INFORMATION.
4. DETAILED SHOP DRAWINGS SHALL BE PROVIDED FOR REVIEW AND APPROVAL PRIOR TO CONSTRUCTION. STRUCTURAL STEEL SHOP DRAWINGS SHALL REQUIRE APPROVAL PRIOR TO FABRICATION.
5. ENGINEER'S SEAL APPLIES TO STRUCTURAL COMPONENTS ONLY AND DOES NOT CERTIFY ARCHITECTURAL LAYOUT OR DIMENSIONAL ACCURACY.
6. ROSS LINDEN ENGINEERS PC ASSUMES NO LIABILITY FOR CHANGES OR MODIFICATIONS MADE TO THESE DRAWINGS BY OTHERS, OR FOR CONSTRUCTION METHODS, OR FOR ANY DEVIATION FROM THESE DRAWINGS.

II. CONCRETE

1. UNLESS OTHERWISE NOTED, ALL CONCRETE SHALL HAVE THE FOLLOWING STRENGTH AND SLUMP REQUIREMENTS:  
3,500 PSI 28-DAY COMPRESSIVE STRENGTH, MAX. 5" SLUMP.
2. ALL CONCRETE SHALL BE MOIST CURED PER ACI 301 OR CURED WITH AN APPROVED CURING COMPOUND. CONTRACTOR SHALL VERIFY THAT THE CURING COMPOUND IS COMPATIBLE WITH FLOOR COVERING ADHESIVES, COATINGS, OR TOPPING TO BE USED. CONCRETE SHALL BE CURED FOR A MINIMUM OF 7 DAYS.
3. UNLESS OTHERWISE NOTED, ALL REINFORCING STEEL SHALL BE NEW BILLET STEEL, CONFORMING TO ASTM A-615, GRADE 60, DEFORMED.
4. UNLESS OTHERWISE NOTED, ALL DETAILING, FABRICATION, AND PLACING OF REINFORCING STEEL SHALL CONFORM TO THE MANUAL OF STANDARD PRACTICE FOR DETAILING REINFORCED CONCRETE STRUCTURES. (ACI 315)
5. ALL BAR SPLICES SHALL BE CLASS "B" TENSION SPLICES PER ACI 318-14, UNLESS OTHERWISE SHOWN.
6. ANCHOR BOLTS TO BE ASTM A36 OR A307.
7. CONTRACTOR SHALL REFER TO DRAWINGS OF OTHER TRADES AND VENDOR DRAWINGS FOR EMBEDDED ITEMS AND RECESSES NOT SHOWN ON THE STRUCTURAL DRAWINGS.
8. A GEOTECHNICAL REPORT BY GEOTECHNOLOGIES DATED 27 JULY 2023 HAS BEEN USED AS THE BASIS OF THIS DESIGN. ALL SPREAD FOOTINGS ARE DESIGNED FOR AN ALLOWABLE BEARING PRESSURE OF 3,000 PSF. A GEOTECHNICAL REPRESENTATIVE SHALL INSPECT ALL FOOTING EXCAVATIONS TO CONFIRM ALLOWABLE BEARING PRESSURES.
9. PROVIDE TWO (2) #5 x 4'-0" LONG DIAGONAL BARS IN TOP FACE OF ALL SLABS (1" CLEAR) AT ALL RE-ENTRANT CORNERS.
10. CONTRACTOR SHALL BE RESPONSIBLE FOR LOCATING, PROTECTING, AND RELOCATING AS REQUIRED ALL SERVICE AND UTILITY LINES IN VICINITY OF THE WORK SITE.
11. CONTRACTOR SHALL VERIFY ALL SIZES AND LOCATIONS OF ALL MECHANICAL AND ELECTRICAL OPENINGS AND EQUIPMENT PADS WITH THE MECHANICAL AND ELECTRICAL DETAILS AND SHOP DRAWINGS BY OTHERS. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO PROVIDE ALL OPENINGS AND SLEEVES FOR PROPER DISTRIBUTION FOR ALL UTILITIES THROUGHOUT THE BUILDING.
12. ALL DOWELS WHICH ARE TO BE DRILLED AND GROUTED INTO EXISTING CONCRETE SHALL BE DONE WITH AN EPOXY GROUT. DRILL HOLE WITH DIAMETER 1/8" LARGER THAN DOWEL OR AS RECOMMENDED BY GROUT SUPPLIER. USE HIT-RE 500 V3 BY HILTI OR APPROVED EQUAL.

III. MASONRY

1. MASONRY CONSTRUCTION SHALL COMPLY WITH ACI 530.1-13/ASCE 6-13: "SPECIFICATION FOR MASONRY STRUCTURES."
2. ASSUMED MASONRY PROPERTIES: UNIT COMPRESSIVE STRENGTH 1900 PSI, TYPE S MORTAR, PARTIAL GROUT, RUNNING BOND.

IV. STRUCTURAL STEEL


1. SEE FRAMING PLANS FOR BOTTOM OF BASE PLATE ELEVATIONS.
2. ALL STRUCTURAL STEEL WIDE FLANGE BEAMS AND COLUMNS, UNLESS NOTED, SHALL CONFORM TO THE REQUIREMENTS OF ASTM A992 OR ASTM A572, GRADE 50. ANGLES AND CHANNELS SHALL CONFORM TO ASTM A36. TUBES SHALL CONFORM TO ASTM A500, GRADE B.
3. ALL DETAILING, FABRICATION, AND ERECTION OF STRUCTURAL STEEL, UNLESS OTHERWISE NOTED, SHALL CONFORM TO THE REQUIREMENTS OF THE AISC SPECIFICATIONS FOR BUILDINGS, LATEST EDITION.
4. UNLESS OTHERWISE NOTED, ALL SHOP CONNECTIONS SHALL BE MADE BY WELDING OR HIGH STRENGTH BOLTING. (3/4" DIAMETER BOLTS, MINIMUM)
5. WELDS SHALL BE MADE WITH E-70XX ELECTRODES BY CERTIFIED WELDERS.
6. UNLESS OTHERWISE NOTED, ALL FIELD CONNECTIONS SHALL BE MADE WITH 3/4" DIAMETER HIGH STRENGTH BOLTS (ASTM A-325). CONNECTIONS SHALL BE DESIGNED AS BEARING TYPE WITH THREADS IN SHEAR PLANE. BOLTS SHALL BE TIGHTENED TO THE SNUG TIGHT CONDITION PER "AISC" UNLESS NOTED OTHERWISE ON THE DRAWINGS.
7. UNLESS OTHERWISE SHOWN, ALL BEAM CONNECTIONS SHALL BE STANDARD FRAMED OR SEATED CONNECTIONS AS SHOWN IN PART 10 OF THE AISC MANUAL OF STEEL CONSTRUCTION. UNLESS REACTIONS ARE INDICATED ON THE DRAWINGS, CONNECTIONS SHALL DEVELOP AT LEAST ONE-HALF OF THE TOTAL UNIFORM LOAD CAPACITY TABULATED IN THE TABLES OF THE MANUAL FOR THE GIVEN SHAPE AND SPAN OF THE BEAM IN QUESTION. IN NO CASE, HOWEVER, SHALL THE LENGTH OF THE FRAMED CONNECTIONS BE LESS THAN ONE-HALF OF THE "T" DISTANCE OF THE BEAM WEB.
8. GUSSET PLATES SHALL BE 3/8" THICK MINIMUM.
9. ALL COLUMN ANCHOR BOLT HOLES TO BE OVERSIZED IN ACCORDANCE WITH RECOMMENDATIONS OF "AISC" MANUAL FOR "DETAILING FOR STEEL CONSTRUCTION."
10. UNLESS NOTED OTHERWISE ON THE DRAWINGS, ALL BRACING CONNECTIONS SHALL BE DESIGNED AND DETAILED SO THAT ALL FORCE COMPONENTS CAN BE DELIVERED DIRECTLY TO THE CENTERLINE OF INTERSECTING MEMBERS. ALTERNATELY, CONNECTIONS SHALL BE DESIGNED TO ACCOUNT FOR RESULTING ECCENTRICITIES.
11. CONTRACTOR TO PROVIDE ADEQUATE BRACING FOR STRUCTURE SO THAT IT WILL BE STABLE DURING ALL STAGES OF CONSTRUCTION. THE STRUCTURE AND FOUNDATIONS ARE DESIGNED FOR A COMPLETED CONDITION ONLY AND THEREFORE REQUIRES ADDITIONAL SUPPORT TO MAINTAIN STABILITY BEFORE COMPLETION.

V. LIGHT GAUGE STEEL FRAMING


1. INSTALLATION OF LIGHT GAUGE STEEL FRAMING SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
2. WALL STUDS SHALL HAVE THE FOLLOWING PROPERTIES:  
16" MAX. SPACING  
STUD DEPTH = 6"  
FLANGE WIDTH = 1.58"  
18 GAUGE STEEL
3. PROVIDE MIN. 18 GA. BOTTOM TRACK AND ANCHOR TO SLAB WITH POWDER ACTUATED FASTENERS AT 16" O.C.
4. SEE ARCH. DWGS. FOR WALL FINISH MATERIALS. PROVIDE GYPSUM BOARD ON ALL INTERIOR WALLS (MINIMUM 1/2"). FASTEN ALL PANELS WITH 1 1/4" SCREWS AT 7" o.c. AT TOP AND BOTTOM PLATES AND ALL STUDS FOR INTERIOR SIDE OF EXTERIOR WALLS, AND 12" o.c. AT TOP AND BOTTOM PLATES AND ALL STUDS FOR ALL OTHER WALLS. GYPSUM SHALL BE APPLIED PERPENDICULAR TO FRAMING.
5. ALL EXTERIOR WALLS SHALL BE SHEATHED WITH MINIMUM 7/16" WOOD STRUCTURAL SHEATHING (PLYWOOD -or- OSB) WITH BLOCKING AT ALL JOINTS. FASTEN ALL PANELS WITH SCREWS AT 3" o.c. AT ALL EDGES AND AT 6" o.c. AT INTERMEDIATE FRAMING.
6. SEE TYPICAL WALL SECTION FOR ADDITIONAL INFORMATION.
7. DETAILED SHOP DRAWINGS SHALL BE PROVIDED FOR REVIEW AND APPROVAL PRIOR TO CONSTRUCTION.

VI. WOOD

1. ALL EXTERIOR WALLS SHALL BE SHEATHED WITH MINIMUM 7/16" SHEATHING WITH BLOCKING AT ALL JOINTS. FASTEN ALL PANELS WITH SCREWS AT 4" o.c. AT ALL EDGES AND AT 8" o.c. AT INTERMEDIATE FRAMING. ORIENT PANEL EDGE PARALLEL WITH FRAMING.
2. PROVIDE MINIMUM 1/2" GYPSUM BOARD ON BOTH SIDES OF FULL-HEIGHT INTERIOR WALLS WITH INTERMEDIATE SUPPORT AT ALL JOINTS. FASTEN ALL PANELS WITH 1 1/4" SCREWS AT 7" o.c. AT TOP AND BOTTOM PLATES AND ALL STUDS. GYPSUM SHALL BE APPLIED PERPENDICULAR TO FRAMING.
3. ROOF FRAMING SHALL BE SHEATHED WITH MINIMUM 5/8" WOOD STRUCTURAL SHEATHING (PLYWOOD -or- OSB). PROVIDE PLYWOOD EDGE CLIPS BETWEEN PANELS.

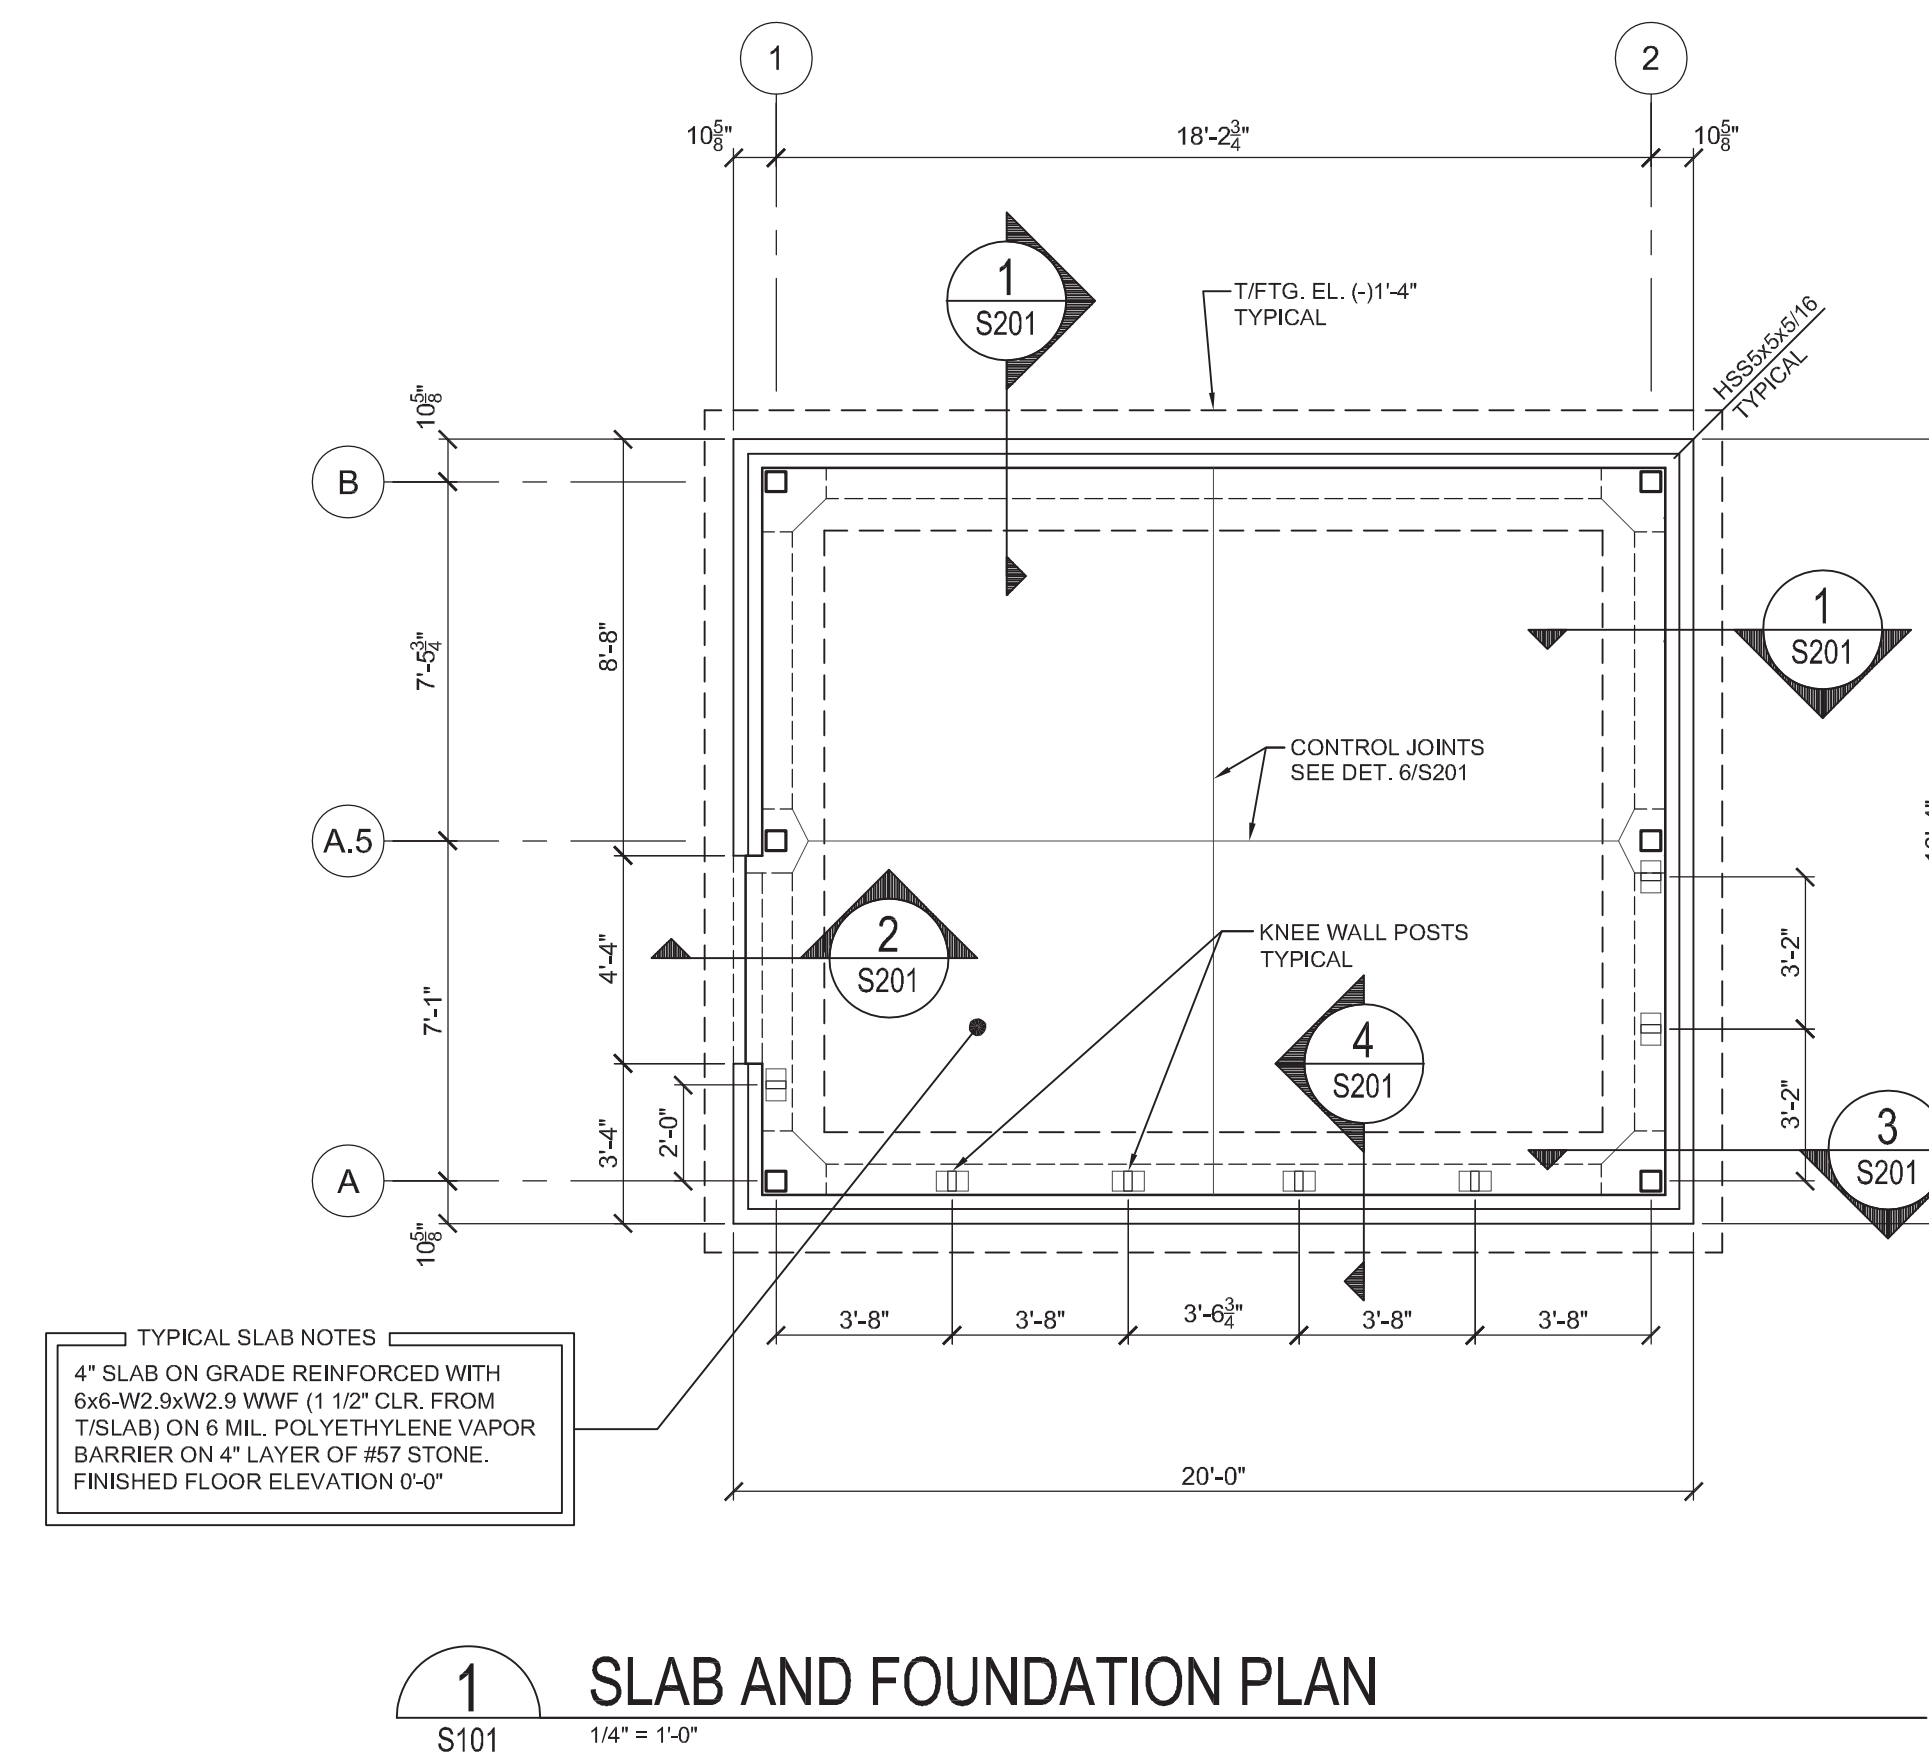

1 SLAB AND FOUNDATION PLAN  
S101 1/4" = 1'-0"

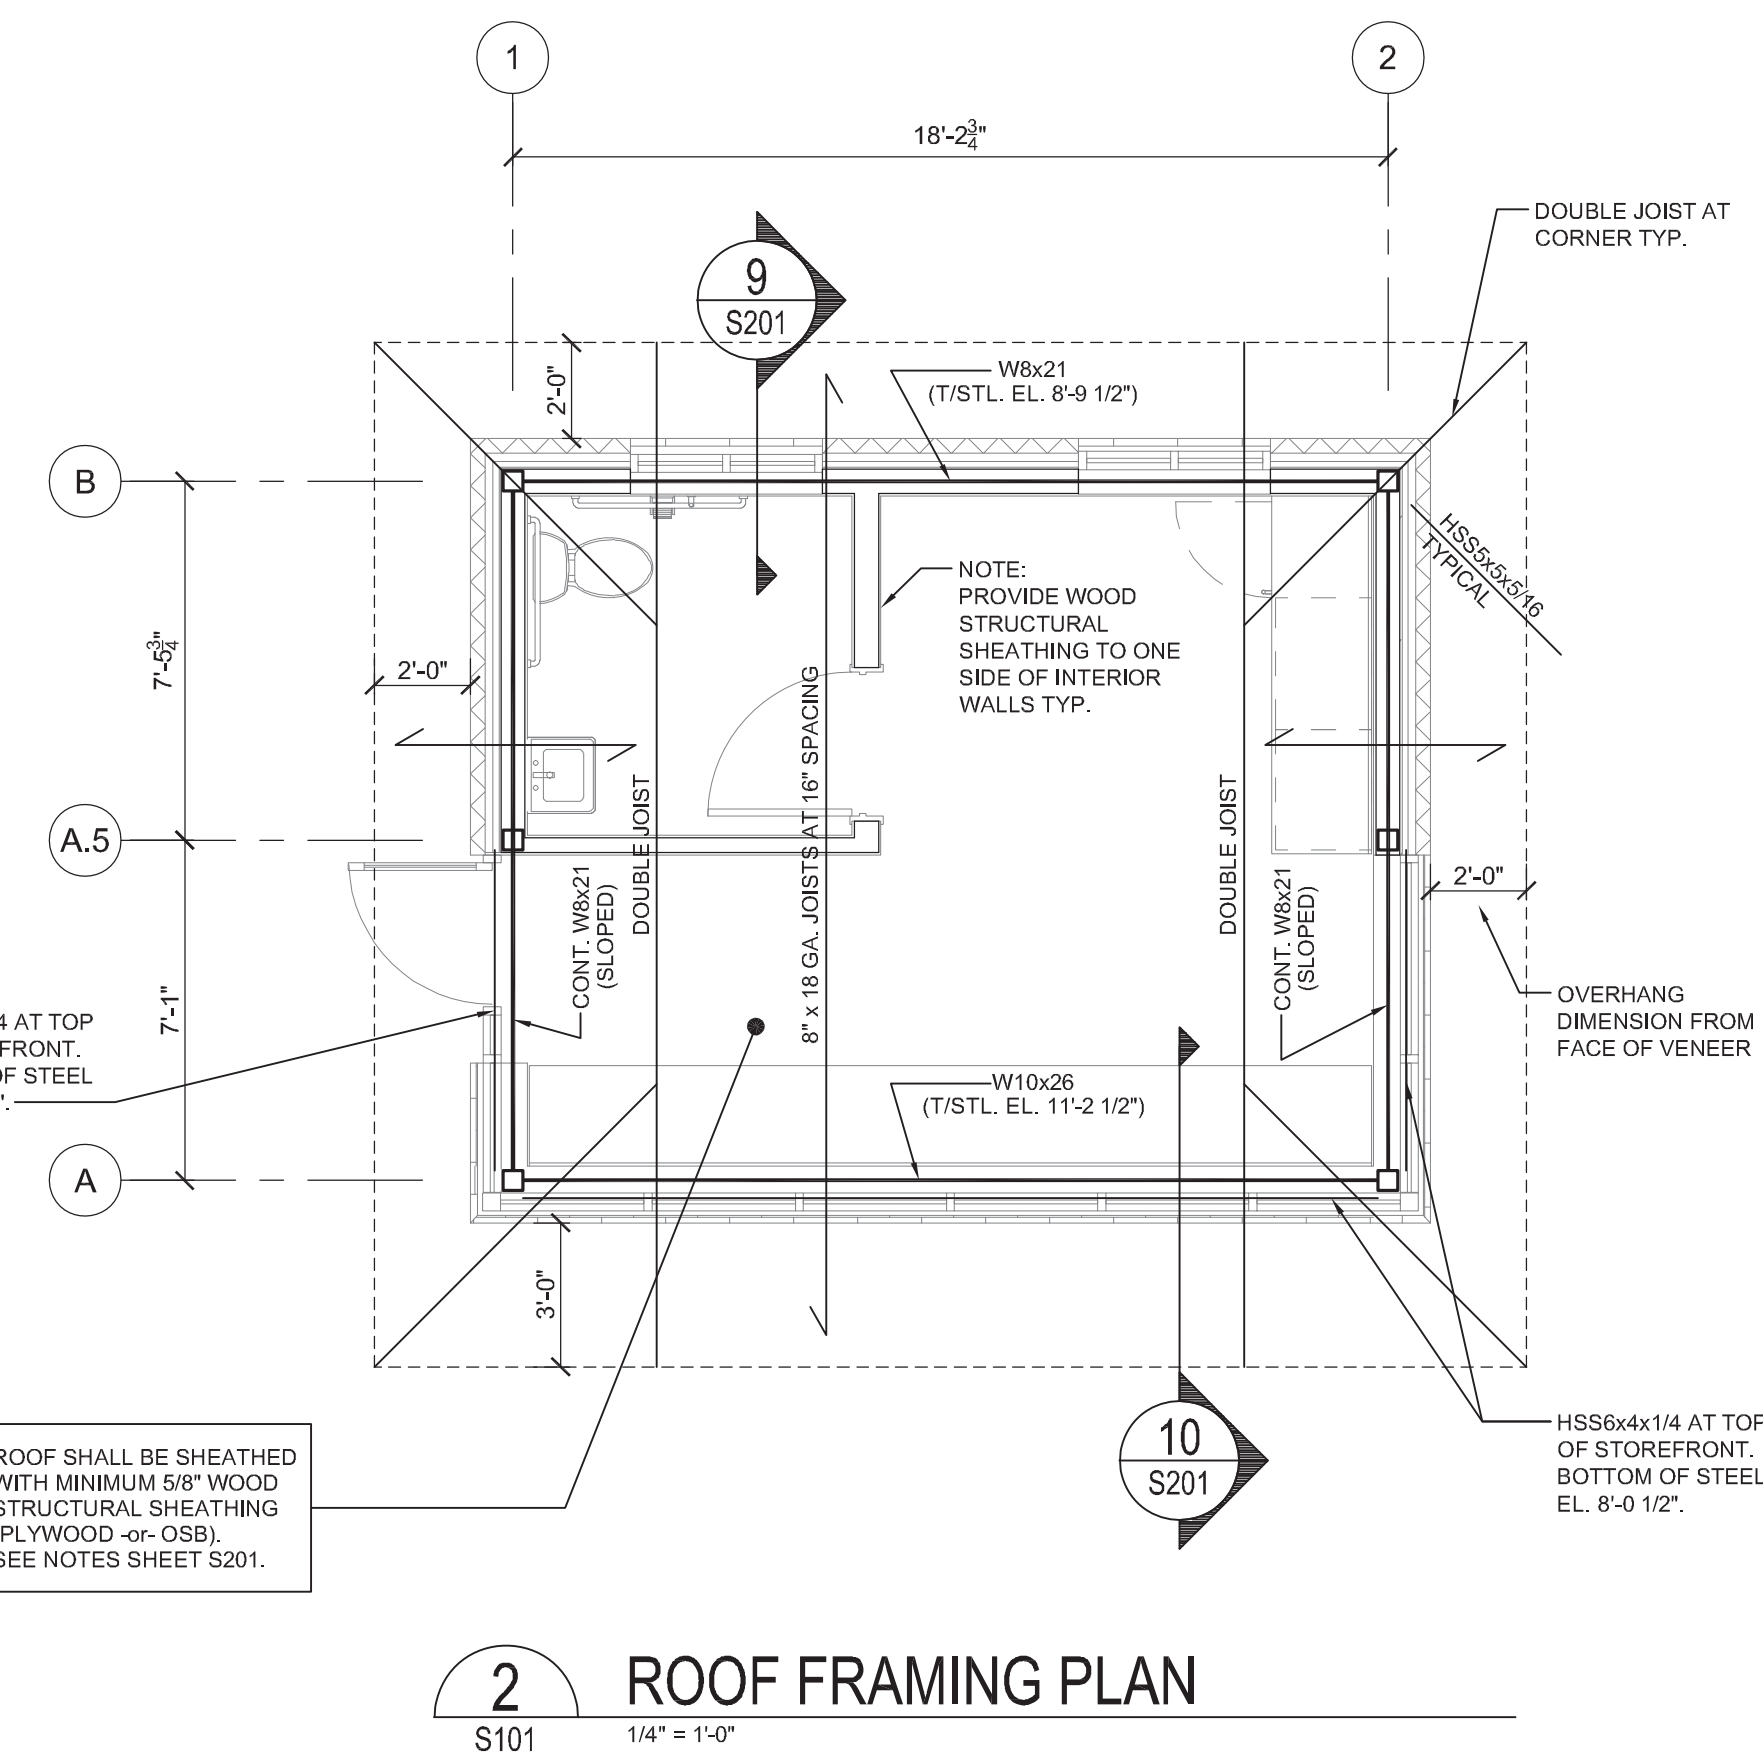


2 ROOF FRAMING PLAN  
S101 1/4" = 1'-0"



GONTRAM ARCHITECTURE, INC.

© COPYRIGHT 2023  
THESE DOCUMENTS ARE INSTRUMENTS OF SERVICE AND AS SUCH REMAIN THE PROPERTY OF THE ENGINEER. PUBLISH OR USE THEM ONLY WITH THE ENGINEER'S EXPRESSED WRITTEN APPROVAL.

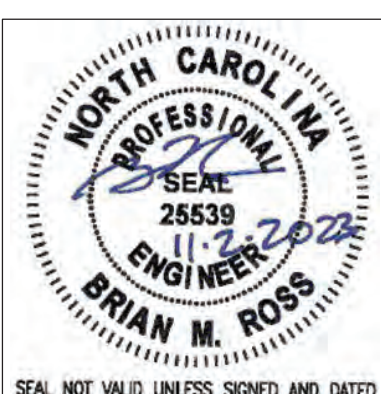

ROSS LINDEN ENGINEERS PC  
709 W. JONES STREET RALEIGH, NC 27603  
TEL 919.832.3680 FAX 919.832.3675  
WWW.ROSSLINDEN.COM  
NC LICENSE NO. C-2364

ATTENDANT BUILDING  
ASSEMBLY COURT SOLID WASTE  
CONVENIENCE CENTER  
575 ASSEMBLY COURT | FAYETTEVILLE NC 28306


PLOT DATE:  
11/2/2023  
ISSUED:  
11/2/2023  
FOR PERMIT

DRAWN BY:  
BR  
PROJECT NO.:  
C230704


APPROVED:  
SS/EG  
RECORD:

CONTENTS:  
FOUNDATION AND FRAMING PLANS


SHEET:  
S101

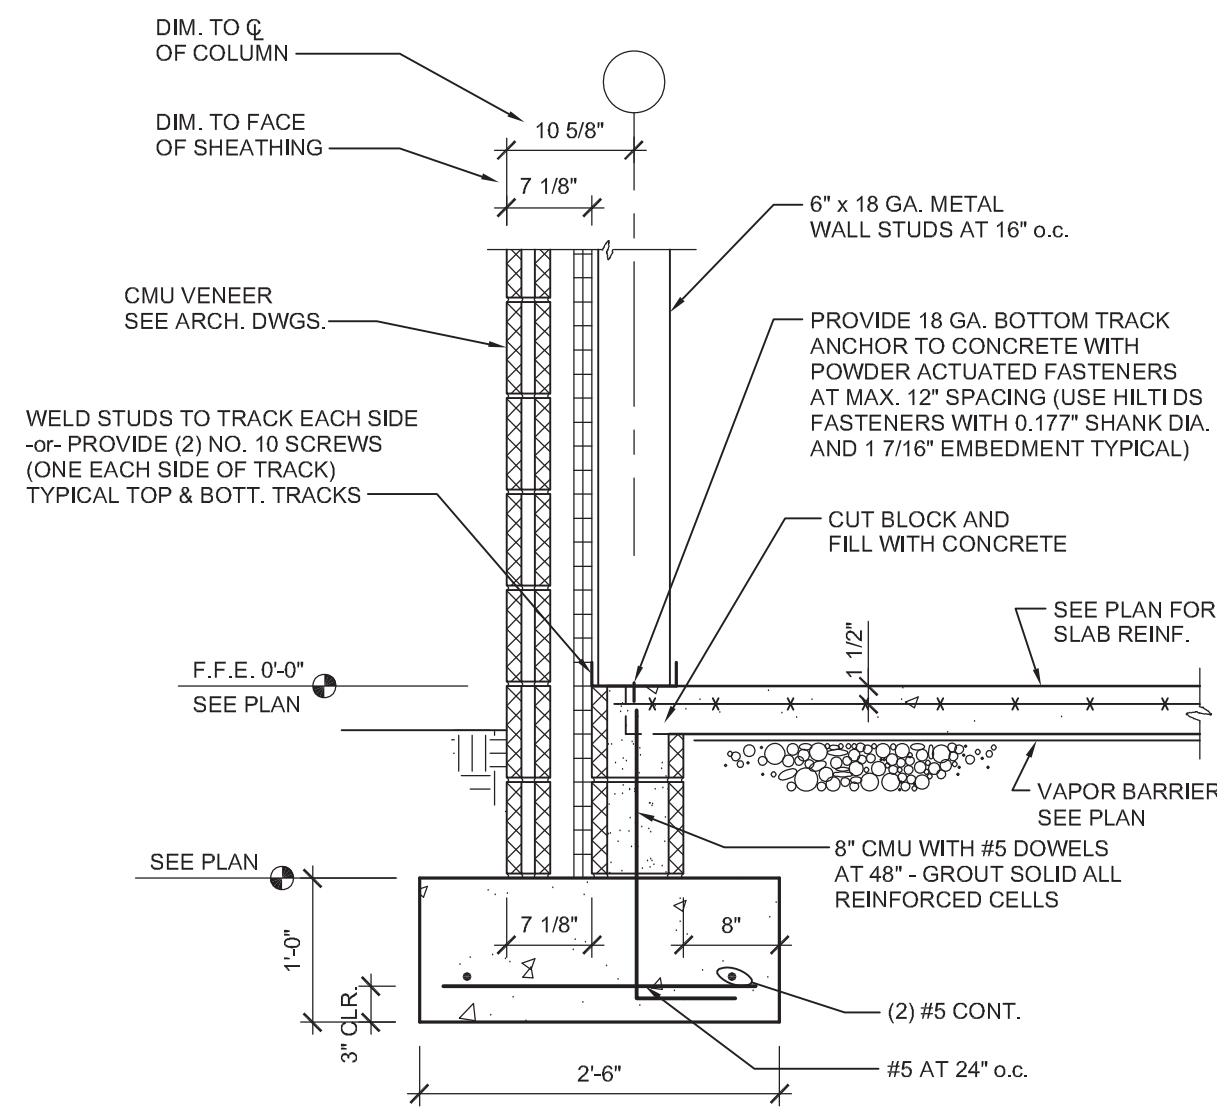


**1** DETAIL - PERIMETER FOOTING  
S201 3/4" = 1'-0"

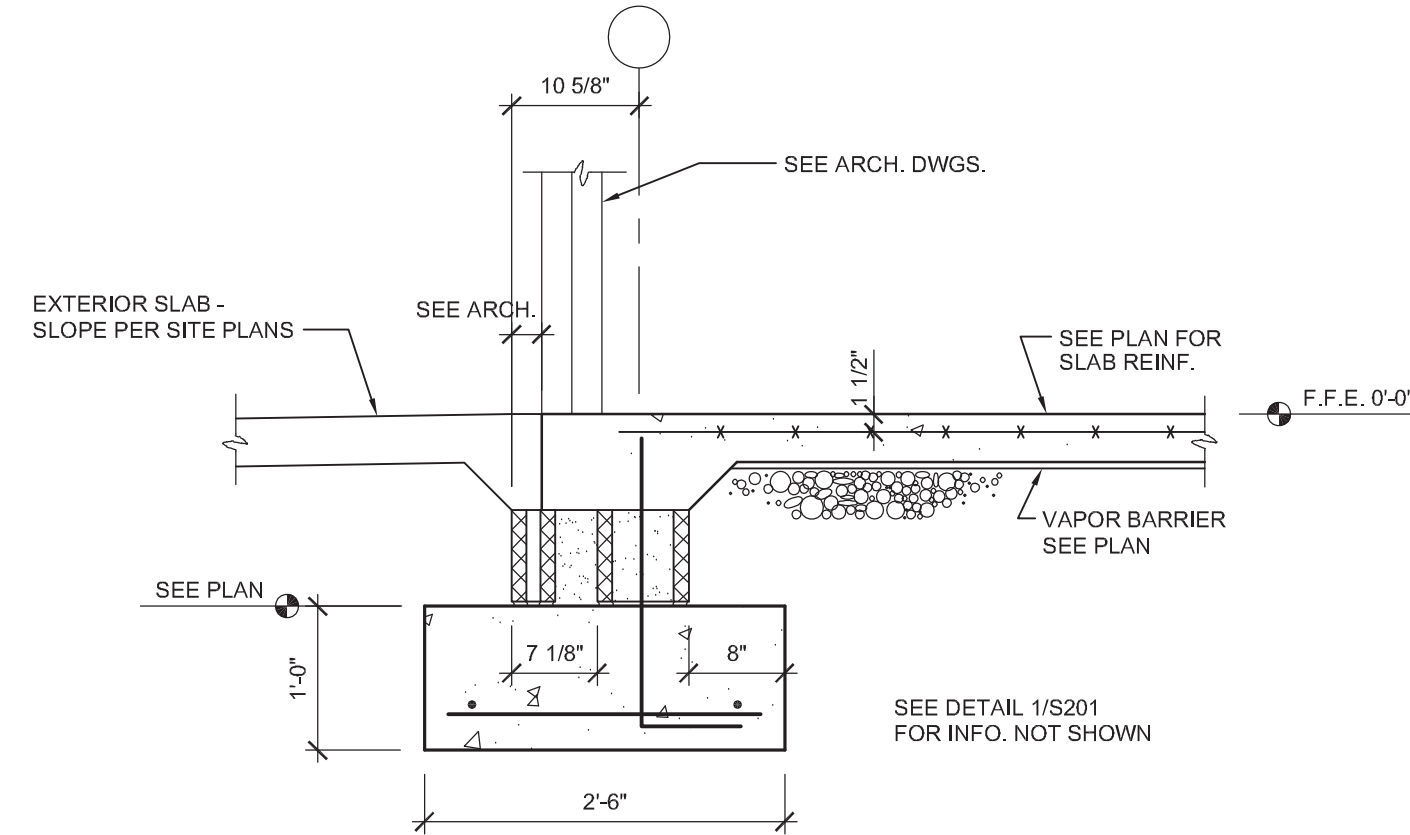


**2** DETAIL - SLAB EDGE AT DOORS  
S201 3/4" = 1'-0"

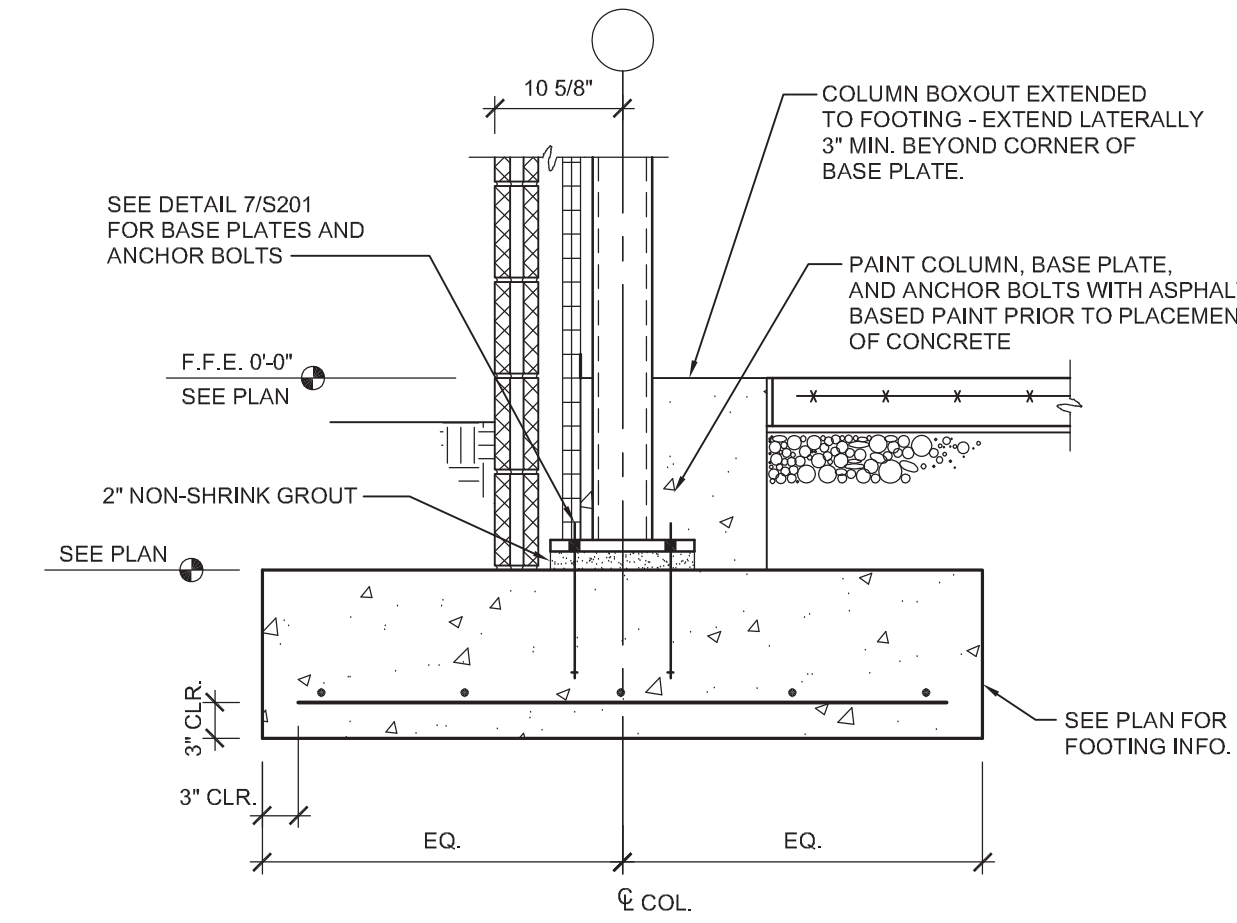


**3** DETAIL - COLUMN FOOTING  
S201 3/4" = 1'-0"

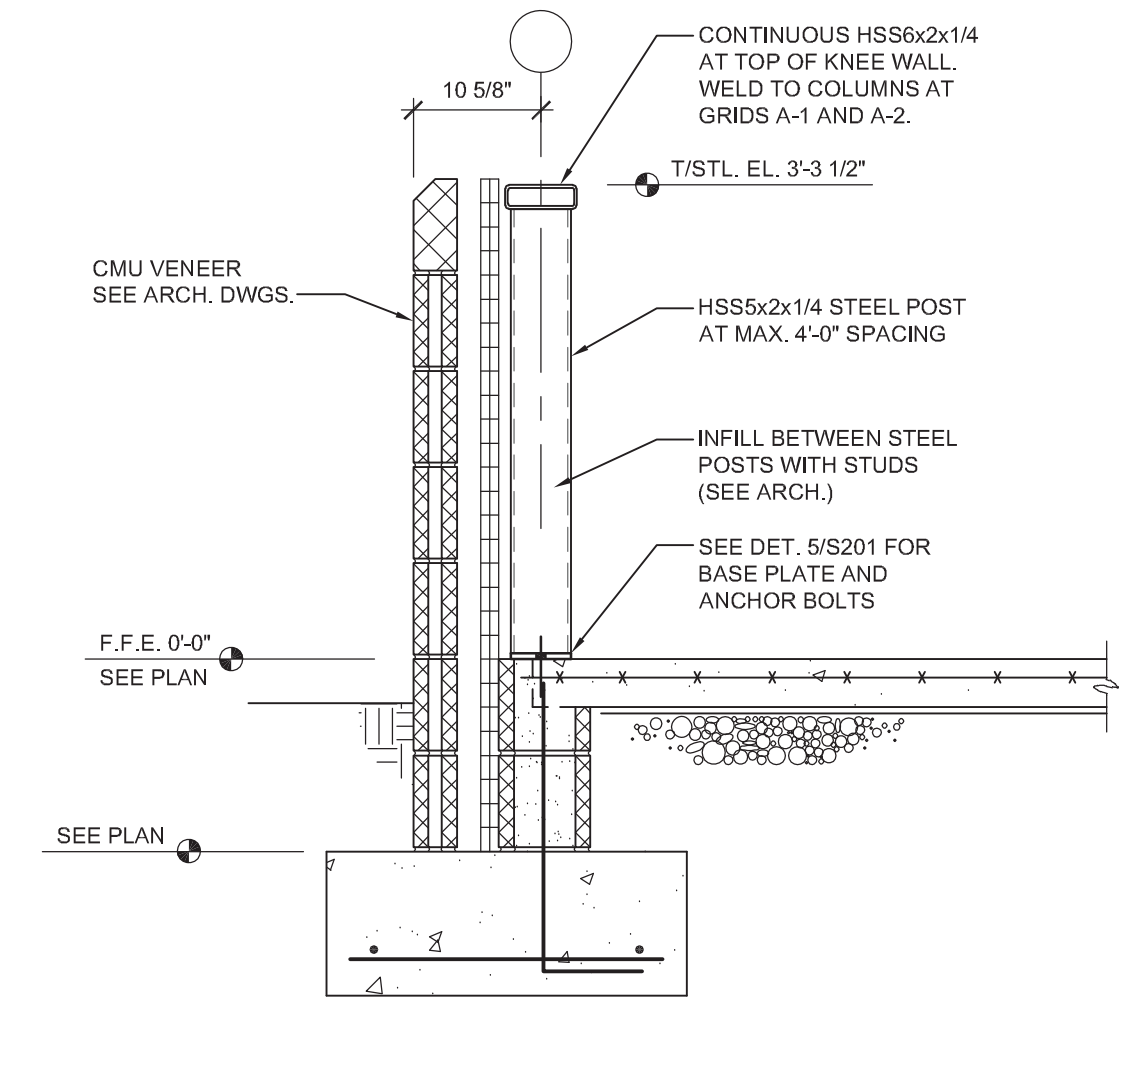


**4** DETAIL - KNEE WALL  
S201 3/4" = 1'-0"

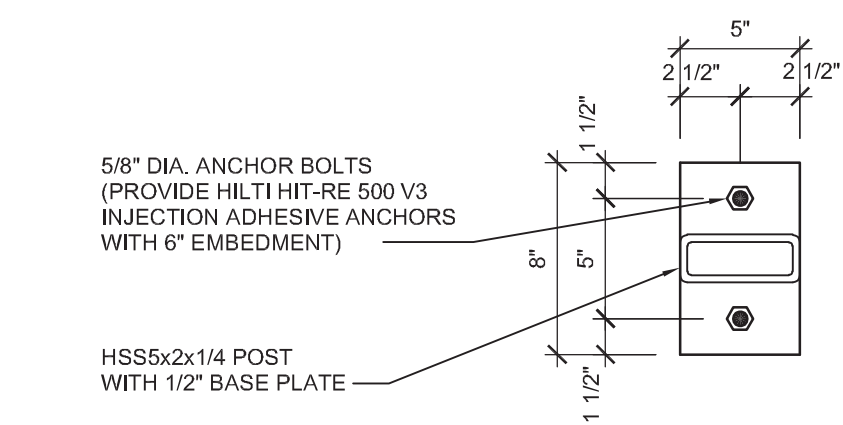


**5** POST BASE PLATE  
S201 1 1/2" = 1'-0"

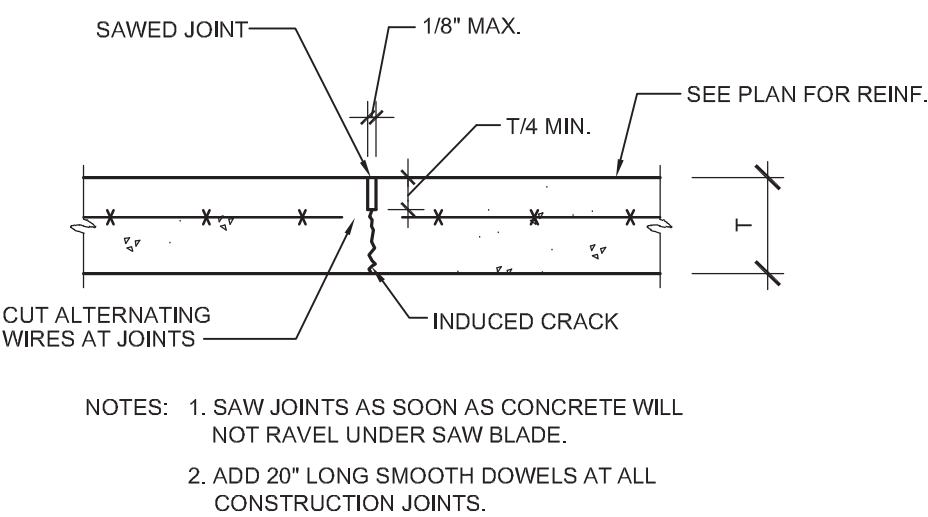


**6** DETAIL - TYP. SLAB CONTROL JOINT  
S201 1" = 1'-0"

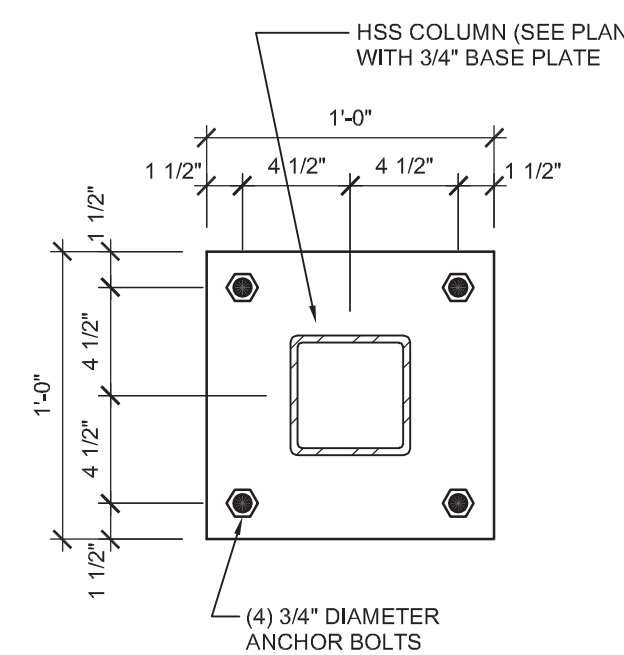


**7** BASE PLATE DETAIL  
S201 1 1/2" = 1'-0"

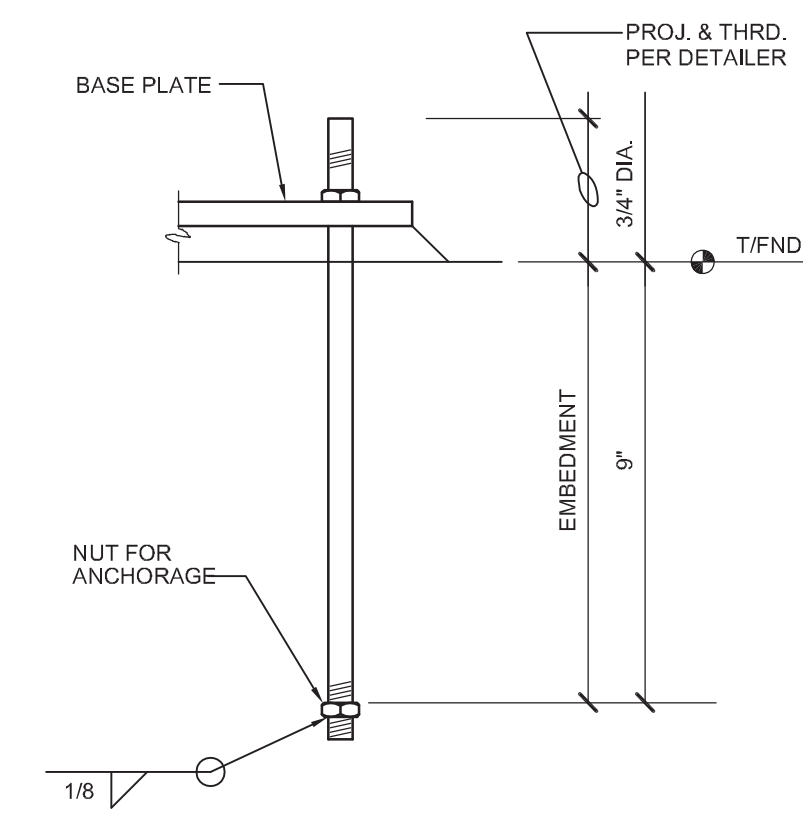

**8** TYP. ANCHOR BOLT DETAIL  
S201 NO SCALE

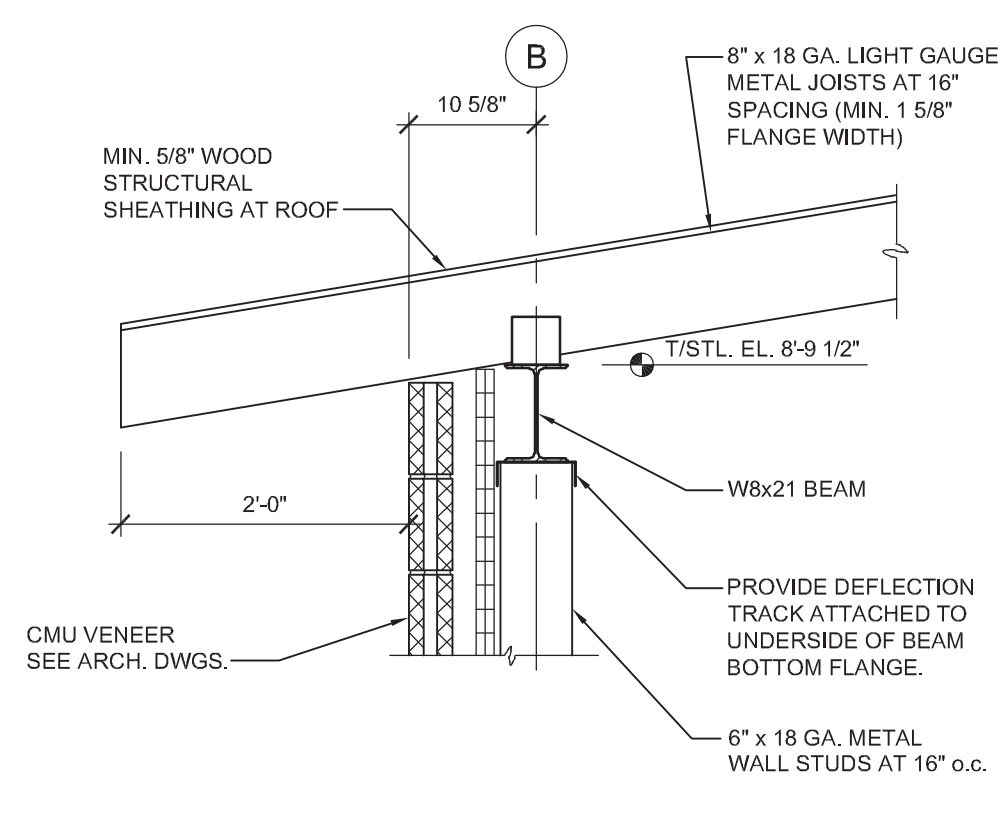

**9** FRAMING SECTION  
S201 3/4" = 1'-0"

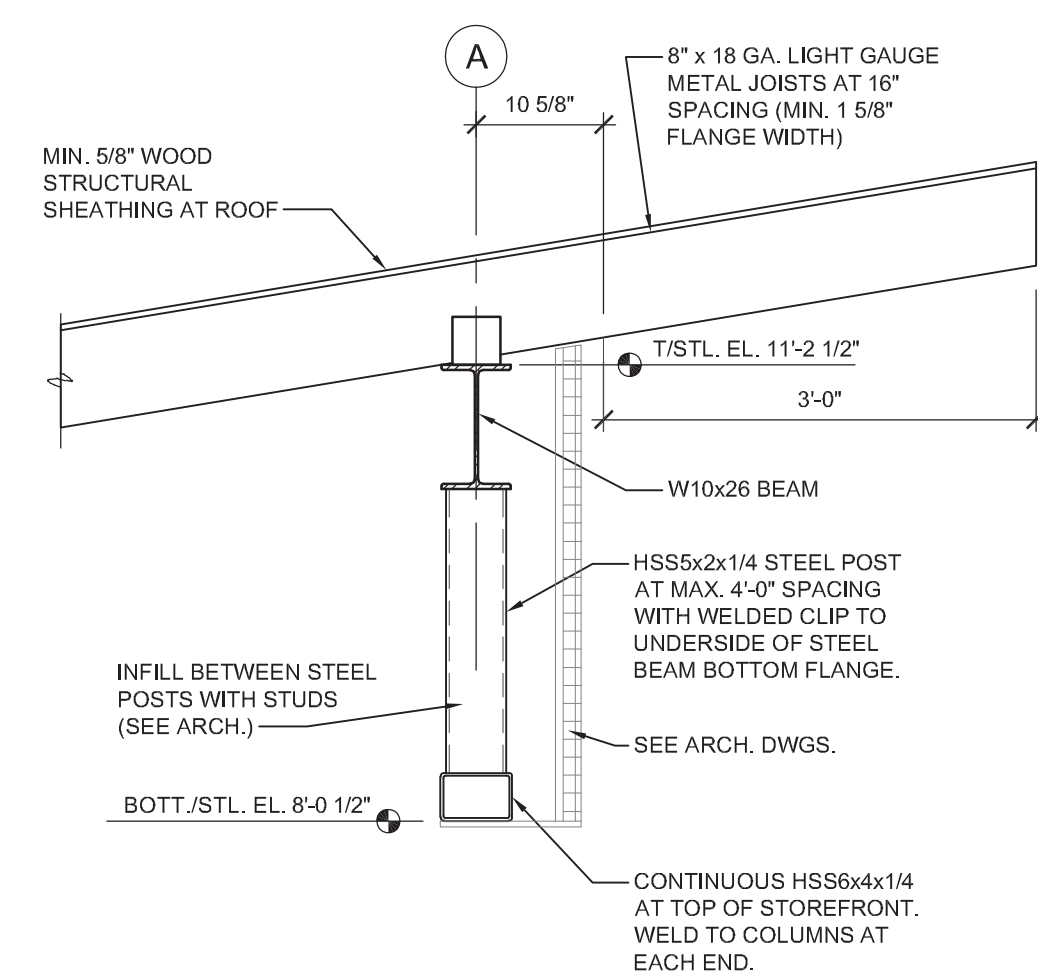


**10** FRAMING SECTION  
S201 3/4" = 1'-0"



**GONTRAM**  
ARCHITECTURE, INC.

© COPYRIGHT 2023  
THESE DOCUMENTS ARE INSTRUMENTS OF SERVICE AND AS SUCH REMAIN THE PROPERTY OF THE ENGINEER. PUBLISH OR USE THEM ONLY WITH THE ENGINEER'S EXPRESSED WRITTEN APPROVAL.

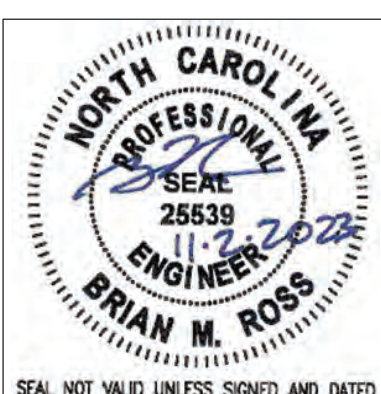

**ROSS LINDEN**  
ENGINEERS P.C.  
709 W. JONES STREET, RALEIGH, NC 27603  
TEL 919.832.3680 FAX 919.832.3675  
WWW.ROSSLINDEN.COM NC LICENSE NO. C-2316


**ATTENDANT BUILDING**  
**ASSEMBLY COURT SOLID WASTE**  
**CONVENIENCE CENTER**  
**575 ASSEMBLY COURT | FAYETTEVILLE NC 28306**

PLOT DATE:  
11/2/2023  
ISSUED:  
11/2/2023  
FOR PERMIT


DRAWN BY:  
BR  
APPROVED:  
SS/EG  
PROJECT NO.:  
C230704  
RECORD:

CONTENTS:  
SECTIONS AND  
DETAILS


SHEET:  
**S201**

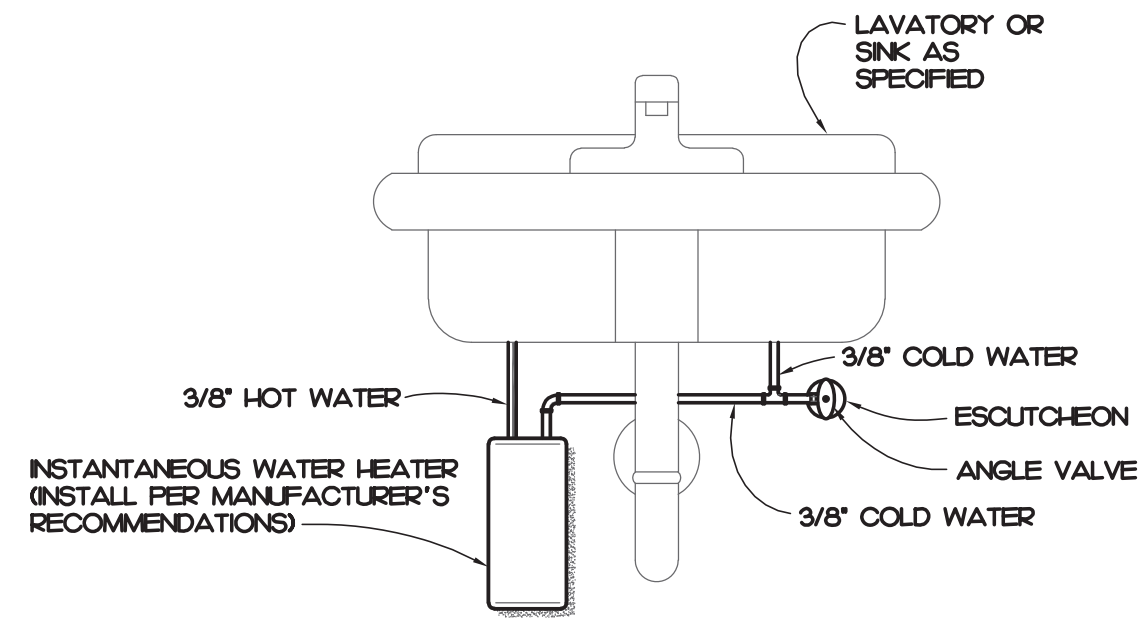


**5 WATER HEATER DETAIL**  
NOT TO SCALE

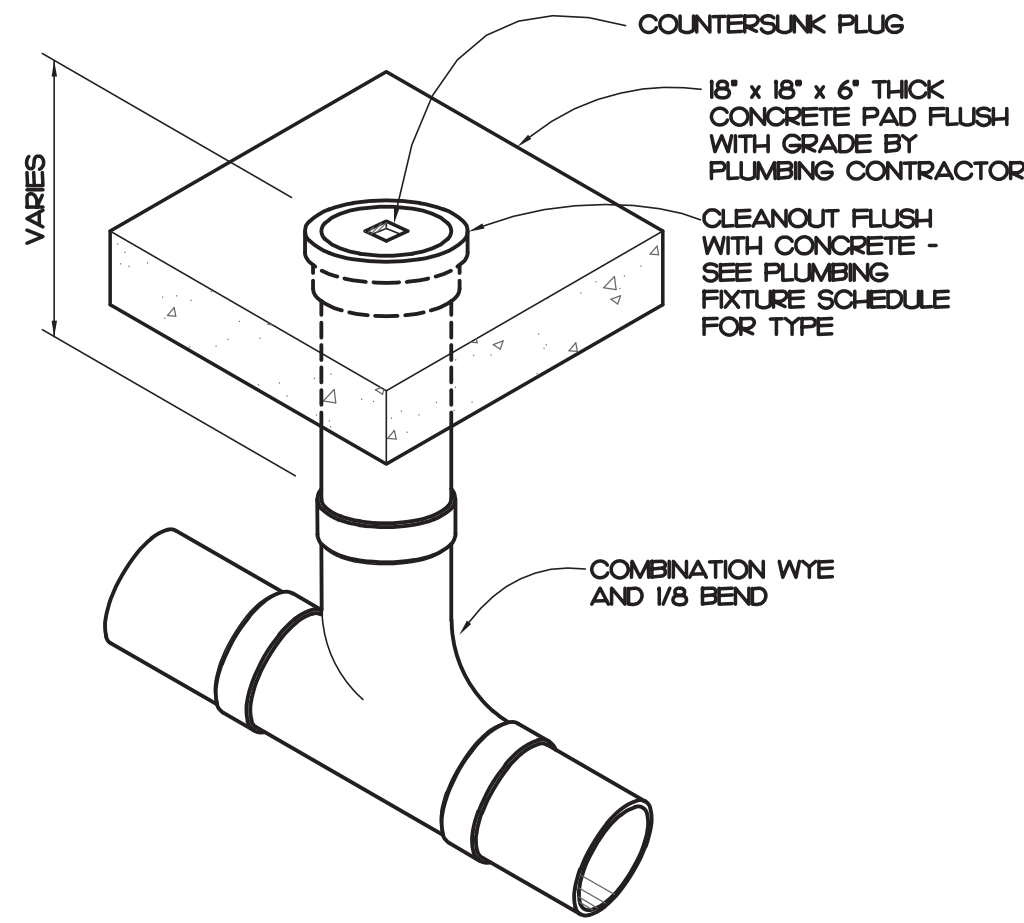

**6 CLEANOUT DETAIL**  
NOT TO SCALE

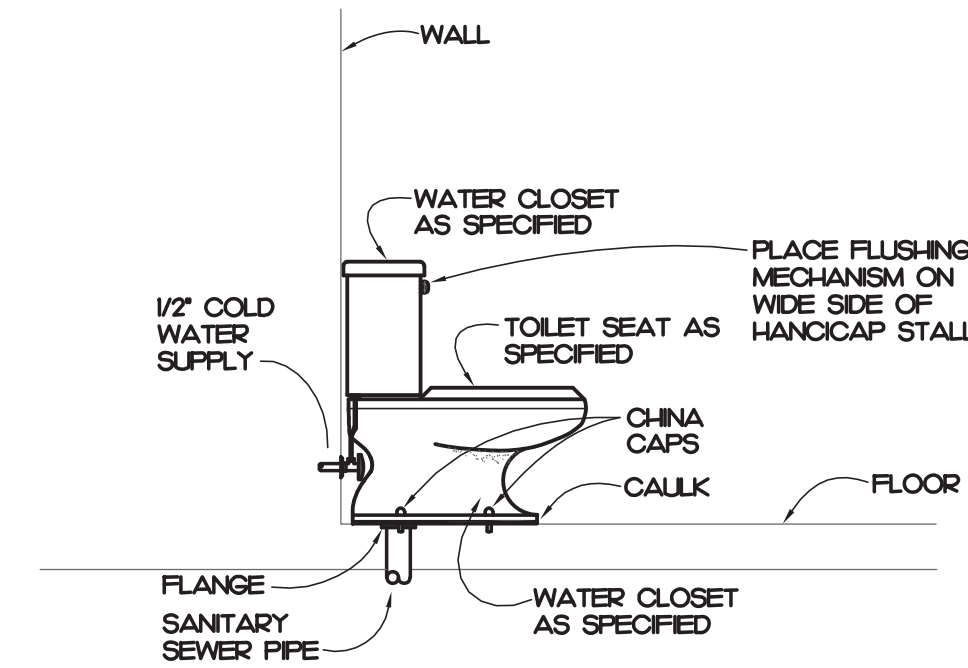

**4 WATER CLOSET DETAIL**  
NOT TO SCALE

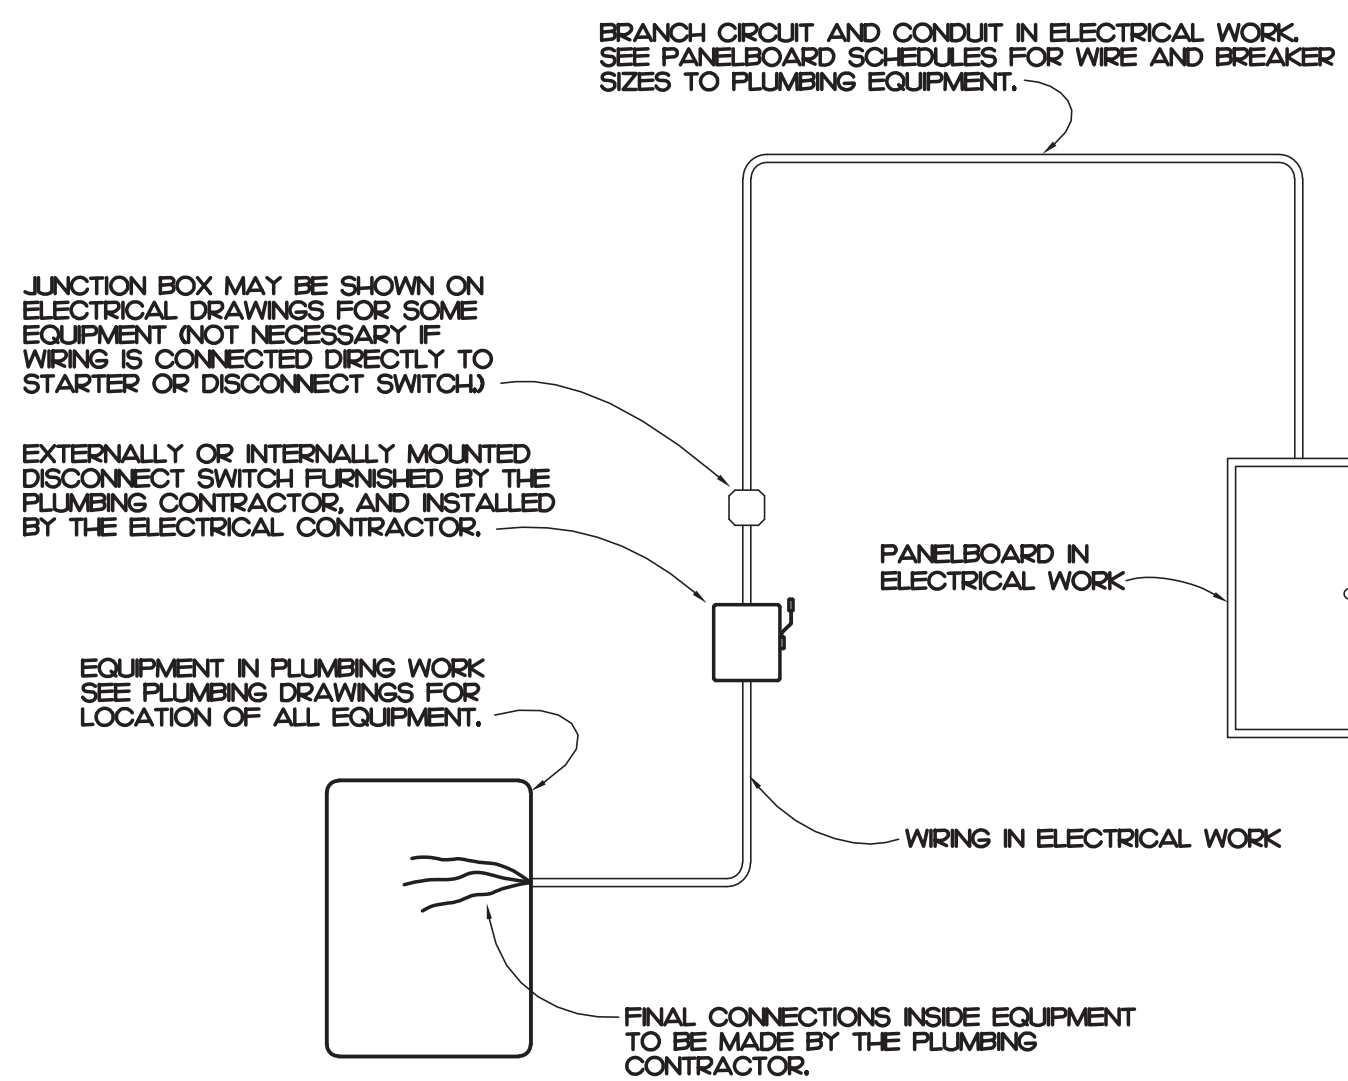

**3 TYPICAL WIRING DETAIL**  
NOT TO SCALE

**PLUMBING GENERAL NOTES**

- ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE LATEST EDITION OF THE STATE CODE, ALL LOCAL AND OTHER APPLICABLE CODES.
- ANY PERMITS AND INSPECTION FEES SHALL BE SECURED AND PAID FOR BY THE PLUMBING CONTRACTOR.
- ALL WORK SHALL BE PERFORMED BY EXPERIENCED AND SKILLED CRAFTSMAN. THE PLUMBING CONTRACTOR SHALL COORDINATE ALL OF HIS WORK WITH ALL OTHER CONTRACTORS.
- THE PLUMBING PLANS AND SPECIFICATIONS SHALL BE THOROUGHLY REVIEWED PRIOR TO PURCHASING MATERIALS AND INSTALLATION. ALL DISCREPANCIES OR INTERFERENCES SHALL BE BROUGHT TO THE ENGINEER'S ATTENTION.
- THESE PLANS ARE DIAGRAMMATIC AND MAY NOT SHOW MINOR DETAILS AND LOCATIONS. FOR DIMENSIONS, REFER TO THE ARCHITECTURAL PLANS.
- THE PLUMBING CONTRACTOR SHALL PROVIDE ALL OPENINGS REQUIRED FOR THE PLUMBING WORK. THE PATCHING SHALL BE BY THE PLUMBING CONTRACTOR AND FINISHING BY GENERAL CONTRACTOR.
- ALL PIPE, FITTINGS, FIXTURES, AND SOLDER TO BE LEAD FREE.
- WATER PIPING BELOW GRADE SHALL BE TYPE 1/2" COPPER (NO JOINTS BELOW GRADE) AND ABOVE GRADE TYPE 1" COPPER, SUPPORTED AS REQUIRED AND SHALL BE HYDROSTATICALLY TESTED FOR ONE HOUR AT 50 PSI. TEST TO COMPLY WITH ALL EPA STANDARDS. THE ENTIRE WATER DISTRIBUTION SYSTEM SHALL BE DISINFECTED PRIOR TO PLACING IN SERVICE.
- WATER PIPING LOCATED ABOVE CEILINGS AND IN EXTERIOR WALLS SHALL BE ROUTED ON HEATED SIDE OF CEILING INSULATION (UNDERSIDE) AND WALL INSULATION (INSIDE).
- ALL COLD AND HOT WATER PIPING SHALL BE INSULATED. INSULATE WASTE PIPING AS DESIGNATED ON PLUMBING DRAWINGS. INSULATION SHALL BE FIBERGLASS. EXPOSED PIPING TO BE WRAPPED WITH ALUMINUM JACKET.
- DO NOT SUPPORT PIPING FROM BAR JOIST BRIDGING AND/OR ROOF DECK.
- IF THE WATER PRESSURE EXCEEDS 80 PSI A PRESSURE REDUCING VALVE SHALL BE INSTALLED WHERE THE WATER ENTERS THE BUILDING.
- PLUMBING CONTRACTOR SHALL PROVIDE A DIELECTRIC UNION WHEN CONNECTING DISSIMILAR MATERIAL.
- WATER HEATERS SHALL HAVE AN EFFICIENCY MEETING REQUIREMENTS OF THE NORTH CAROLINA BUILDING CODE.
- THE PLUMBING CONTRACTOR SHALL BE RESPONSIBLE FOR ALL ELECTRICAL AND CONTROL CONNECTIONS TO THE EQUIPMENT FURNISHED UNDER HIS CONTRACT.
- SANITARY SEWER AND VENT PIPING SHALL BE SCHEDULE 40 PVC, CELLULAR CORE (FOAM CORE) IS NOT ALLOWED. SANITARY SEWER AND VENT PIPING SHALL BE GAS AND AIR TIGHT.
- THE PLUMBING CONTRACTOR SHALL COORDINATE ALL WORK WITH OTHER TRADES PRIOR TO INSTALLATION OF ANY WORK.
- THE PLUMBING CONTRACTOR SHALL REVIEW ALL UTILITY SITE PLANS FOR WORK BY OTHERS. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE HIS WORK WITH WORK BY OTHERS AND AVOID ALL CONFLICTS.
- LOCATIONS OF UTILITIES (WASTE AND WATER PIPING, ETC.) PROVIDED BY OTHERS, THAT ARE TO BE CONNECTED TO ARE ASSUMED. IT SHALL BE THE RESPONSIBILITY OF THE PLUMBING CONTRACTOR TO VERIFY THESE LOCATIONS AND MAKE FINAL CONNECTIONS AS REQUIRED.
- ALL VENT PIPING THROUGH THE ROOF SHALL BE A MINIMUM OF 5'-0" FROM ALL MAKE-UP AIR INLETS OR A MINIMUM OF 2'-0" ABOVE THE TOP OF ALL MAKE-UP AIR INLETS. VENTS THROUGH ROOF ARE TO BE ON REAR OF BUILDING.
- SEE ARCHITECTURAL DRAWINGS FOR PLUMBING MINIMUM FACILITY CALCULATIONS.
- THE PLUMBING CONTRACTOR SHALL VERIFY BUILDING FLOOR ELEVATION IS ABOVE MAN-HOLE RIM ELEVATION OR PROVIDE A BACKWATER VALVE AS REQUIRED.
- THE PLUMBING CONTRACTOR SHALL PROVIDE THE ENGINEER WITH A SET OF AS-BUILT DRAWINGS UPON COMPLETION OF PROJECT.

**PLUMBING SYMBOL LEGEND**

SYMBOL	DESCRIPTION
	COLD WATER PIPING
	COLD WATER PIPING BELOW FINISHED FLOOR
	WATER PIPING TURNED DOWN
	WATER PIPING TURNED UP
	PIPING SIDE CONNECTION
	SANITARY SEWER / WASTE PIPING
	SANITARY SEWER / WASTE PIPING DIRECTION OF FLOW
	VENT PIPING
	VENT PIPE UP
	PLUMBING FIXTURE PROVIDED AND INSTALLED BY PLUMBING CONTRACTOR
	FLOOR CLEANOUT
	VENT THRU ROOF

**PLUMBING FIXTURE SCHEDULE**

SYMBOL / IMAGE	DESCRIPTION	3 - EQUALS				PIPING CONNECTIONS				
		MANUFACTURER	MODEL NUMBER	MANUFACTURER	MODEL NUMBER	MANUFACTURER	MODEL NUMBER	COLD WATER	HOT WATER	SANITARY SEWER
	EXTERIOR CLEANOUT	ZURN	Z-1449-BP	WATTS	CO-380-34B	JR SMITH	4283	-	-	SEE PLUMBING DRAWINGS
	CLEANOUT FERRULE WITH CAST IRON BODY, WITH GAS AND WATERTIGHT BRONZE PLUG, MOUNT IN CONCRETE.									
	LAVATORY	KOHLER	K-2861-O	AMERICAN STANDARD	0355.012	ZURN	Z5834			
	FAUCET	DELTA	523LF-HGMDF	CHICAGO FAUCETS	2200-4	MOEN	6470			
	TRAP	McGUIRE	8902	DEARBORN BRASS	7021	KOHLER	K-8999			2"
	SUPPLY	McGUIRE	85LK	BRASS CRAFT	R992AC	KOHLER	K-7605-P-CP	1/2"	1/2"	
	WALL HUNG LAVATORY SHALL BE MADE OF CAST IRON WITH A WHITE FINISH, HAVE 4" CENTERS, AN OVERFLOW, SEE ARCHITECTURAL DRAWINGS FOR MOUNTING HEIGHT. DECK MOUNTED FAUCET SHALL BE CHROME FINISH, SINGLE LEVER, 4" CENTERS, WITH 3/8" COPPER SUPPLY TUBE INLETS, AND PROVIDED WITH AN AERATOR. P-TRAP SUPPLY KIT SHALL INCLUDE CHROME PLATED BRASS STOPS WITH THREADED CONNECTIONS, FULL TURN BRASS STEM, REDUCER, AND FLANGE. INLET SHALL BE 3/8" IPS, OUTLET SHALL BE 3/8" IPS. P-TRAP SHALL BE CHROME PLATED CAST BRASS BODY WITH CLEANOUT, CAST BRASS ELBOW AND CAST BRASS SLIP NUT, AND FLANGE. PROVIDE WITH OFFSET DRAIN, TRUBERO LAV SHIELD, AND WATER TEMPERATURE LIMITING DEVICE THAT CONFORMS TO ASSE 1070 OR CSA B253.									
	WATER CLOSET	KOHLER	K-3979	TOTO	CS1744SL	AMERICAN STANDARD	25AA.004.020			4"
	SEAT	BEMIS	K655SC	KOHLER	K-4670-C-O	CHURCH				
	SUPPLY	BRASSCRAFT	CS40DLC	KOHLER	K-7638	McGUIRE	185	1/2"	-	
	16 GPF TOILET SHALL BE MADE OF VITREOUS CHINA WITH A WHITE FINISH AND A 12" ROUGH-IN. TOILET SHALL INCLUDE POLISHED CHROME TRIP LEVER. SEAT SHALL BE EXTRA HEAVY WEIGHT SOLID PLASTIC WITH OPEN FRONT LESS COVER FOR ELONGATED BOWL. SUPPLY KIT SHALL INCLUDE CHROME PLATED BRASS STOPS, FULL TURN BRASS STEM AND FLANGE. INLET SHALL BE 3/8" IPS, OUTLET SHALL BE 3/8" IPS. THE FLUSHING LEVER MECHANISM SHALL BE ON THE WIDE SIDE OF THE STALL.									
	WATER HEATER	EEMAX	SP2412					3/8"	3/8"	
	ELECTRIC INSTANTANEOUS WATER HEATER SHALL HAVE AN ELECTRIC INPUT OF 24 KW AT 120 VOLT, SINGLE PHASE. WIRING BY LICENSED ELECTRICAL CONTRACTOR.									


**PLUMBING SCHEDULE NOTES AND LEGEND:**

- THE PLUMBING CONTRACTOR MAY SUBSTITUTE FIXTURES WITH OWNERS' APPROVAL.
  - SUBMIT CUT SHEETS FOR ALL PROPOSED FIXTURES TO ARCHITECT PRIOR TO BIDDING.
  - PROVIDE VACUUM BREAKER ON ALL EQUIPMENT REQUIRING PLUMBING.
  - REFER TO MANUFACTURERS WEB SITE FOR CUT SHEETS AND DATA ON THE FIXTURES AND APPURTENANCES USED IN THIS SCHEDULE.
- ADA COMPLIANT  
 ELECTRICAL POWER  
 GAS FIRED


**PLUMBING KEY NOTES**

- 3/4" COLD WATER PIPE TO BE LOCATED BELOW FINISHED GRADE. PLUMBING CONTRACTOR'S WORK BEGINS 5'-0" OUTSIDE BUILDING. SEE SITE PLAN FOR CONTINUATION. SEE SITE PLAN FOR BACKFLOW.
- MAIN SHUT OFF VALVE IN WALL. PROVIDE WITH ACCESS PANEL.
- WATER PIPING ABOVE FINISHED CEILING. COORDINATE LOCATION WITH MECHANICAL AND ELECTRICAL CONTRACTOR'S.
- 4" SANITARY SEWER PIPE TO BE LOCATED BELOW FINISHED GRADE. PLUMBING CONTRACTOR'S WORK EXTENDS 5'-0" OUTSIDE BUILDING. SEE SITE PLAN FOR CONTINUATION.
- INVERT ELEVATION IS TO BE 175' BELOW FINISHED FLOOR.
- ELECTRICAL EQUIPMENT BY ELECTRICAL CONTRACTOR.

ALL VENT PIPING IS TO BE 2" UNLESS NOTED OTHERWISE.

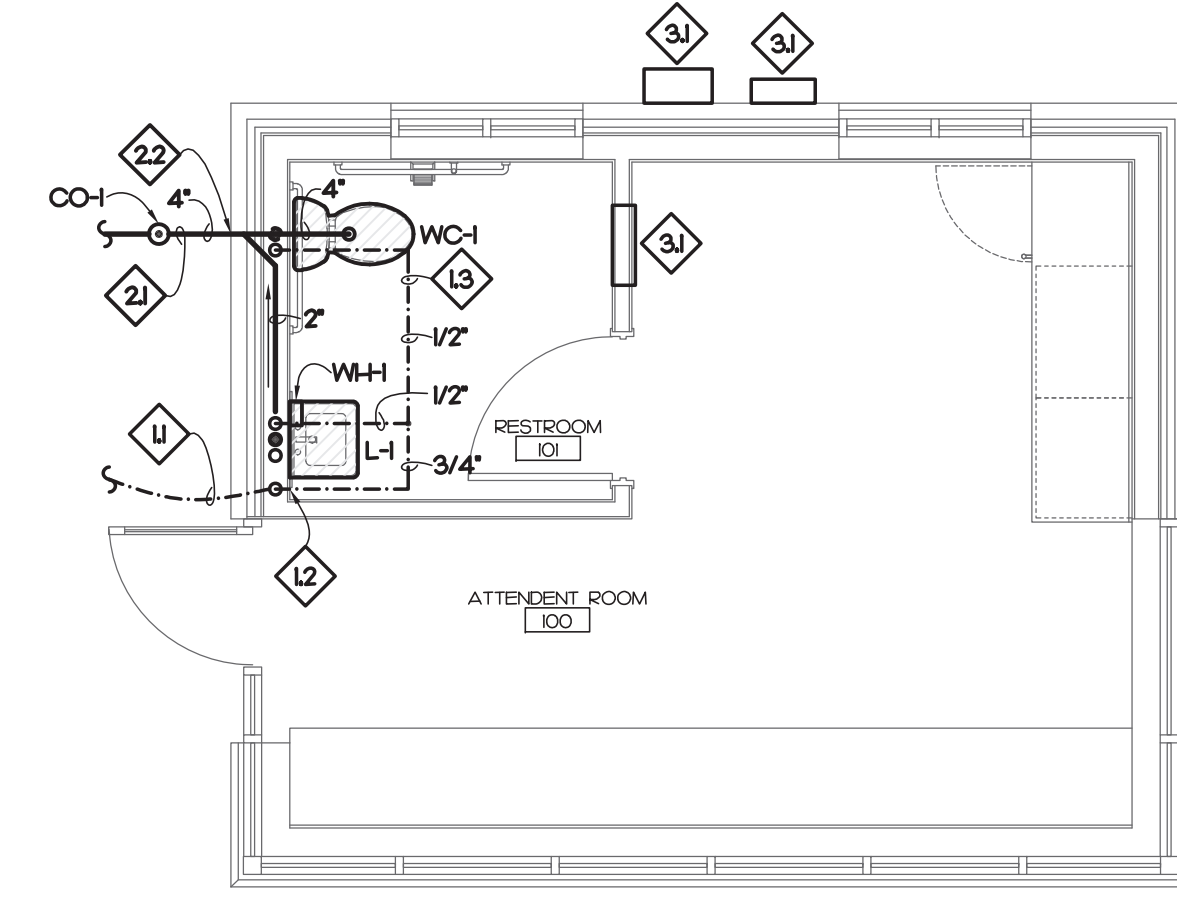

**1 PLUMBING PLAN**  
SCALE: 1/4" = 1'-0"

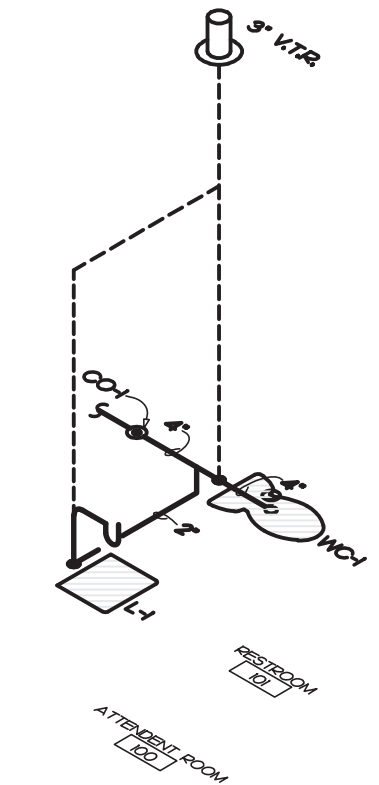

**2 WASTE RISER PLAN**  
NOT TO SCALE




**GONTRAM ARCHITECTURE, INC.**

5100 UNICION DRIVE, SUITE 103  
WAKE FOREST, NC 27587  
PHONE: 919.876.5331  
eddie@gontramarchitecture.com  
www.gontramarchitecture.com

© COPYRIGHT 2023  
THESE DOCUMENTS ARE INSTRUMENTS OF SERVICE AND AS SUCH REMAIN THE PROPERTY OF THE ARCHITECT. PERMISSION TO USE THEM ONLY WITH THE ARCHITECT'S EXPRESSED WRITTEN APPROVAL.

**ATLANTEC ENGINEERS, PA**  
322 BLUE RIDGE ROAD, SUITE 103  
RALEIGH, NC 27602  
919 571-1111 2302

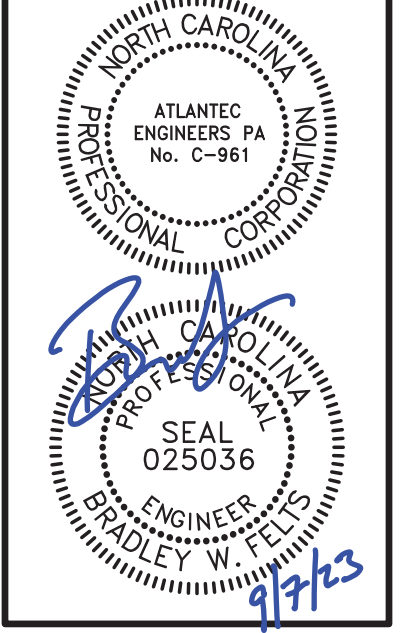

ATTENDANT BUILDING  
ASSEMBLY COURT SOLID WASTE  
CONVENIENCE CENTER  
575 ASSEMBLY COURT | FAYETTEVILLE NC 28306

PLOT DATE:  
09/08/2023  
ISSUED:  
09/08/2023  
FOR CONSTRUCTION  
REVISION:  
  
DRAWN BY:  
NGB  
PROJECT NO.:  
22003  
CONTENTS:  
PLUMBING PLAN

SHEET:  
**P-01**  
OF 1

MECHANICAL SYSTEMS, SERVICE SYSTEMS AND EQUIPMENT METHOD OF COMPLIANCE

PRESCRIPTIVE  ENERGY COST BUDGET

THERMAL ZONE 3A

EXTERIOR DESIGN CONDITIONS  
 winter dry bulb: 16°F  
 summer dry bulb: 93°F  
 relative humidity: 46%

INTERIOR DESIGN CONDITIONS  
 winter dry bulb: 70°F  
 summer dry bulb: 74°F  
 relative humidity: 50%

BUILDING HEATING LOAD: BLOCK LOAD = 10.2 MBH  
 BUILDING COOLING LOAD: BLOCK LOAD = 14.0 MBH (12 TONS)

MECHANICAL SPACING CONDITIONING SYSTEM

Unitary:  
 description of unit:  
 heating efficiency:  
 cooling efficiency:  
 heat output of unit:  
 cooling output of unit: } SEE SCHEDULES ON THIS SHEET

Boiler: NA  
 total boiler capacity, if oversized state reason.

Chiller: NA  
 total chiller capacity, if oversized state reason.

LIST EQUIPMENT EFFICIENCIES: SEE SCHEDULES ON THIS SHEET

EQUIPMENT SCHEDULES WITH MOTORS (MECHANICAL SYSTEMS)  
 motor horsepower:  
 number of phases:  
 minimum efficiency:  
 motor type:  
 # of poles: } SEE SCHEDULES ON THIS SHEET


DESIGNER STATEMENT

To the best of my knowledge and belief, the design of this building complies with the mechanical systems, service systems and equipment requirements of the North Carolina State Energy Code.


SIGNED: *Bradley W. Felts*

NAME: Bradley W. Felts, PE

TITLE: Professional Engineer

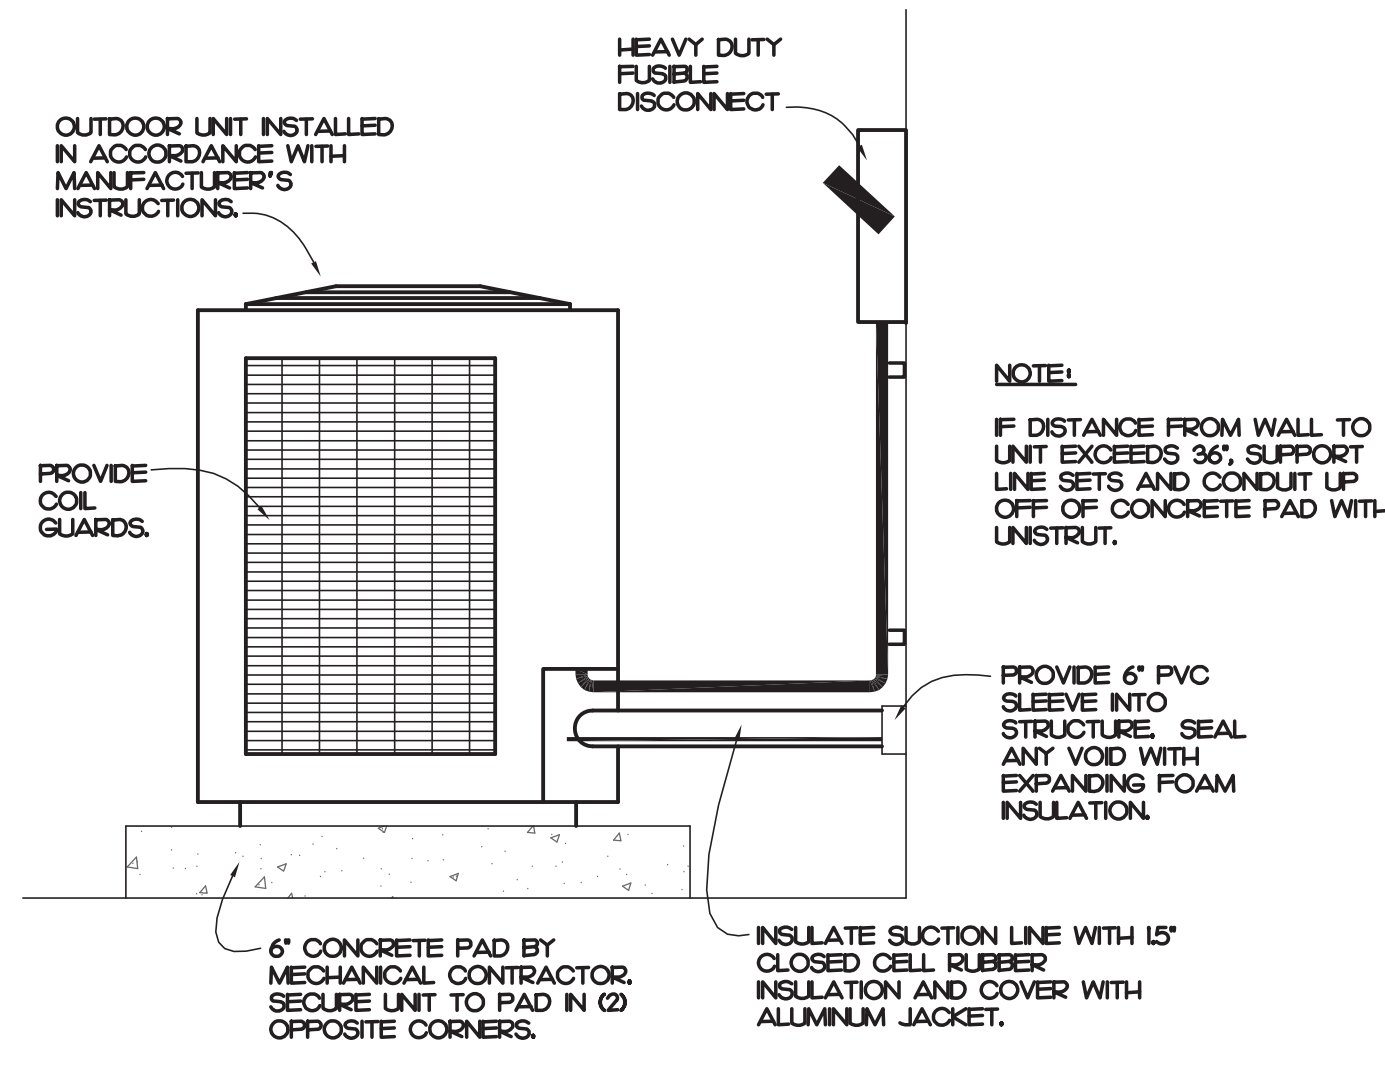

2 OUTDOOR UNIT DETAIL  
 NOT TO SCALE

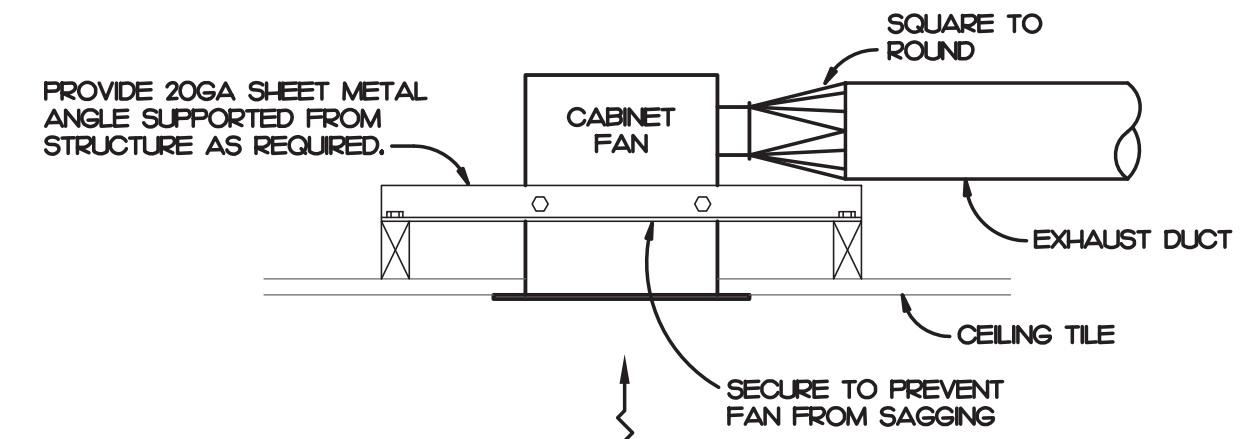

3 CABINET FAN DETAIL  
 NOT TO SCALE

**EXHAUST FAN SCHEDULE**

MARK	BASIS OF DESIGN	SERVICE	TYPE	CFM	RPM	HP/AMPS	S.P.	POWER	NOTES
EF-	COOK. GC-140		CABINET FAN	105	1500	67 Watts	0.25'	120/1	1-3

NOTES:  
 1. PROVIDE WITH DISCONNECT SWITCH.  
 2. PROVIDE WITH BACKDRAFT DAMPER.  
 3. CONTROL VIA LIGHT SWITCH BY E.C.

**GENERAL NOTES**

- ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE LATEST EDITION OF THE STATE CODE, ALL LOCAL AND OTHER APPLICABLE CODES.
- ANY PERMITS AND INSPECTION FEES SHALL BE SECURED AND PAID FOR BY THE MECHANICAL CONTRACTOR (M.C.) ALL OF HIS WORK WITH ALL OTHER CONTRACTORS.
- ALL WORK SHALL BE PERFORMED BY EXPERIENCED AND SKILLED CRAFTSMAN. THE M.C. SHALL COORDINATE ALL OF HIS WORK WITH ALL OTHER CONTRACTORS.
- THE MECHANICAL PLANS AND SPECIFICATIONS SHALL BE THOROUGHLY REVIEWED PRIOR TO PURCHASING MATERIALS AND INSTALLATION. ALL DISCREPANCIES OR INTERFERENCES SHALL BE BROUGHT TO THE ENGINEER'S ATTENTION.
- THESE PLANS ARE DIAGRAMMATIC AND MAY NOT SHOW MINOR DETAILS AND LOCATIONS. FOR DIMENSIONS, REFER TO THE ARCHITECTURAL PLANS.
- THE M.C. SHALL BE RESPONSIBLE FOR ALL ELECTRICAL STARTERS, INTERLOCKS, CONTROL WIRING. THE ELECTRICAL CONTRACTOR SHALL PROVIDE POWER WIRING, CONDUIT FROM THE DISCONNECT TO M.C. EQUIPMENT. THE M.C. SHALL BE RESPONSIBLE FOR ALL FINAL CONNECTION TO HIS EQUIPMENT.
- ALL THERMOSTATS, WIRING AND CONDUIT ARE TO BE FURNISHED BY THE M.C. MOUNT THERMOSTATS 4'-0" ABOVE THE FLOOR, UNLESS OTHERWISE NOTED.
- THE M.C. SHALL INSURE THAT ALL MECHANICAL EQUIPMENT INSTALLED UNDER HIS CONTRACT SHALL OPERATE FREE OF OBJECTIONABLE NOISE AND VIBRATION.
- THE M.C. SHALL KEEP THE PREMISES CLEAR OF DEBRIS FROM HIS WORK DURING CONSTRUCTION AND LEAVE THE AREA AND BUILDING CLEAN AT THE COMPLETION OF HIS WORK. HE SHALL ALSO LEAVE CLEAN ALL EXPOSED EQUIPMENT IN HIS CONTRACT.
- ALL DUCTWORK SIZES SHOWN ARE ACTUAL SHEET METAL DIMENSIONS. EXTERNALLY WRAP ALL DUCT WITH 3" FOIL-BACKED INSULATION FOR A MINIMUM OF R-8.
- MECHANICAL CONTRACTOR SHALL WORK WITH TEST AND BALANCE CONTRACTOR TO REMEDY ANY DIFFERENCES TO INCLUDE FAN DRIVE CHANGES, INSTALLATION OF DAMPERS OR OTHER MINOR DUCT MODIFICATIONS TO PROVIDE AIRFLOW TO WITHIN +/- 10% OF THE DESIGN VALUES LISTED ON THESE PLANS.
- THE AIR HANDLING UNIT SHALL OPERATE AT ALL TIMES DURING OCCUPIED HOURS.
- THE MECHANICAL CONTRACTOR SHALL PROVIDE THE ENGINEER WITH A SET OF AS-BUILT DRAWINGS UPON COMPLETION OF JOB.
- THE MECHANICAL CONTRACTOR SHALL PROVIDE THE ENGINEER WITH A BALANCE REPORT BY A CERTIFIED TEST AND BALANCE COMPANY.
- PROVIDE PERMIT LABEL ENGRAVED PLASTIC LAMINATE MECHANICALLY FASTENED TO OUTDOOR UNITS.
- LABEL CEILING GRID WHERE EQUIPMENT IS LOCATED ABOVE LAY-IN CEILING. WITH EQUIPMENT IDENTIFIER. ALSO LABEL ALL TEMPERATURE SENSORS AND THERMOSTATS WITH EQUIPMENT IDENTIFIER.

**MECHANICAL KEY NOTES**

- 1 ROUTE 6" EXHAUST DUCT TO EXTERIOR. TERMINATE IN SOFFIT VENT.

**SYMBOL LEGEND**

SYMBOL	DESCRIPTION
	SHEET METAL DUCT
	EXHAUST FAN
	THERMOSTAT - MOUNTED 48" ABOVE FINISHED FLOOR

**NATURAL VENTILATION SUMMARY**

REQUIRED:  
 TOTAL REQUIRED = 220 SQFT = 0.04 = 9 SQFT


PROVIDED:  
 TOTAL PROVIDED = 21 SQFT (NEW DOOR)

NOTE: NATURAL VENTILATION FROM NEW DOOR IS IN EXCESS OF THE REQUIRED 4% OF SQFT PER NCMC 4022

**SPLIT SYSTEM HEAT PUMP SCHEDULE**

INSIDE UNIT				OUTSIDE UNIT						
MARK	BASIS OF DESIGN	FAN CFM	FLA.	MARK	BASIS OF DESIGN	COOLING / HEATING CAPACITY	ELECTRICAL POWER (MCA/MCOOP)	EFFICIENCY COOLING	EFFICIENCY HEATING	NOTES
FC-1	MTSLEISH-PCA-AIBLA	425	0.9	HP-1	MTSLEISH-PLZ-AIBNKA7	18.0/19.0 MBH	230/1 11 15	19.8 SEER	11.2 HSPF	1-5

NOTES:  
 1. PROVIDE FUSIBLE DISCONNECT ON OUTDOOR UNIT.  
 2. PROVIDE MOTOR RATED SWITCH FOR INDOOR UNIT.  
 3. ROUTE CONDENSATE TO EXTERIOR SPLASH BLOCK.  
 4. PROVIDE WITH WIRED THERMOSTAT.  
 5. PROVIDE WITH LOW AMBIENT CONTROLS DOWN TO 0°F.

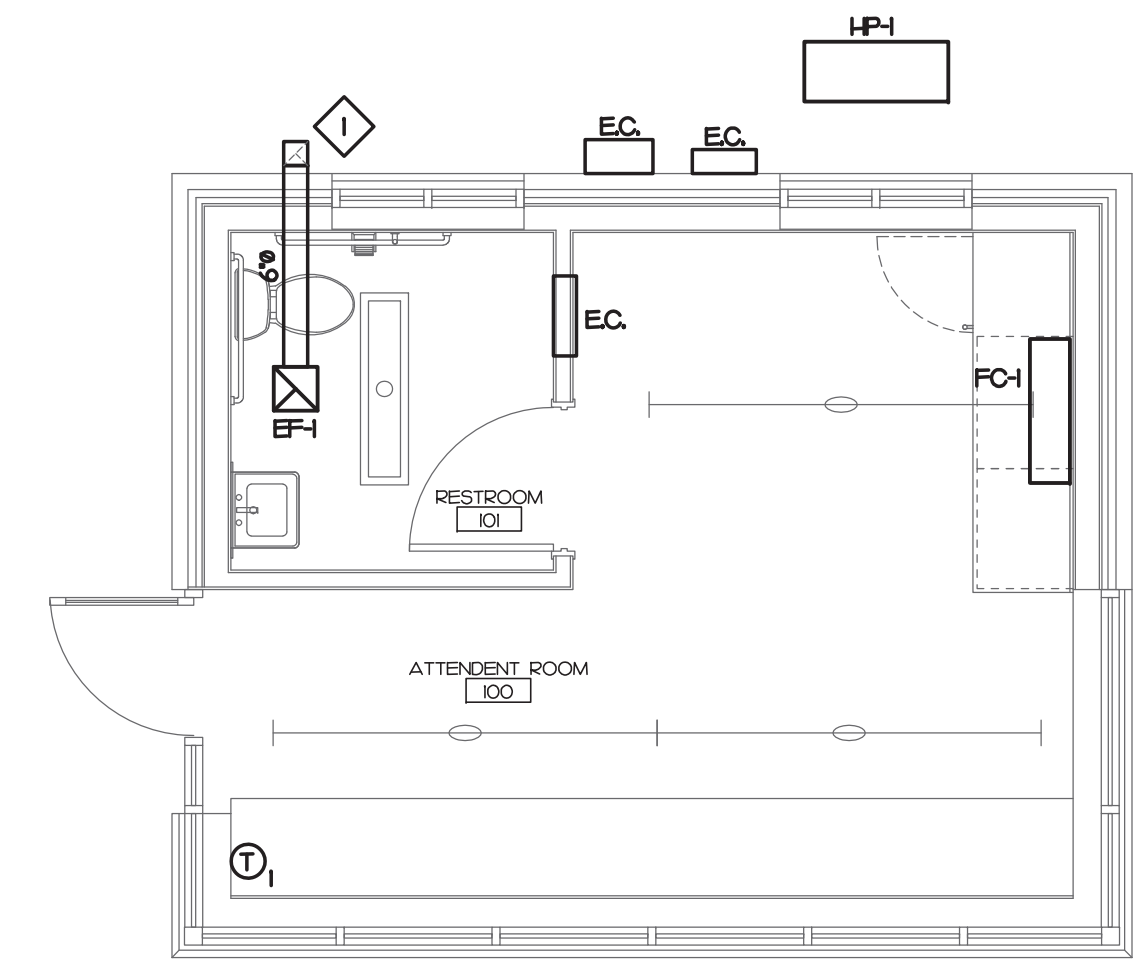


1 MECHANICAL PLAN  
 SCALE: 1/4" = 1'-0"



5100 UNICION DRIVE, SUITE 103  
 WAKE FOREST, NC 27587  
 PHONE: 919.876.5331  
 eddie@gontramarchitecture.com  
 www.gontramarchitecture.com

© COPYRIGHT 2023  
 THESE DOCUMENTS ARE INSTRUMENTS OF SERVICE AND AS SUCH REMAIN THE PROPERTY OF THE ARCHITECT. PUBLISH OR USE THEM ONLY WITH THE ARCHITECT'S EXPRESSED WRITTEN APPROVAL.

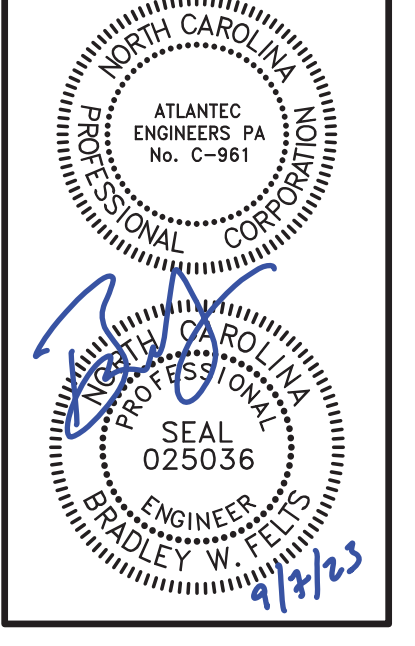

ATTENDANT BUILDING  
 ASSEMBLY COURT SOLID WASTE  
 CONVENIENCE CENTER  
 575 ASSEMBLY COURT | FAYETTEVILLE NC 28306

PLOT DATE:  
 09/08/2023

ISSUED:  
 09/08/2023  
 FOR CONSTRUCTION

REVISION:

DRAWN BY:  
 NGB

APPROVED:  
 BWF

PROJECT NO.:  
 22003

RECORD:


CONTENTS:  
 MECHANICAL PLAN

SHEET:  
**M-01**  
 OF 1



**KEY NOTES**

- ① TYPICAL PULLBOX TO BE AT EACH LIGHT POLE LOCATION FOR CONDUIT CONNECTIONS
- ② E.G. TO PROVIDE DISCONNECT AND MOTOR STARTER WITH HAND OFF AND AUTO SWITCH

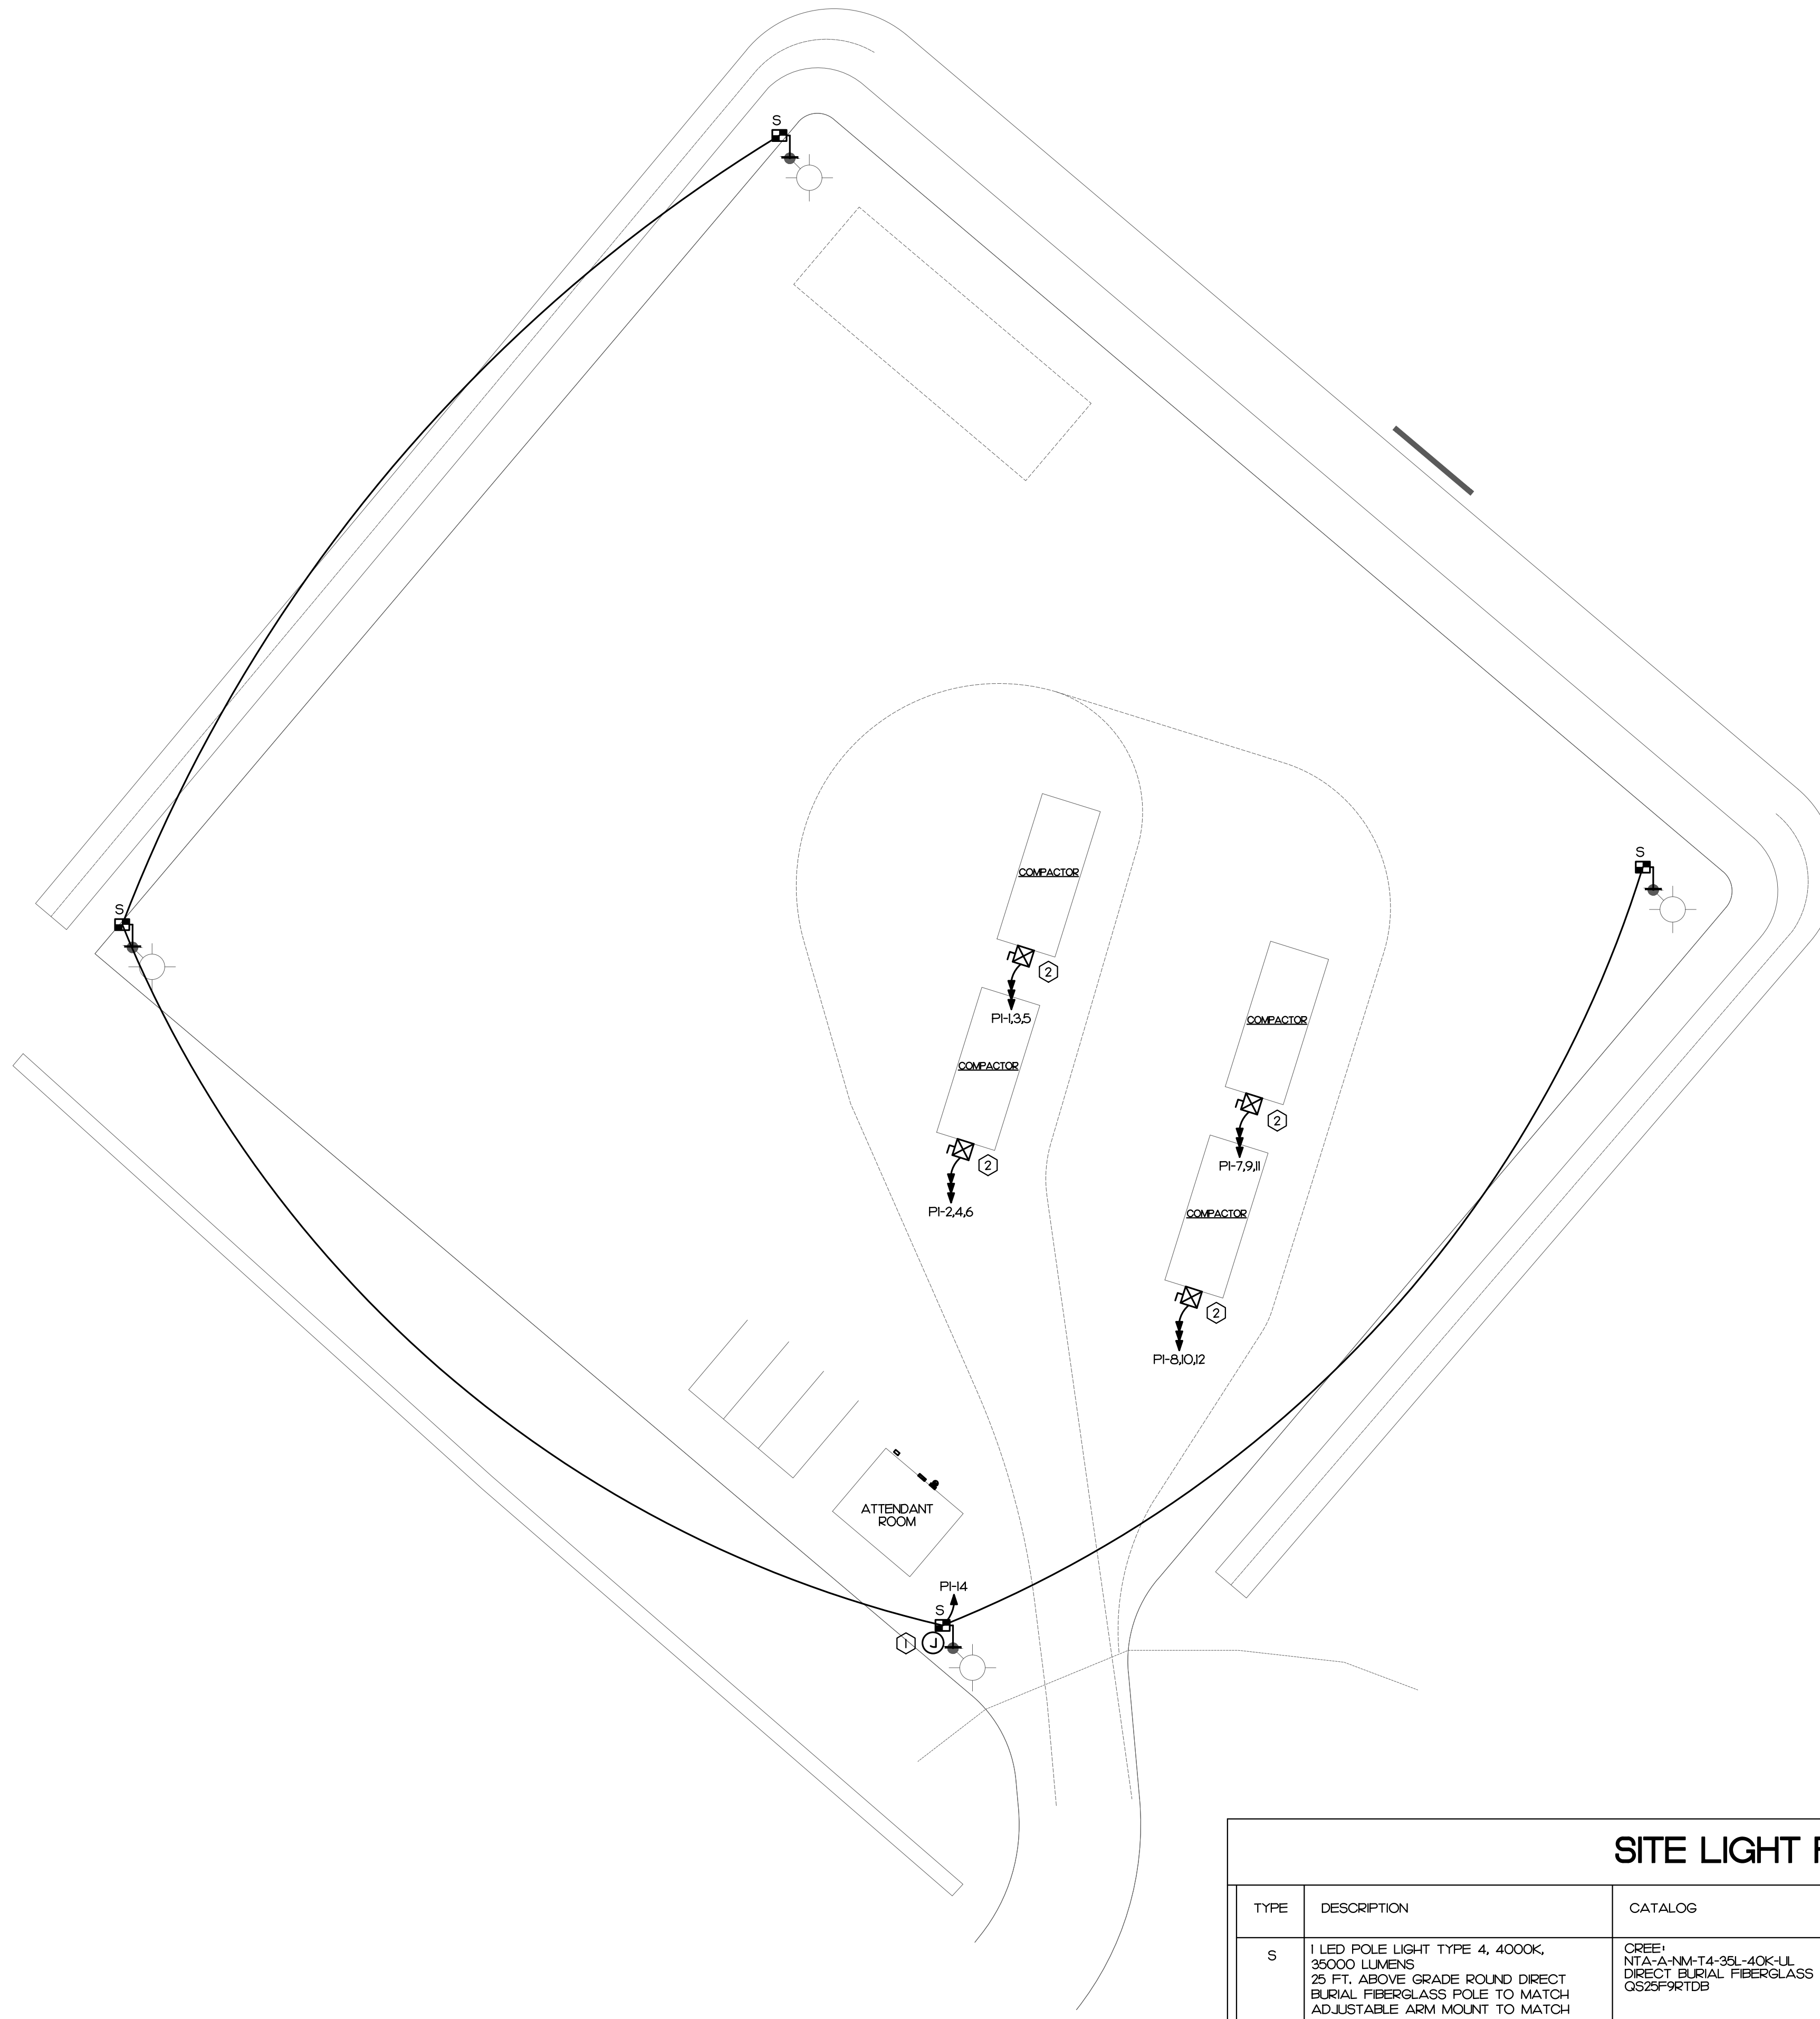

**SITE LIGHT FIXTURE SCHEDULE**

TYPE	DESCRIPTION	CATALOG	ELECTRICAL DATA	NOTES
S	1 LED POLE LIGHT TYPE 4, 4000K, 35000 LUMENS 25 FT. ABOVE GRADE ROUND DIRECT BURIAL FIBERGLASS POLE TO MATCH ADJUSTABLE ARM MOUNT TO MATCH	CREE: NTA-A-NM-T4-35L-40K-UL DIRECT BURIAL FIBERGLASS POLE: QS25F9RTDB	35000 LUMEN LED, 4000K ELECTRONIC DRIVER 230 WATTS - 256 VA, 120-277V	ALL TYPE 'S' FIXTURES TO BE MOUNTED AT 25' POLE TO HAVE AT LEAST 7' EMBEDMENT WITH 25' ABOVE GRADE

**1 SITE POWER PLAN**  
SCALE: 1" = 20'-0"




**GONTRAM ARCHITECTURE, INC.**

5100 UNICON DRIVE, SUITE 103  
WAKE FOREST, NC 27587  
PHONE: 919.876.5331  
eddie@gontramarchitecture.com  
www.gontramarchitecture.com

© COPYRIGHT 2023  
THESE DOCUMENTS ARE INSTRUMENTS OF SERVICE AND AS SUCH REMAIN THE PROPERTY OF THE ARCHITECT. PUBLISH OR USE THEM ONLY WITH THE ARCHITECT'S EXPRESSED WRITTEN APPROVAL.

**ATLANTEC ENGINEERS, PA**  
332 BLUE ROSE ROAD, SUITE 113  
RALEIGH, NC 27612  
(919) 571-1111 2322

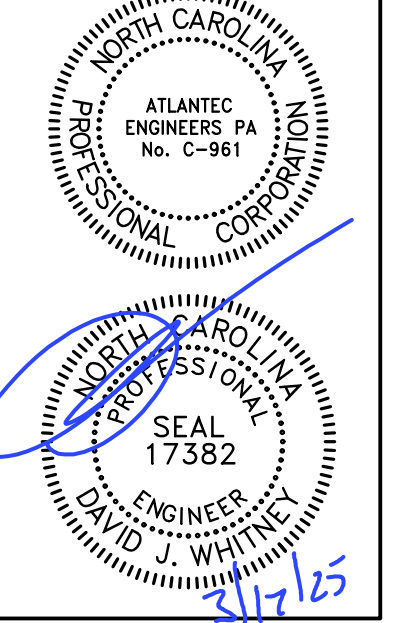

**ATTENDANT BUILDING**  
**ASSEMBLY COURT SOLID WASTE**  
**CONVENIENCE CENTER**  
575 ASSEMBLY COURT | FAYETTEVILLE NC 28306

PLOT DATE: 03/12/2025	
ISSUED: 03/12/2025 FOR CONSTRUCTION	
REVISION:	
DRAWN BY: SWM	APPROVED: DJW
PROJECT NO.: 22003	RECORD:
CONTENTS: SITE POWER PLAN	

SHEET:  
**E1.2**  
OF 3

# SYMBOL LEGEND

SYMBOL	DESCRIPTION	REMARKS
[Symbol]	1 X 4 SURFACE FIXTURE - LETTER DESIGNATES TYPE	SEE FIXTURE SCHED.
[Symbol]	LINEAR STRIP FIXTURE - LETTER DESIGNATES TYPE	SEE FIXTURE SCHED.
[Symbol]	WALL SCONCE LIGHT FIXTURE - LETTER DESIGNATES TYPE	SEE FIXTURE SCHED.
[Symbol]	EXTERIOR WALL LIGHT FIXTURE - LETTER DESIGNATES TYPE	SEE FIXTURE SCHED.
[Symbol]	EMERGENCY WITH EXIT LIGHT - CONNECT UNSWITCHED	SEE FIXTURE SCHED.
[Symbol]	BATTERY BACKUP EMERGENCY LIGHT - CONNECT UNSWITCHED	SEE FIXTURE SCHED.
[Symbol]	PHOTOCELL, 105-305VAC, 50/60HZ, 1800VA BALLAST LOAD, 1000W TUNGSTEN LOAD, 8A LED LOAD (LP TO 220W @277V)	TORQ: ZSS24
[Symbol]	POLE MOUNT FIXTURE WITH 1 LUMINAIRE - LETTER DESIGNATES TYPE	SEE FIXTURE SCHED.
[Symbol]	SINGLE POLE TOGGLE SWITCH, MOUNT 4" AFF, UNLESS NOTED OTHERWISE.	HUBBELL I231-TR WITH NPJ COVER PLATE
[Symbol]	WALL MOUNTED OCCUPANCY SENSOR SWITCH, DUAL TECHNOLOGIES, MOUNT 4" AFF, UNLESS NOTED OTHERWISE. 800W/120VAC OR 1200W/277VAC	SENSORWORX SWX-I2-TR WITH NPJ26 COVER PLATE
[Symbol]	SPECIFICATION GRADE DUPLEX TAMPER RESISTANT RECEPTACLE, MOUNT 6" AFF, UNLESS OTHERWISE NOTED.	HUBBELL HBL5362-TR WITH NPJ26 COVER PLATE
[Symbol]	SPECIFICATION GRADE TAMPER RESISTANT GFCI RECEPTACLE, MOUNT 6" AFF, UNLESS OTHERWISE NOTED.	HUBBELL GFTIRST20-TR WITH NPJ26 COVER PLATE
[Symbol]	SPECIFICATION GRADE DUPLEX TAMPER RESISTANT RECEPTACLE, MOUNT 6" AFF, UNLESS OTHERWISE NOTED. FED FROM GFCI CIRCUIT BREAKER.	HUBBELL GFTWRST20-TR WITH WP26M COVER PLATE
[Symbol]	CEILING PANEL CABINET FAN, FURNISHED AND INSTALLED BY MC, WIRED BY EC.	SEE MECH. PLAN.
[Symbol]	JUNCTION BOX SIZED PER NEC.	
[Symbol]	DISCONNECT SWITCH SEE PLANS FOR SIZE AND TYPE	SQUARE D HEAVY DUTY
[Symbol]	DISCONNECT SWITCH WITH MOTOR STARTER, SEE PLANS FOR SIZE AND TYPE	SQUARE D HEAVY DUTY
[Symbol]	NEW CONCEALED WIRING	PER NEC.
[Symbol]	UNSWITCHED LIGHTING CONDUCTOR	PER NEC.
[Symbol]	HOME RUN TO PANEL BOARD, NUMBERS OF ARROW INDICATE CIRCUITS	PER NEC.
[Symbol]	120/240V 1Ø, 3W PANEL BOARD - SEE PANEL SCHEDULES	SQUARE D NQ/H-LINE
[Symbol]	277/480V 3Ø, 4W PANEL BOARD - SEE PANEL SCHEDULES	SQUARE D NF/H-LINE
[Symbol]	UTILITY METER BASE	SEE POWER RISER
A.F.C.	ABOVE FINISHED CEILING	
A.F.F.	ABOVE FINISHED FLOOR - NOTE ALL MOUNTING DIMENSIONS GIVEN ARE TO THE BOTTOM OF THE OUTLET BOX	

# GENERAL NOTES

- THE CONTRACTOR SHALL REFER TO THE ARCHITECTURAL PLANS FOR FLOOR PLAN DIMENSIONS. DO NOT SCALE THESE DRAWINGS.
- THE ELECTRICAL CONTRACTOR SHALL COORDINATE ANY AND ALL WORK WITH OTHER TRADES INVOLVED IN THE PROJECT, PRIOR TO THE INSTALLATION OF HIS EQUIPMENT SO AS TO AVOID CONFLICTS DURING CONSTRUCTION AND TO ALLOW FOR OPTIMUM MAINTENANCE AND WORKING SPACE.
- USE OF THE CONDUIT SYSTEM FOR EQUIPMENT GROUNDING SHALL NOT BE ACCEPTABLE. A SEPARATE GREEN GROUND WIRE SHALL BE RUN WITH THE CIRCUIT CONDUCTORS IN EACH CONDUIT.
- ALL BREAKER SIZES, SHOWN FOR MECHANICAL EQUIPMENT, SHALL BE VERIFIED BEFORE THE PURCHASE OR INSTALLATION OF SAID EQUIPMENT, WITH THE EQUIPMENT SUPPLIER AND THE MECHANICAL CONTRACTOR.
- ALL WORK AND MATERIAL SHALL BE PROVIDED IN ACCORDANCE WITH THE STATE, LOCAL AND NATIONAL CODES, ORDINANCES AND 2020 NATIONAL ELECTRICAL CODE (NFPA 70).
- EACH CONTRACTOR SHALL PROVIDE HIS OWN SUPPORT OF ALL DEVICES AND EQUIPMENT PROVIDED BY HIM AND SHALL SUPPORT SUCH EQUIPMENT PER APPROVED GOVERNING CODES OR PER APPROVAL OF THE ENGINEER. UNACCEPTABLE WORKMANSHIP OR MATERIALS SHALL BE REPLACED AT THE REQUEST OF THE ENGINEER AT THE CONTRACTOR'S EXPENSE.
- THE MOUNTING HEIGHTS AND LOCATIONS OF ALL WALL MOUNTED OUTLETS AND JUNCTION BOXES SHALL BE REVIEWED AND COORDINATED WITH THE ARCHITECT, PRIOR TO INSTALLATION FOR USE WITH THE ACTUAL EQUIPMENT, CASEWORK, AND MILLWORK TO BE FURNISHED.
- THE ELECTRICAL CONTRACTOR SHALL PROVIDE ALL NECESSARY DISCONNECTS, SWITCHES, AND RECEPTACLES UNDER THE ELECTRICAL BID AND SHALL INCLUDE ALL NECESSARY CIRCUITS TO AND FINAL CONNECTIONS TO THE EQUIPMENT PROVIDED BY ALL SUPPLIERS. SEE DETAILS FOR CONNECTION TO EQUIPMENT PROVIDED BY MECHANICAL AND PLUMBING CONTRACTORS.
- PENETRATION:
  - WHERE ELECTRICAL EQUIPMENT PENETRATES RATED WALLS AND CEILINGS, EXTERIOR WALLS, THEY SHALL BE PROPERLY SEALED PER APPROVED UL METHODS.
  - WHERE ELECTRICAL EQUIPMENT PENETRATES EXTERIOR WALLS, THEY SHALL BE PROPERLY SEALED WITH METHODS APPROVED BY THE ENGINEER. SUBMIT DETAIL OF PROPOSED SEALING METHODS.
- ALL PERMITS AND INSPECTION FEES SHALL BE SECURED AND PAID BY THE ELECTRICAL CONTRACTOR.
- ALL WORK SHALL BE PERFORMED BY A LICENSED ELECTRICAL CONTRACTOR.
- THE CONTRACTOR SHALL PROVIDE COMPLETE UPDATED TYPEWRITTEN PANEL SCHEDULES FOR ALL PANELBOARDS.
- AS BUILT DRAWINGS SHALL BE GIVEN TO THE OWNER AT THE COMPLETION OF THE PROJECT.
- THE CONTRACTOR SHALL VERIFY THE CEILING TYPES WITH THE GENERAL CONTRACTOR PRIOR TO THE PURCHASE OF ANY LIGHT FIXTURES SO THAT THE PROPER TRIM WILL BE PROVIDED FOR ALL FIXTURES. ANY DIFFERENCES WILL BE THE RESPONSIBILITY OF THIS CONTRACTOR.
- ALL WIRE SIZES INDICATED ON THE PANEL SCHEDULES ARE BASED ON 75 DEGREE COPPER TH-IN-TWIN WIRE. ALL WIRE TERMINALS AND EQUIPMENT SHALL BE LISTED AND APPROVED FOR 75°C. ONLY THINW-2 WIRE SHALL BE INSTALLED IN WET AND EXTERIOR LOCATION.
- MINIMUM CONDUIT SIZE SHALL BE 1/2" AND MINIMUM WIRE SIZE SHALL BE #12 AWG.
- ARMORED CABLE (TYPE AC) AND METAL-CLAD CABLE (TYPE MC) ARE ACCEPTABLE WIRING METHODS SUBJECT TO THE FOLLOWING RESTRICTIONS:
  - SEE NEC 320 AND 330 FOR RESTRICTION.
  - PENETRATIONS OF RATED WALLS SHALL BE IN ACCORDANCE WITH APPROVED UL PENETRATION METHODS.
  - CABLE SHALL NOT BE USED FOR HOME RUN TO PANEL BOARD.
  - CABLE SHALL ONLY BE INSTALLED IN CONCEALED SPACE AND FURRED AREAS. MAX. LENGTH OF EACH SECTION IN ACCESSIBLE CONCEALED CEILING SPACES SHALL NOT EXCEED 10 FT.
  - WHERE REQUIRED BY NEC 577.3, CABLE SHALL BE LISTED FOR THE USE.
- THE MAXIMUM NUMBER OF HOMERUNS IN A CONDUIT SHALL NOT EXCEED THREE (3). FEEDING CIRCUITS WITH SHARED NEUTRAL SHALL BE SWITCHED TOGETHER.
- ALL DISCONNECTS SHALL HAVE SEPARATE NEUTRAL AND GROUND BARS.
- ALL PANELS SHALL BE ONE PHASE, THREE WIRE UNLESS OTHERWISE NOTED.
- BOXES AND CONDUITS SHALL NOT BE INSTALLED RECESSED IN A 3-HOUR OR HIGHER RATED WALL WHEN OUTLETS ARE INDICATED ON THESE WALLS. FIELD COORDINATE CONDUIT AND BOX INSTALLATION.
- ELECTRICAL IDENTIFICATION
  - FURNISH AND INSTALL ENGRAVED LAMINATED PHENOLIC NAMEPLATES FOR ALL SAFETY SWITCHES, PANEL BOARDS, TRANSFORMERS, SWITCHBOARDS, MOTOR CONTROL CENTERS AND OTHER ELECTRICAL EQUIPMENT SUPPLIED FOR THE PROJECT FOR IDENTIFICATION.
  - FURNISH AND INSTALL SELF-ADHESIVE PLASTIC TAPE FOR ALL RECEPTACLE AND WALL SWITCH COVER PLATES INDICATING CIRCUIT NUMBERS.
- THE ELECTRICAL CONTRACTOR SHALL FIELD COORDINATE THE INSTALLATION OF THE NEW UNDERGROUND ELECTRICAL SERVICE WITH THE LOCAL UTILITY. THE OWNER SHALL PAY ALL CHARGES FOR THE INSTALLATION OF THE NEW UNDERGROUND UTILITY SERVICE.

# 2018 NORTH CAROLINA ENERGY CODE

ELECTRICAL SYSTEM AND EQUIPMENT METHOD OF COMPLIANCE - PRESCRIPTIVE

LAMP TYPE REQUIRED	LIGHTING SCHEDULE			
	FLUORESCENT T8/T5	LED	CFL	INCAN
NUMBER OF LAMPS	N/A	SEE	N/A	N/A
BALLAST TYPE USED	N/A	FIXTURE SCHEDULE	N/A	N/A
NUMBER OF BALLASTS	N/A	SCHEDULE	N/A	N/A
TOTAL WATTAGE PER FIXTURE	N/A		N/A	N/A


INTERIOR WATTAGE	SPECIFIED	ALLOWED BY CODE
OFFICE		268
TOTAL	230	241 **
EXTERIOR WATTAGE	ZONE 3	
ALLOWANCE	32	750

**NOTES:**

- \*\* PER SECTION C406.3, THE WHOLE AREA ALLOWED BY CODE IS REQUIRED TO BE 10% LOWER THAN THOSE CALCULATED PER SECTION C406.4.2.
  - VALUE CALCULATE PER SECTION C406.4.2: 268 WATTS
  - VALUE PER SECTION C406.3: 241 WATTS
- ALL EXTERIOR LIGHTS:
  - CONTROLLED BY PHOTOCELL THAT WILL NOT INTENDED TO BE ON FOR 24 HOUR OPERATION.

DESIGNER STATEMENT: TO THE BEST OF MY KNOWLEDGE AND BELIEF, THE DESIGN OF THIS BUILDING COMPLES WITH THE ELECTRICAL SYSTEM AND EQUIPMENT REQUIREMENTS OF THE NORTH CAROLINA STATE BUILDING CODE, 2018 - ENERGY.

SIGNED: [Signature]  
 NAME: DAVID L. WHITNEY, P.E.  
 TITLE: ENGINEER

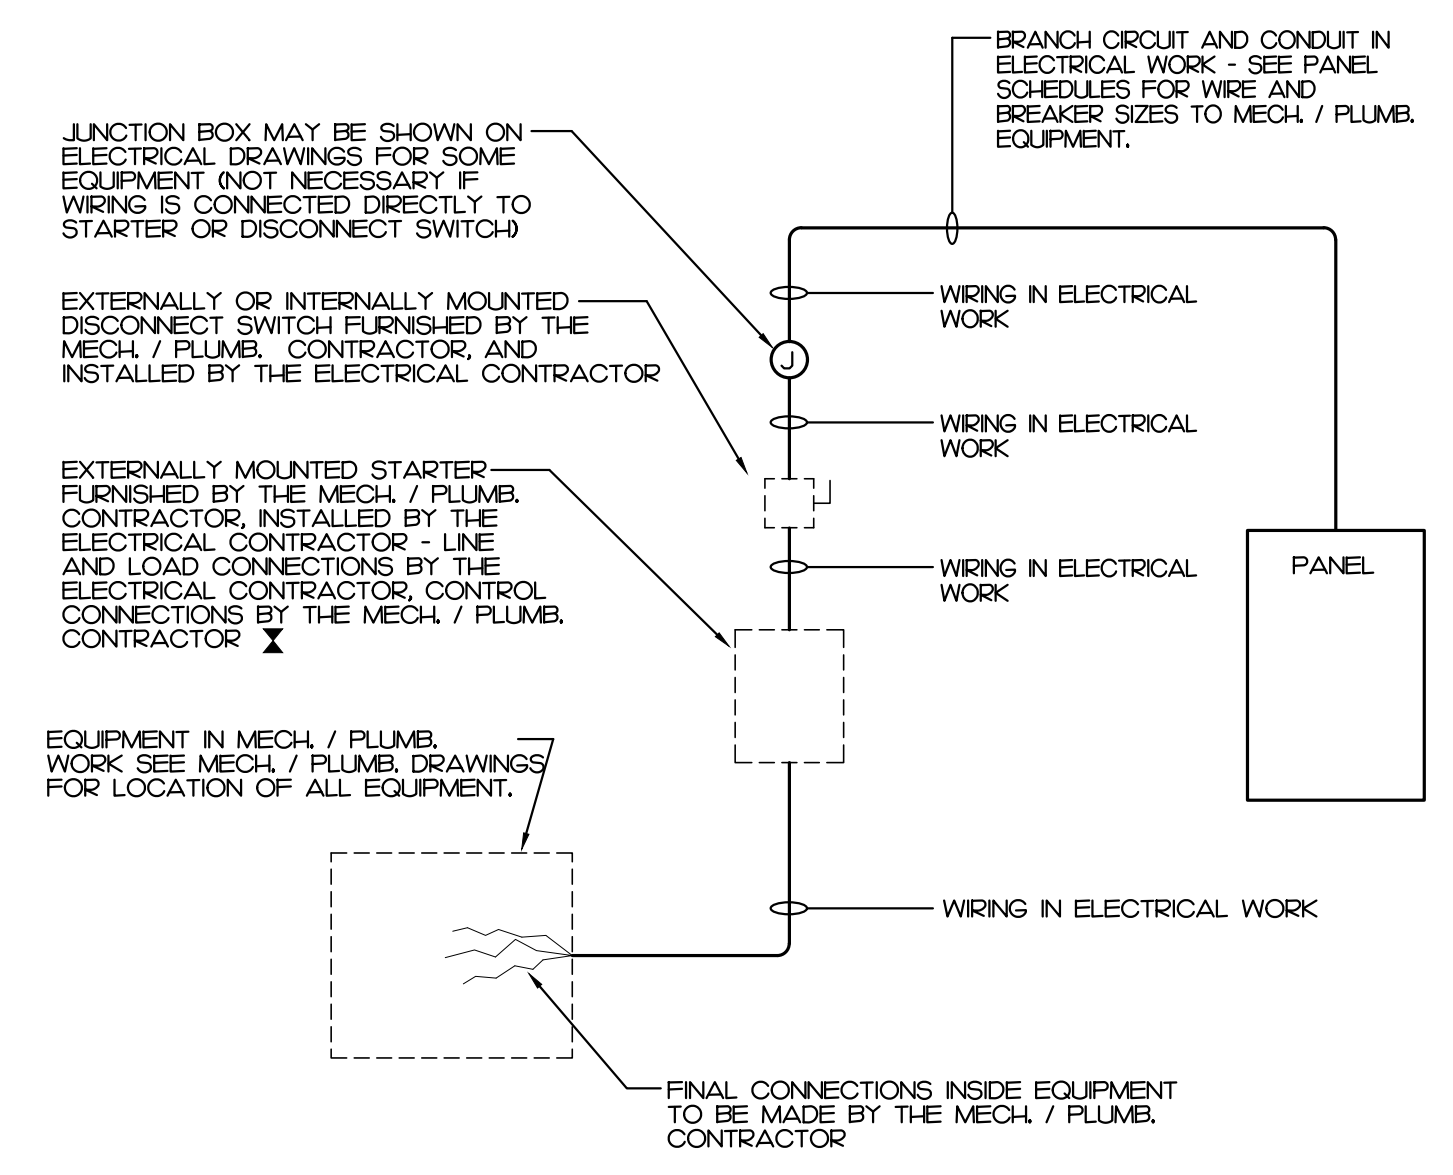

**NOTES:**

- A COMBINATION STARTER MAY BE USED IN LIEU OF A SEPARATE DISCONNECT SWITCH AND STARTER.
- E.C. SHALL FURNISH ALL REQUIRED FUSES.

**WIRING TO MECHANICAL AND PLUMBING EQUIPMENT**  
 NOT TO SCALE

# LIGHT FIXTURE SCHEDULE

TYPE	DESCRIPTION	CATALOG	ELECTRICAL DATA	NOTES
A	8' STRIP LIGHT 6000 LUMEN	LITHONIA: CSS-L96-AL04-MVOLT-35K-80CRI	6000 LUMEN LED, 3500K 0-10V ELECTRONIC DIMMING DRIVER 46 WATTS - 5I VA, 120-277V	
B	1x4 LED FLAT PANEL FIXTURE SURFACE MOUNTED 2500 LUMEN	LITHONIA: CPX-1X4-AL07-80CRI-SWW7-TR-MVOLT	2500 LUMEN LED, 3500K 0-10V ELECTRONIC DIMMING DRIVER 20 WATTS - 22 VA, 120-277V	
C	EXTERIOR WALL PACK 3000 LUMEN	LITHONIA: WIDGEZLED-P3-30K-80CRI-TR-MVOLT-SRM	3000 LUMEN LED, 3000K ELECTRONIC DRIVER 18 WATTS, 20 VA, 120-277V	
EGX	EMERGENCY WITH EXIT LIGHT 1 SIDE RED LETTER	LITHONIA: LHQW-LED-R-SD	4 WATTS - 4 VA, 120/277V	
BH	EXTERIOR EMERGENCY LIGHT LISTED FOR WET LOCATION	LITHONIA: AFF-OEL-TR-FCT	11 WATTS - 12 VA, 120/277V	
EG	EMERGENCY LIGHT	LITHONIA: ELM2L-SDRT	2 WATTS - 2 VA, 120/277V	

**NOTES:**


- SEE ARCHITECTURAL PLAN FOR MOUNTING LOCATION AND HEIGHT. FIELD COORDINATE MOUNTING HEIGHT WITH ARCHITECT. IF NOT SHOWN ON ARCHITECTURAL PLAN.
- E.C. SHALL SUBMIT CATALOG TO ARCHITECT FOR APPROVAL PRIOR PURCHASE ANY FINISH COLOR/TERM SUBJECT TO BE CHANGED PER ARCHITECT.
- FIELD VERIFY FLUORESCENT LAMP COLOR WITH ARCHITECT PRIOR PURCHASE ANY.



**GONTRAM ARCHITECTURE, INC.**  
 5100 UNICON DRIVE, SUITE 103  
 WAKE FOREST, NC 27587  
 PHONE: 919.876.5331  
 eddie@gontramarchitecture.com  
 www.gontramarchitecture.com

© COPYRIGHT 2023  
 THESE DOCUMENTS ARE INSTRUMENTS OF SERVICE AND AS SUCH REMAIN THE PROPERTY OF THE ARCHITECT. PUBLISHER OR USER THEREOF WITHOUT THE ARCHITECT'S EXPRESSED WRITTEN APPROVAL.

**ATLANTEC ENGINEERS, PA**  
 332 BLUE ROSE ROAD, SUITE 113  
 RALEIGH, NC 27602  
 (919) 571-1111 2322

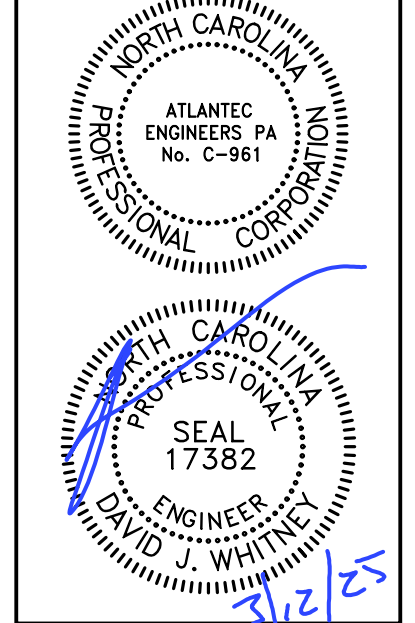

**ATTENDANT BUILDING ASSEMBLY COURT SOLID WASTE CONVENIENCE CENTER**  
 575 ASSEMBLY COURT | FAYETTEVILLE NC 28306

PLOT DATE: 03/12/2025	
ISSUED: 03/12/2025 FOR CONSTRUCTION	
REVISION:	
DRAWN BY: SWM	APPROVED: DJW
PROJECT NO.: 22003	RECORD:
CONTENTS: SYMBOL LEGEND GENERAL NOTES DETAILS	

SHEET:  
E2.1  
 OF 3